

REQUEST FOR PROPOSALS
(COMPETITIVE SEALED PROPOSALS)

**Hospital Reheat Hot Water System
Upgrade**

RFP No:
HHSC 21-0044
ADDENDUM #3
(Revised/new items are highlighted)

for


Hawaii Health Systems Corporation
West Hawaii Region
Kona Community Hospital

Yvonne S. Taylor, Contracts
Kona Community Hospital
79-1019 Haukapila Street
Kealahou, HI 96750
Telephone (808) 322-9311
Fax (808) 322-4488
<http://www.kch.hhsc.org/Procurement/default.aspx>
An Agency of the State of Hawaii

1. Questions and Answers

Q1: Sheet M-106 Detail B – Extend Concret Pad. Please provide structural details. These two boilers will weigh approx. 3,000 lbs combined. Please confirm roof can support the load.

A1: See the concrete pad detail for the boiler. With review from the Sturctureal Engineer, the roof will support the load.

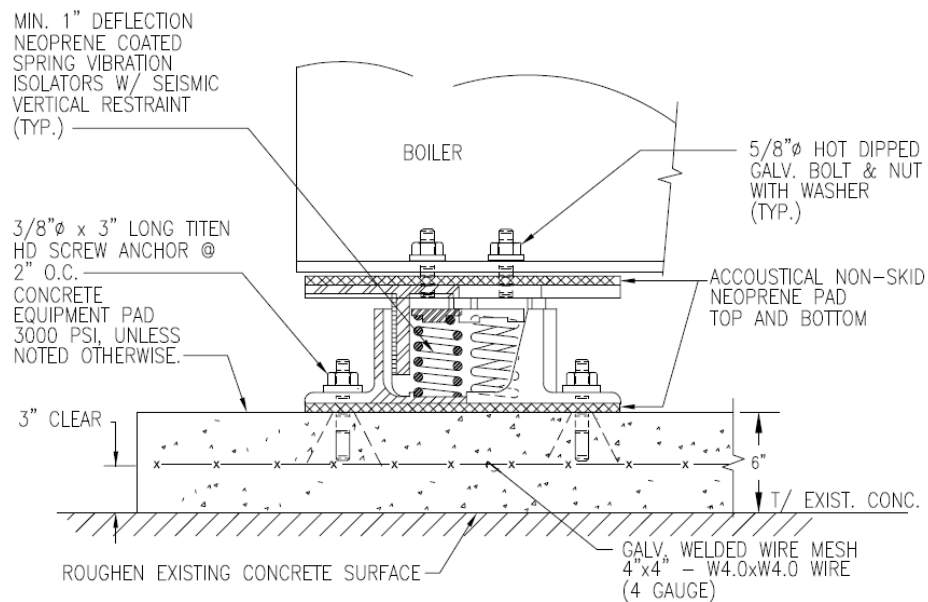

4 BOILER UNIT
MOUNTING DETAIL
NO SCALE

Q2: Sheet M-100 refers to sheets M-202 – M-205, do these sheets exists?

A2: Please disregard page M-100 as it has been removed.