

# REQUEST FOR PROPOSALS

(COMPETITIVE SEALED PROPOSALS)

# Hospital Re-heat Hot Water System Upgrade

RFP No: HHSC 21-0044

for

# Hawaii Health Systems Corporation West Hawaii Region Kona Community Hospital

Yvonne S. Taylor, Contracts
West Hawaii Region
79-1019 Haukapila Street
Kealakekua, HI 96750
Telephone (808) 322-9311
Fax (808) 322-4488
http://www.kch.hhsc.org/Procurement/default.aspx
An Agency of the State of Hawaii

# **TABLE OF CONTENTS**

| SECTION 1 ADMINISTRATION  | 1 -   |
|---|-------|
| 1.0 INTRODUCTION  | . 1   |
| 1.1 RFP TIMETABLE   |       |
| 1.2 AUTHORITY   |       |
| 1,2.1 RFP ORGANIZATION  |       |
| 1.3 REGIONAL CHIEF EXECUTIVE OFFICER (RCEO)                     |       |
| 1.4 DESIGNATED OFFICIALS  | 3 -   |
| 1.4.1 ISSUING OFFICER   |       |
| 1.5 HHSC ORGANIZATIONAL INFORMATION                             |       |
| 1.5.1 CHARTER   | 4-    |
| 1.5.2 STRUCTURE AND SERVICES                                    | 4 -   |
| 1.5.3 MISSION   |       |
| 1.6 FACILITY INFORMATION  |       |
| 1.7 SUBMISSION OF QUESTIONS                                     | 4 -   |
| 1.8 RFP REVIEW  |       |
| 1.9 RFP AMENDMENTS  |       |
| 1.10 CANCELLATION OF RFP  |       |
| 1.11 GRIEVANCE  | 5 -   |
|   |       |
| SECTION 2 SCOPE OF SERVICES                                     | 7 -   |
|   | _     |
| 2.0 SCOPE OF SERVICES   | 7 -   |
| SECTION 3 PROPOSALS   | 10    |
| SECTION 3 PROPOSALS   | 12 -  |
| 3.0 INTRODUCTION  | 12    |
| 3.1 PROPOSAL PREPARATION  |       |
| 3.1.1 MANDATORY PROPOSAL TABS                                   |       |
| 3.2 COSTS FOR PROPOSAL PREPARATION                              |       |
| 3.3 DISQUALIFICATION OF PROPOSALS                               |       |
| 3.4 SUBMISSION OF PROPOSALS                                     |       |
| 3.5 PROPOSAL TRANSMITTAL COVER LETTER                           | 14 -  |
| 3.6 PUBLIC INSPECTION   |       |
| 3.7 TECHNICAL SECTION   |       |
| 3.7.1 SUMMARY   | 14 -  |
| 3.7.2 THIS SECTION IS DELETED                                   | 14 -  |
| 3.7.3 MANDATORY QUESTIONS                                       | 14 -  |
| 3.8 PRICE PROPOSAL  | 15 -  |
| 3.8.1 PRICE   |       |
| 3.9 REQUIREMENTS  | 15 -  |
| 3.10 REQUIRED DOCUMENTATION/COMPLIANCE DOCUMENTS                |       |
| 3.11 PROPOSAL SUBMISSION CHECKLIST                              | 15 -  |
|   |       |
| SECTION 4 EVALUATIONS   | 17 -  |
|   |       |
| 4.0 INTRODUCTION  | 17 -  |
| 4.1 PROPOSAL EVALUATION COMMITTEE                               |       |
| 4.2 EVALUATION PHASES   | 17 -  |
| 4.2.1 PHASE 1 EVALUATION OF MANDATORY REQUIREMENTS              |       |
| 4.2.2 PHASE 2 TECHNICAL SECTION EVALUATION                      |       |
| 4.2.3 PHASE 3 DETERMINATION OF SHORT-LISTED OFFERORS (OPTIONAL) | 17/ - |
| 4.2.4 PHASE 4 PROPOSAL DISCUSSIONS WITH SHORT-LISTED OFFERORS   | 1.0   |
| (OPTIONAL)4.2.5 PHASE 5 BEST AND FINAL OFFERS (OPTIONAL)        | 18 -  |
| 4.2.5 PHASE 5 BEST AND FINAL OFFERS (OPTIONAL)                  | 18 -  |

| 4.2.6 PHASE 6 RECOMMENDATION FOR CONTRACT AWARD        | - 18 - |
|--|--------|
| 4.3 EVALUATION CATEGORIES AND VALUE WEIGHT PERCENTAGES |        |
| 4.4 EVALUATION SCORING SYSTEM                          |        |
| 4.4 EV/LO/(1101/ 0001(11/0 0101 EW)                    | 10     |
| SECTION 5 AWARD OF CONTRACT                            | _ 19 _ |
|  | 17     |
| 5.0 AWARD OF CONTRACT                                  | 19 -   |
| 5.1 CONTRACT AWARD NOTIFICATION                        | 19 -   |
| 5.2 CONTRACT AWARD DEBRIEFING                          |        |
| 5.2.1 CONTRACT DOCUMENT                                |        |
| 5.2.2 GENERAL EXCISE/USE TAX                           | 19 -   |
| 5.3 CONTRACT EXECUTION                                 | 20 -   |
| 5.4 CONTRACT COMMENCEMENT DATE                         | 20 -   |

# Table of FiguresFigure 1. Procurement Schedule- 2 -Figure 2. RCEO – Regional Chief Executive Officer- 3 -Figure 3. Issuing Officer- 3 -Figure 4. Contact for Relevant Questions- 5 -Figure 5. Website for all Procurement Activities- 6 -Figure 6. Mandatory Proposal Tabs- 12 -Figure 7. Mandatory Proposal Item Identification- 13 -Figure 8. Address for Proposal Submittals- 13 -Figure 9. Mandatory Proposal Package Marking- 14 -Figure 10. Proposal Evaluation Phases- 17 -Figure 11. Evaluation Categories and Value Weight Percentages- 18 -

#### **List of Appendices**

APPENDIX A

Sample Proposal Transmittal Cover Letter

APPENDIX B

Proposal Submission Checklist

APPENDIX C

Sample

APPENDIX D

1999 DAGS interim General Conditions

APPENDIX E

mandatory questions -

APPENDIX F

Agenda for Pre-Proposal Conference with Tour of Hospital Facilities

APPENDIX G

RFP Conference Reservation Form

APPENDIX H

Mandatory Hospital Tour Confidentiality Agreement

APPENDIX I

subcontractor table

APPENDIX J

**Drawings** 

APPENDIX K

Specifications/Project Manual

APPENDIX L

Contractors Handbook

#### **SECTION 1 ADMINISTRATION**

#### 1.0 INTRODUCTION

HHSC invites proposals from qualified and experienced licensed general contractors to provide a an upgrade to KCH's reheat hot water system. KCH worked with a design firm to upgrade our current HVAC re-heat boiler system. We are currently using Rinnai water heaters that are not efficient for a closed loop operating system and does not give us adequate hot water flow, volume, or temperature for humidity control. The design upgrade includes new boilers, pumps, buffer tank, plumbing, direct digital controls, and balancing valve replacement.

This Request for Proposal (hereinafter "RFP") is issued by the Hawaii Health Systems Corporation West Hawaii Region Kona Community Hospital (hereinafter "HHSC"), a public body corporate and politic and an instrumentality and Agency of the State of Hawaii. This solicitation is governed by the applicable provisions of Hawaii Revised Statutes ("HRS") and implementing policies. All procedures and processes will be in accordance with applicable HRS Chapters including, but not limited to, 323F. To the extent this solicitation contains any terms or provisions inconsistent with applicable HRS Chapters and implementing policies, the statutes and the policies will control.

Thank you for your interest in submitting a proposal for this solicitation. The rationale for this competitive sealed RFP is to promote and ensure the fairest, most efficient means to obtain the **most qualified contractor** to HHSC, i.e. the proposal offering the greatest overall combination of quality of work and service and pricing. Hereinafter, organizations interested in submitting a proposal in response to this RFP shall be referred to as "OFFEROR".

As an offeror, you are expected to submit proposals that are accurate, complete, and contain all terms and conditions which you feel are necessary. If, after submitting your proposal, you find changes are necessary, you may change or withdraw your proposal any time up to the time of the proposal opening. However, after the opening, the proposal may not be changed or altered in any way.

In order for HHSC to evaluate OFFEROR'S response in a timely manner, please thoroughly read this RFP and follow instructions as presented.

#### 1.1 ACCELERATED RFP TIMETABLE

The timetable as presented represents HHSC's best estimated schedule. If an activity of the timetable, such as "Closing Date for Receipt of Proposals" is delayed, the rest of the timetable dates may be shifted. OFFEROR will be advised, by addendum to the RFP, of any changes to the timetable. Contract start date will be subject to the issuance of a Notice to Proceed.

| No. | Activity  | Planned Date                                     |
|-----|---|--|
| 1.  | RFP Public Announcement   | October 8, 2020                                  |
| 1A  | Pre-Proposal Conference at Kona Community Hospital Tour of Hospital Facilities. Reservation form (Appendix G) and signed Confidentiality Agreement (Appendix H) must be received no later than Friday, Oct. 16, 2020 This meeting is MANDATORY for all Offerors. See Appendix F for Agenda. | Tuesday October 20, 2020<br>8:30am – 10:00am HST |
| 2.  | Closing Date for Receipt of Questions   | Friday, October 23, 2020<br>2:00pm HST           |
| 3.  | Addendum for HHSC Response to OFFEROR's Questions   | Wednesday, October 28, 2020                      |
|     |   | Wed, November 12, 2020                           |
| 4.  | Closing Date for Receipt of Proposals   | 2:00pm HST                                       |
| 5.  | Mandatory Requirements Evaluation   | November 13, 2020                                |
| 6.  | Proposal Evaluations  | November 18, 2020                                |
| 7.  | Proposal Discussions (optional)   |  |
| 8.  | Best and Final Offers (optional)  |  |
| 9.  | Contractor Selection/Award Notification (on/about)  | November 19, 2020                                |
| 10. | Contract Execution Period   | November 20-25, 2020                             |
| 11. | Contract Tentative Award Date   | November 25, 2020                                |

Figure 1. Procurement Schedule

#### 1.2 **AUTHORITY**

This RFP is issued under the provisions of the applicable Hawaii Revised Statutes (HRS). All OFFERORS are charged with presumptive knowledge of all requirements of the cited authorities. Submission of a valid executed proposal by any OFFEROR shall constitute admission of such knowledge on the part of such OFFEROR.

#### 1.2.1 RFP ORGANIZATION

This RFP is organized into five Sections:

SECTION 1: ADMINISTRATIVE

Provides information regarding administrative requirements.

SECTION 2: SCOPE OF SERVICES

Provides a detailed description of goods and/or services to be

provided and delineates HHSC and CONTRACTOR

responsibilities.

SECTION 3: PROPOSALS

Describes the required format and content for submission of a

proposal.

SECTION 4: EVALUATION

describes how proposals will be evaluated and lists the "value

weight percentages" of the evaluation categories.

SECTION 5: AWARD OF CONTRACT

Describes procedures for selection and award of contract.

#### 1.3 REGIONAL CHIEF EXECUTIVE OFFICER (RCEO)

The RCEO for HHSC West Hawaii Region, or designee, is authorized to execute any and all Agreements (Contracts), resulting from this RFP.

The RCEO for this RFP is:

James Y. Lee, RCEO West Hawaii Region Hawaii Health Systems Corporation 79-1019 Haukapila Street Kealakekua, HI 96750

Figure 2. RCEO - Regional Chief Executive Officer

#### 1.4 DESIGNATED OFFICIALS

The officials identified in the following paragraphs have been designated by the RCEO as HHSC's procurement officials responsible for execution of this RFP, award of Agreement and coordination of CONTRACTOR's satisfactory completion of contract requirements.

#### 1.4.1 ISSUING OFFICER

The Issuing Officer or her designee is responsible for administrating/facilitating all requirements of the RFP solicitation process and is the **sole point of contact** for OFFEROR from date of public announcement of the RFP until the selection of the successful OFFEROR. The Issuing Officer will also serve as the Contract Manager responsible for contractual actions throughout the term of the contract. The Issuing Officer is:

Yvonne S. Taylor, Sr. Contracts Manager West Hawaii Region Email <u>ytaylor@hhsc.org</u> Direct (808) 322-4442 Fax (808) 322-4488

Or in Yvonne's absence:

Michelle Gray, Contracts Assistant II Email mgray@hhsc.org Direct (808) 322-5830

Figure 3. Issuing Officer

#### 1.5 HHSC ORGANIZATIONAL INFORMATION

#### 1.5.1 CHARTER

HHSC is a public body corporate and politic and an instrumentality and agency of the State of Hawaii. HHSC is administratively attached to the Department of Health, State of Hawaii and was created by the legislature with passage of Act 262, Session Laws of the State of Hawaii 1996. Act 262 affirms the State's commitment to provide quality health care for the people in the State of Hawaii, including those served by small rural facilities.

#### 1.5.2 STRUCTURE AND SERVICES

HHSC oversees the operation of nine public health facilities throughout the Hawaiian Island chain, including Oahu, Kauai and Hawaii. In addition to the nine HHSC facilities, Kahuku Medical Center, Hawaii Health Systems Foundation, and Alii Community Care are wholly owned subsidiaries.

HHSC is organized into five operational regions and provides a broad range of healthcare services including acute, long term, rural and ambulatory health care services. As the fourth largest public health system in the country, HHSC is the largest provider of healthcare in the Islands, other than on Oahu, and is the only acute care provider on the Islands of Maui and Lanai. In fiscal year 2009, HHSC had a total of 3,892 full time employees, operating 1,260 licensed beds, located on five different islands, with approximately 22,378 in-patient admissions.

HHSC West Hawaii Region has two hospitals: Kohala Hospital and Kona Community Hospital.

Kona Community Hospital is a 94-bed full-service acute care hospital with 24-hour emergency services, proudly serving the West Hawaii community. For nearly 100 years Kona Community Hospital has been caring for the people of West Hawaii. Adding more and more services, Kona Community Hospital has constantly improved our abilities to serve our residents and visitors whenever they are in need.

The Kona Community Hospital staff includes over 400 highly skilled employees and 100 medical staff practitioners, many who have been with our hospital for over 20 years. Along with our professional and experienced staff, Kona Community Hospital has many volunteers and affiliates that support our hospital. Kona Community Hospital also is one of the largest employers in West Hawaii.

#### **1.5.3 MISSION**

The mission of HHSC is to provide and enhance accessible, comprehensive health care services that are quality-driven, customer-focused and cost-effective.

#### 1.6 FACILITY INFORMATION

Detailed information pertaining to HHSC facilities is located at http://www.hhsc.org.

#### 1.7 SUBMISSION OF QUESTIONS

Relevant questions must be submitted in writing via electronic mail, facsimile or post mail to the Issuing Officer no later than the "Closing Date for Receipt of Questions", identified in Figure 1 in order to generate an official answer. All written questions will receive an official written response from HHSC and become addenda to the RFP.

#### - IMPORTANT -

OFFEROR may NOT request changes and/or propose alternate language to the attached HHSC Special Conditions and DAGS 1999 Interim General Conditions.

HHSC reserves the right to reject or deny any request(s) made by OFFEROR.

Responses by HHSC shall be due to the OFFEROR no later than the dates for initial questions and final questions stipulated in Figure 1.

Impromptu, un-written questions are permitted and verbal answers may be provided during preproposal conferences and other occasions, but are only intended as general direction and will not represent the official HHSC position. The only official position of HHSC is that which is stated in writing and issued in the RFP as addenda thereto.

No other means of communication, whether oral or written, shall be construed as a formal or official response/statement and may not be relied upon.

Send relevant questions to:

Yvonne S. Taylor, Sr. Contracts Manager
West Hawaii Region
Email <a href="mailto:ytaylor@hhsc.org">ytaylor@hhsc.org</a>
Direct (808) 322-4442
Fax (808) 322-4488
Or in Yvonne's absence:
Michelle Gray, Contracts Assistant II
Email <a href="mailto:mgray@hhsc.org">mgray@hhsc.org</a>
Direct (808) 322-5830

Figure 4. Contact for Relevant Questions

#### 1.8 RFP REVIEW

OFFEROR should carefully review this RFP for defects and questionable or objectionable matter. Comments concerning RFP's defects and questionable or objectionable matter, including requests to revise the General or Special Conditions, must be made in writing and should be received by the Issuing Officer, Yvonne Taylor, no later than the "Closing Date for Receipt of Questions" as identified in Figure 1. This will allow issuance of any necessary amendments to the RFP.

#### 1.9 RFP AMENDMENTS

HHSC reserves the right to amend the RFP any time prior to the ending date for the proposal evaluation period. RFP Amendments will be in the form of addenda and posted on the KCH Procurement website and well as electronically mailed to all bidders who have requested a RFP package.

#### 1.10 CANCELLATION OF RFP

The RFP may be canceled at any time for any reason when it is determined to be in the best interests of HHSC.

#### 1.11 GRIEVANCE

It is the policy of the West Hawaii Region to work cooperatively with all vendors to the end of fair and fiscally sound procurement decisions. In the event a vendor or prospective vendor feels that a procurement decision has been made or is about to be made that is not in accordance with applicable law or policies, the vendor is encouraged to proceed as follows:

Request a debriefing in writing by the Issuing Officer.

If the debriefing does not satisfy the vendor, a meeting may be requested with the Issuing Officer who may invite others to participate as needed.

If the Issuing Officer does not resolve the issue, the vendor may request a meeting with the RCEO. The RCEO is the last recourse for disputes relating to procurement decisions and all decisions made by the RCEO shall be final.

A grievance based upon the content of the RFP shall be submitted in writing within five (5) working days <u>after</u> the aggrieved individual/business knows or should have known of the facts; provided further that the grievance shall not be considered unless it is submitted in writing prior to and not later than the "Closing Date for Receipt of Questions" identified in Figure 1.

Such grievances of an award or proposed award shall be submitted within five (5) working days after the posting of award of the contract. The notice of award, if any, resulting from this solicitation shall be posted on the Kona Community Hospital website:

http://www.kch.hhsc.org/Procurement/

Figure 5. Website for all Procurement Activities

#### **SECTION 2 SCOPE OF SERVICES**

#### 2.0 SCOPE OF SERVICES

#### PROJECT PARAMETERS and SCOPE OF SERVICES

KCH has worked with a design firm to upgrade our current HVAC re-heat boiler system. We are currently using Rinnai water heaters that are not efficient for a closed loop operating system and does not give us adequate hot water flow, volume, or temperature for humidity control. The design upgrade includes new boilers, pumps, buffer tank, plumbing, direct digital controls, and balancing valve replacement.

A specification manual and engineered drawings are provided for this project in Appendices J and K.

All work must be performed in accordance with all applicable federal, state and local codes and laws. CONTRACTOR and its employees must possess all certificates and licenses required by law for all work that is being performed.

The Contractor represents that, prior to submitting a response to this Request for Proposal, they have carefully reviewed the enclosed documents and inspected the site of the proposed work. In addition, they are fully informed of the conditions under which the work is to be performed. The Contractor further represents that they have satisfied themselves to the actual conditions of the premises, existing construction, actual elevations site logistics, local code restrictions, and any other conditions affecting the completion of the intended work. It being hereby understood and agreed that no considerations will be allowed subsequently to the Contractor's submission of their response to the Request for Proposal by reason of error, or oversight, on the part of the Contractor or, on account of, interference by other Contractor's activities. The Contractor's Proposal shall include, as a minimum, the following Scope of Services. The following scope items are intended to clarify, but not limit, the Request for Proposal:

- Contractor shall manage, with his own personnel and qualified subcontractors, all construction work required for the construction, and refurbishment in accordance with the Contract Documents prepared by the Engineer. It is the intent of this Request for Proposal to contract with a General Contractor who will provide "above" industry standard construction services as referenced in this Request for Proposal.
- 2. Rubbish removal will be the Contractor's responsibility. Rubbish removal must be completed at the end of every construction day. It is imperative that the Contractor maintain a clean and efficient worksite. Contractor may utilize KCH's dumpsters (metal and non-metal) for the project's waste. Please notify Construction Supervisor if a dumpster is full. Dumpsters are located near the maintenance building so hauling waste from jobsite to dumpster is required.

- 3. Contractor shall visit the site to verify that he has familiarized himself with the jobsite regarding staging, site and building access, existing conditions, etc.
- 4. The Contractor shall maintain a detailed and accurate accounting system that shall be necessary for the proper financial management of the project. Contractor's records and receipts shall allow for ready identification of all charges included in subcontracts, purchase orders, change orders, invoices and Application for Payments. The Owner shall have the right to audit, at any time, all the Contractors records related to this project and the work. Waiver of lien documents shall be provided for all subcontractor/suppliers and tier subcontract/suppliers.
- 5. Contractor shall keep the Construction Supervisor advised and copied on all communications with the Engineer, Engineer's consultants, other consultants or vendors contracted by the Owner for this specific project.
- 6. Contractor shall communicate with the Construction Supervisor, Engineer and Engineer's consultants utilizing telephone, email, file storage/sharing for issue tracking, submittal tracking, cost tracking, requests for information, etc..
- 7. Contractor shall maintain a detailed and accurate shop drawing and product submittal control system for the project. The system shall be updated on a regular basis and reported to the Construction Supervisor, Engineer and other applicable consultants for coordination at all appropriate meetings. The schedule responsibility is that of the Contractor and negligence in coordinating the shop drawing process does not relieve Contractor from its contractual obligation for Substantial Completion.
- 8. The Contractor shall provide the following services as part of their proposed scope of services:

#### **Pre-Construction Phase**

- 1. Verify with Construction Supervisor the proper sequence of work.
- Work with engineer and/or building department for permitting issues. Engineering Contractor will apply for permit and permit, when issued, will be picked up by Contractor.
- 3. Commit sub-contractors.
- 4. Develop construction schedule and present to HHSC for approval.
- 5. Obtain required levels and types of insurance. Provide copies to the Contracts Department.
- 6. Preview OFCI equipment to ensure all items are on-site.

- 7. Each employee who will be onsite must read and sign the Contractor's Guidelines Handbook (attached as Appendix L). All requirements in the handbook must be completed two (2) weeks prior to start of work. Any employee who has not completed the requirement prior to start of project, will not be permitted to work until requirements are met.
- 8. Each employee who will be onsite must provide proof of a negative COVID-19 test prior to starting work. Test must be taken within 72 hours of starting work.

#### Construction Phase

#### 1. Construction

- a) Provide, coordinate and supervise all construction work for the project. Verify that materials furnished, and work performed meet all plans, specifications and applicable code and regulatory requirements.
- b) Regulate and control all subcontractors.
- c) Coordinate all subcontractors to ensure that the project schedule is met.
- d) Develop and implement a quality control system for all General Contractor activities.
- e) Coordinate and review for compliance all shop drawings and items submitted by subcontractors prior to submission to the Engineer. Establish and maintain on site a complete file of all shop drawings and items submitted.
- f) Coordinate with Construction Supervisor as necessary to provide coordination with trades, job schedules, storage, deliveries, etc. and ensure Owner's project completion dates are on schedule.
- g) Conduct weekly Owner Engineer Contractor ("OAC") meetings with the team members, prepare and distribute meeting minutes following each meeting.
- h) KCH standard working hours are Monday through Friday 7:00am through 3:30pm.
- i) While required by KCH, every employee on the job site must have temperature taken by the KCH COVID-19 screener prior to starting work <u>each day</u>. COVID-19 requirements are subject to change. Changes to procedures will be communicated to CONTRACTOR by Construction Supervisor.
- 2. Accounting and Cost Control Systems
- a) Prepare schedules of estimated values of all work awarded.

- b) Review all progress payments and make recommendations for approval to Construction Supervisor.
- c) Review all changes proposed by Owner and/or the Engineer and make recommendations regarding their practicality, cost and impact on the schedule.
- d) Receive and review all change order requests from subcontractors and prepare independent take-offs to evaluate each subcontractor requests.
- e) Construction Supervisor must review and approve each change order in writing.
- f) Hawaii law requires all State and County construction projects greater than \$2,000.00 to pay prevailing wages to laborers and mechanics on the project iobsite and file certified payrolls with the contracting agency (KCH). The CONTRACTOR is responsible for complying with all requirements and rules the State of Hawaii Wage Rate Schedule regarding (http://labor.hawaii.gov/rs/home/wages/72-2/). with the Not complying prevailing wage requirements will result in KCH immediately shutting down the jobsite until the CONTRACTOR is in full compliance.
- g) Weekly certified payroll reports certifying the hourly rate of wage of each worker for both CONTRACTOR and SUB-CONTRACTORS must be submitted to KCH in a timely and consistent manner. Submit reports to Michelle Gray, mgray@hhsc.org in the Contracts department.

#### **Post Construction**

- 1. Coordinate the punch list walk through, Prepare punch list(s) and ensure that all items are completed on a timely basis.
- 2. Assemble all booklets containing all guarantees and warranties, as required, and deliver all such documents to Owner with certificates that they are complete. Provide digital copies of all documents as required.
- 4. Coordinate and expedite the preparation of subcontractor care and maintenance manuals and deliver all such manuals to Owner with a certificate of completion.
- 5. Receive and verify all releases of claims required prior to issuance of final certificates of completion and payment to subcontractors.
- 6. Coordinate the preparation of as-built drawings of the entire project including engineering drawings and provide to HHSC.

Items listed in above in this section are not all-inclusive and it is expected that the CONTRACTOR know and perform all appropriate activities at the appropriate times during the renovation process.

Any questions or clarifications the CONTRACTOR may have shall be brought to the Construction Supervisor's attention in a timely manner so as to not delay the progress of the project.

Additional specifics regarding the Scope of Services may be discussed at the Pre-Bid meeting and documented in writing via Addendum to the RFP. **The Pre-Bid meeting is not mandatory for all OFFERORS however it is highly recommended.** No provisions for an additional site visit will be made.

#### **SECTION 3 PROPOSALS**

#### 3.0 INTRODUCTION

One of the objectives of the RFP is to make proposal preparation easy and efficient, while giving OFFEROR ample opportunity to highlight their proposal. When an OFFEROR submits a proposal, it shall be considered a complete plan for accomplishing the requirements described in this RFP.

#### 3.1 PROPOSAL PREPARATION

OFFEROR shall prepare a written proposal in accordance with requirements of this Section.

Proposals shall include all data and information requested to qualify proposals for evaluation and consideration for award. Non-compliance may be deemed sufficient cause for disqualification of a proposal. Examples of Non-Compliance are, but not limited to, no-bidding any section of RFP, quoting non-approved alternates or not submitting Sub Contractor information.

The development of overly elaborate proposals and presentation material, not required and/or related to RFP requirements, is <u>HIGHLY DISCOURAGED</u>. If OFFEROR will submit hard copy proposals, loose bound 3 ring binders or binder clips are preferred. Please let Contracts Manager know if you would like to have your binders returned after the RFP's closing.

#### 3.1.1 MANDATORY PROPOSAL TABS

The following tabs must be used in the OFFEROR's proposal:

|    | Mandatory Tabs                              |
|----|---|
| 1. | PROPOSAL TRANSMITTAL COVER LETTER           |
| 2. | TECHNICAL SECTION                           |
|    | SUMMARY                                     |
|    | MANDATORY QUESTIONS                         |
|    | PERSONNEL                                   |
| 3. | PRICE                                       |
|    | OFFER SUMMARY w/ OFFER DETAILS              |
|    | REQUIREMENTS (see section 3.9)              |
| 4. | REQUIRED DOCUMENTATION/COMPLIANCE DOCUMENTS |
|    | W-9   |
|    | VENDOR TERMS AND CONDITIONS (if any)        |
|    | CONFIDENTIALITY AGREEMENT (Exhibit H)       |
|    | GENERAL EXCISE LICENSE (copy)               |
|    | GENERAL CONTRACTOR LICENSE (copy)           |
|    | LETTER FROM SURETY COMMITTING TO PROVIDE    |
|    | PAYMENT AND PERFORMANCE BOND                |
| 5. | PROPOSAL SUBMISSION CHECKLIST               |

Figure 6. Mandatory Proposal Tabs

Relevant material should be placed in the appropriate tabbed area. Greyed in areas in the Mandatory Proposal Tabs (Figure 6) indicate category titles and separate sections. Inapplicable material or material placed in the incorrect tabbed area may not be evaluated.

#### 3.2 COSTS FOR PROPOSAL PREPARATION

Any and all costs incurred in the development of proposals, i.e. preparing and submitting, on-site product/service demonstrations, on-site visits, oral presentations, travel and lodging, etc. shall be the sole responsibility of OFFEROR.

#### 3.3 DISQUALIFICATION OF PROPOSALS

HHSC reserves the right to consider as acceptable only those proposals submitted in accordance with all requirements set forth in the RFP and which demonstrate an understanding of the Scope of Services. HHSC reserves the right to ask for clarification of any item in the proposal.

An OFFEROR will be disqualified and the proposal automatically rejected for any one or more of the following reasons:

Proof of collusion among OFFERORS, in which case all proposals involved in the collusive action will be rejected.

The OFFEROR'S lack of responsibility and cooperation as shown by past work or services.

The proposal shows any noncompliance with applicable law.

The proposal is conditional, incomplete, or irregular in such a way as to make the proposal incomplete, indefinite, or ambiguous as to its meaning.

The proposal has any provision reserving the right to accept or reject award, or to enter into a contract pursuant to an award, or provisions contrary to those required in the solicitation.

Proof of exclusion from participation in federal health care programs, as defined in the Social Security Act (Section 1128 and 1128A), and other federal laws and regulations relating to health care.

#### 3.4 SUBMISSION OF PROPOSALS

Each OFFEROR may submit only one (1) proposal (response). Alternate proposals will not be accepted. The Issuing Officer must receive one (1) original, three (3) copies OR one (1) copy in electronic format (*electronic is preferred*) of the proposal no later than the "Closing Date for Receipt of Proposals", identified in Figure 1. **Proposals received after this time/date may be rejected.** The original shall be clearly marked "ORIGINAL" and copies shall be clearly marked "COPY". All items submitted must be clearly labeled, marked or titled with the following information at a minimum:

RFP # HHSC 21-0044

Hospital Reheat Hot Water System Upgrade Your\_Company\_Name

Figure 7. Mandatory Proposal Item Identification

Mail or deliver proposals to the following address:

Yvonne S. Taylor, Sr. Contracts Manager West Hawaii Region Hawaii Health Systems Corporation 79-1019 Haukapila Street Kealakekua, HI 96750

Figure 8. Address for Proposal Submittals

Proposals transmitted via email shall have the following information in the subject line:

RFP #HHSC 21-0044 Hospital Reheat Hot Water System Upgrade

The outside cover of the package containing the proposal should be marked, as follows:

Proposal Submitted in Response to RFP # HHSC 21-0044 Hospital Reheat Hot Water System Upgrade

Figure 9. Mandatory Proposal Package Marking

#### 3.5 PROPOSAL TRANSMITTAL COVER LETTER

OFFEROR is required to submit proposal with a transmittal cover letter. The transmittal cover letter must be on the OFFEROR'S official business letterhead; signed by an individual authorized to legally bind the OFFEROR and minimally include information, as written/requested, on the "sample" letter in APPENDIX A.

#### 3.6 PUBLIC INSPECTION

Proposals shall not be opened publicly, but shall be opened in the presence of two or more procurement officials. The register of proposals and OFFERORS' proposals shall be open to public inspection after the contract is executed by all parties, subject to the nondisclosure provisions of HRS Chapter 92F.

OFFEROR shall request in writing the nondisclosure of designated trade secrets or other proprietary data to be confidential. Such data shall accompany the proposal and shall be readily separable from the proposal in order to facilitate eventual public inspection of the non-confidential portion of the proposal. The proposals are subject to disclosure rules set forth in Chapter 92F, H.R.S. The OFFEROR bears the burden of establishing that the designated data is exempted from the disclosure requirements set forth in Chapter 92F.

All proposals and other material submitted by OFFEROR become the property of HHSC and may be returned only at HHSC's option.

#### 3.7 TECHNICAL SECTION

Any proposal offering a significantly non-compliant Technical Section may be disqualified without further notice.

The Technical Section is comprised of all contractor, sub-contractor and project details (Exhibit E will be completed by OFFEROR) with the exception of pricing and should include the following categories:

#### **3.7.1 SUMMARY**

Clearly, concisely and briefly summarize and highlight the contents of the technical proposal in such a way to provide HHSC with a broad understanding and the unique, most promising aspects of the proposal. Summary should not exceed 1 page in length.

#### **3.7.2** THIS SECTION IS DELETED.

#### 3.7.3 MANDATORY QUESTIONS

See Exhibit E (Mandatory Questions) and insert the questions and answers in this section.

#### 3.7.4 PERSONNEL

See Exhibit I (Subcontractors Table) and insert the completed form in this section.

#### 3.8 PRICE PROPOSAL

Provide price summary and details.

#### 3.8.1 PRICE

Price shall be a fixed fee for all work described in drawing package dated August 2020 and specification manual dated August 2020.

Any State of Hawaii funded projects over \$50,000.00 are required to have contract performance and payment bonds, the costs of which will be included in the final contract amount.

#### 3.9 REQUIREMENTS

- A. **Non Applicable Requirements.** Excluding HHSC General and Special Terms and Conditions, and any objectionable or defective RFP matters, if any proposal requirement, as describe in this Section, is not applicable to the OFFEROR and therefore will/cannot be provided, list what the requirement(s) are and why the requirement(s) are not applicable.
- B. Non Acceptance of any RFP Requirement. If any RFP requirement, as described in this RFP, is not acceptable to the OFFEROR, list what the requirement(s) are and why the requirement(s) are not acceptable. Should you have an alternate solution submit it.
- C. **HHSC Furnished Items.** If the OFFEROR's proposal requires any goods, services, equipment, third-party vendor support, or anything of value to be provided by HHSC, these items must be clearly detailed and stated in the OFFEROR's proposal.
  - HHSC reserves the right to consider as acceptable only those proposals submitted in accordance with all requirements set forth in the RFP.


#### 3.10 REQUIRED DOCUMENTATION/COMPLIANCE DOCUMENTS

In addition to the requirements outlined in this RFP, OFFEROR must submit the following documentation with response:

- A. W9
- B. VENDOR TERM'S AND CONDITIONS (IF ANY)
- C. CONFIDENTIALITY AGREEMENT (EXHIBIT H)
- D. GENERAL EXCISE LICENSE (COPY)
- E. GENERAL CONTRACTOR'S LICENSE (COPY)
- F. LETTER FROM SURETY COMMITTING TO PROVIDE PERFORMANCE & PAYMENT BONDS

#### 3.11 PROPOSAL SUBMISSION CHECKLIST

The proposal submission checklist is provided by HHSC and is designed to be used as a tool to ensure that all required documents and information are being submitted with OFFEROR's proposal. HHSC recommends the OFFEROR go through the checklist before submitting the response. The proposal submission checklist is in Appendix B

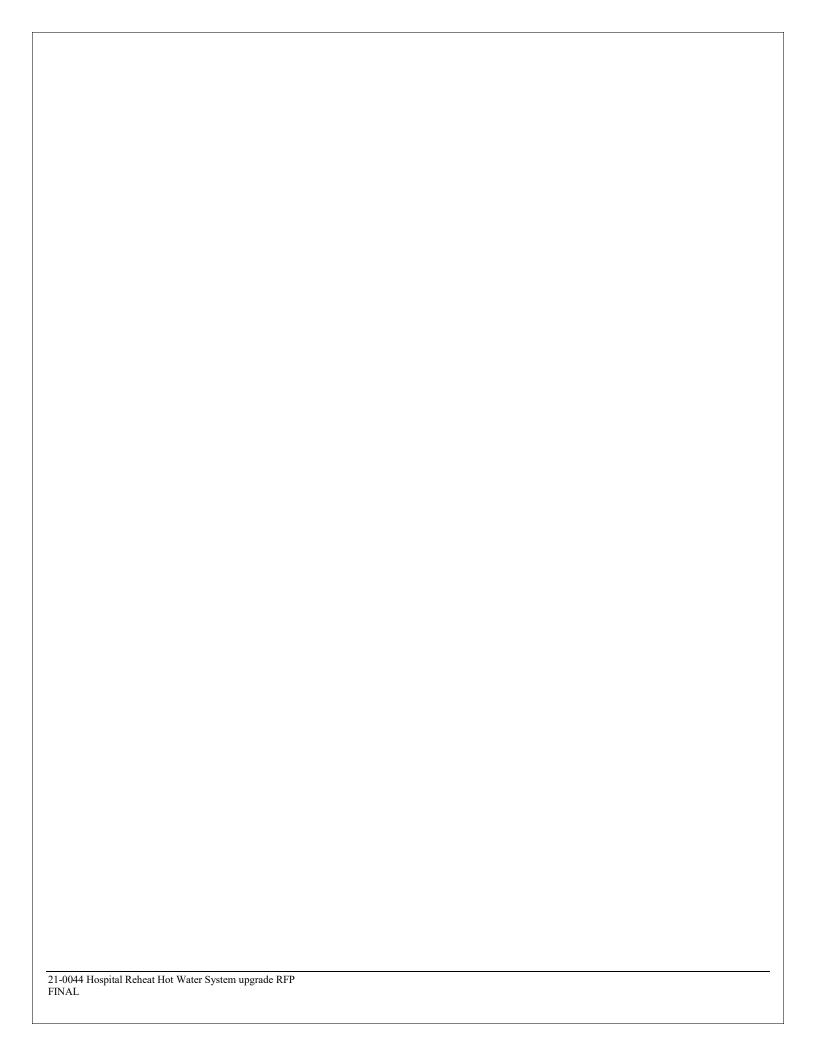

#### **SECTION 4 EVALUATIONS**

#### 4.0 INTRODUCTION

The evaluation of proposals shall be conducted comprehensively, fairly, and impartially. Structural, quantitative scoring techniques will be utilized to maximize the objectivity of the evaluation.

#### 4.1 PROPOSAL EVALUATION COMMITTEE

An evaluation committee will be selected from HHSC to perform all evaluation requirements. The committee will be composed of individuals with experience in, knowledge of, and program responsibility for the requirements identified in the RFP. HHSC reserves the right to request information from OFFEROR to clarify the OFFEROR's proposal.

#### 4.2 EVALUATION PHASES

Evaluation phases will be conducted as follows:

| Phase   | Phase Description                                  |
|---------|--|
| Phase 1 | Evaluation of Mandatory Requirements               |
| Phase 2 | Technical Section Evaluation                       |
| Phase 3 | Determination of Short List of Offerors (optional) |
| Phase 4 | Proposal Discussions by Short-List (optional)      |
| Phase 5 | Best and Final Offers by Short List (optional)     |
| Phase 6 | Recommendation for Contract Award                  |

Figure 10. Proposal Evaluation Phases

#### 4.2.1 PHASE 1 EVALUATION OF MANDATORY REQUIREMENTS

The evaluation of the mandatory requirements, as listed below, shall be based upon a "Pass/ No Pass" basis. The purpose of this phase is to determine whether an OFFEROR's proposal is sufficiently responsible and responsive to RFP requirements to permit a complete evaluation, i.e. responsible in terms of "Does the OFFEROR have the capability to perform fully the Scope of Services requirements"; and, "Were proposal documents received by HHSC and do they contain the required information?" Failure to meet any mandatory requirement will be grounds for deeming the proposal non-responsible, non-responsive or both and disqualification ("No Pass") thereof.

#### 4.2.2 PHASE 2 TECHNICAL SECTION EVALUATION

Evaluation of OFFEROR'S technical section shall be conducted using the technical section categories and the value weight percentages identified in Paragraph 4.3 and the evaluation scoring system identified in Paragraph 4.4.

#### 4.2.3 PHASE 3 DETERMINATION OF SHORT-LISTED OFFERORS (OPTIONAL)

At its discretion, following Phase 1 and 2, HHSC may develop a Short List of OFFERORs based on the evaluation of OFFERORS' Technical section.

# 4.2.4 PHASE 4 PROPOSAL DISCUSSIONS WITH SHORT-LISTED OFFERORS (OPTIONAL)

The OFFERORS on the Short List of OFFERORs may be asked to conduct discussions with HHSC. OFFEROR's proposal may be accepted without discussions. In the event that HHSC elects to hold discussions, HHSC shall inform Short-Listed OFFERORS of specific discussion topics and issues; and schedule the discussion.

#### 4.2.5 PHASE 5 BEST AND FINAL OFFERS (OPTIONAL)

OFFEROR(s) may be requested to submit a Best and Final offer. Best and Final offers shall be evaluated and scoring of the OFFEROR's proposal adjusted, accordingly. If a Best and Final offer is requested but not submitted, the original submittal shall be accepted as the Best and Final offer

#### 4.2.6 PHASE 6 RECOMMENDATION FOR CONTRACT AWARD

The Evaluation Committee shall prepare a report summarizing proposal evaluation findings/rankings and provide recommendation for award of contract to the RCEO.

#### 4.3 EVALUATION CATEGORIES AND VALUE WEIGHT PERCENTAGES

The following Evaluation Categories and Value Weight Percentages shall be used:

| Value Weight Percentages | Points | Evaluation Category  |  |
|--------------------------|--------|--|--|
| Pass/No Pass             | N/A    | MANDATORY REQUIREMENTS. Category includes:                 |  |
|                          |        | PROPOSAL TRANSMITTAL COVER LETTER                          |  |
|                          |        | REQUIRED DOCUMENTATION/COMPLIANCE DOCUMENTS PROVIDED       |  |
|                          |        | REQUIRED QTY OF ORIGINAL AND COPIES                        |  |
| 50%                      | 50     | TECHNICAL APPROACH. Category includes:                     |  |
|                          |        | SUMMARY  |  |
|                          |        | MANDATORY QUESTIONS  |  |
| 40%                      | 40     | PRICE. Category includes:                                  |  |
|                          |        | SUMMARY AND DETAILS  |  |
| 10%                      | 10     | COMPLIANCE WITH REQUIREMENTS. Category includes:           |  |
|                          |        | NON APPLICABLE PROPOSAL REQUIREMENT                        |  |
|                          |        | NON ACCEPTANCE OF ANY RFP REQUIREMENT                      |  |
|                          |        | HHSC FURNISHED ITEMS                                       |  |
|                          |        | PROPOSAL WAS COMPLETED IN ACCORDANCE WITH RFP REQUIREMENTS |  |

Figure 11. Evaluation Categories and Value Weight Percentages

#### 4.4 EVALUATION SCORING SYSTEM

The maximum number of points available for scoring is one hundred (100) per evaluator. The proposal receiving the highest cumulative number of points is considered statistically the best proposal to HHSC; and will be recommended for award of contract, unless otherwise determined and justified by the evaluation committee.

Each Evaluation Committee Member shall review OFFEROR proposals that pass Phase 1 Evaluation of Mandatory Requirements. The Evaluation Committee Members shall determine the score for each Evaluation Category for each OFFEROR in accordance with Figure 11. The OFFEROR'S total score will be the sum of all scores by all evaluators.

#### **SECTION 5 AWARD OF CONTRACT**

#### 5.0 AWARD OF CONTRACT

Award of contract shall be made to the most responsible and responsive OFFEROR whose proposal is determined by the Evaluation Committee to provide the <u>best value</u> to HHSC, considering all evaluation reviews and results.

#### 5.1 CONTRACT AWARD NOTIFICATION

The notice of award, if any, resulting from this solicitation shall be posted on the Kona Community Hospital website: <a href="http://www.kch.hhsc.org/Procurement/">http://www.kch.hhsc.org/Procurement/</a>. This will serve as the official notification to all OFFERORS. In addition, the Issuing Officer will inform the successful OFFEROR of contract award selection by an official "notice of award" letter.

At its discretion and as a courtesy to the OFFEROR the Issuing Officer may issue a "Notice of Posting of Award" to the unsuccessful OFFERORS. However a delay in issuing the notice or the inadvertent omission of such courtesy notice will not extend the grievance filing time.

#### 5.2 CONTRACT AWARD DEBRIEFING

If requested by unsuccessful OFFEROR, HHSC shall provide a contract award debriefing. The purpose of a debriefing is to inform the non-selected OFFEROR of the basis for the source selection decision and contract award. A written request to the Issuing Officer for a debriefing shall be made within three (3) working days after receipt of non-award letter from HHSC and/or posting of the award of the contract.

#### **5.2.1 CONTRACT DOCUMENT**

The contract will be awarded by executing an <u>"Agreement for Goods or Services Based Upon Competitive Sealed Proposals"</u> (hereinafter "CONTRACT") by HHSC and the successful OFFEROR (hereinafter "CONTRACTOR"). This document will serve as the official, legal contractual instrument between both parties. This document will incorporate (by attachments or reference) the RFP, with any and all addendums; GENERAL CONDITIONS and any SPECIAL CONDITIONS; and the CONTRACTOR's accepted proposal, with any and all addendums, changes, negotiated agreements, all of which becomes part and whole of the CONTRACT.

A "sample" CONTRACT is located as Appendix C. **DO NOT complete or execute the "sample" CONTRACT.** 

#### 5.2.2 GENERAL EXCISE/USE TAX

Work to be performed under this solicitation is a business activity taxable under Chapter 237, Hawaii Revised Statutes (HRS), and Chapter 238, HRS, where applicable. Both out-of-state and Hawaii CONTRACTOR are advised that the gross receipts derived from this solicitation are subject to the general excise tax imposed by Chapter 237, HRS, and where applicable to tangible property imported into the State of Hawaii for resale, subject to the use tax imposed by Chapter 28, HRS.

Pursuant to Section 237-9, HRS, the CONTRACTOR is required to obtain and/or possess a valid General Excise Tax License from the Hawaii State Department of Taxation (DOTAX) prior to executing a contractual agreement with a State Agency (Reference the GENERAL CONDITIONS - NON-PHYSICIAN HEALTHCARE SERVICES, APPENDIX D).

The General Excise Tax License shall be obtained from the DOTAX offices in the State of Hawaii or the DOTAX Web Site and by mail or FAX.

#### 5.3 CONTRACT EXECUTION

Upon receipt of the CONTRACT document, the CONTRACTOR shall have five (5) business days to execute and return the CONTRACT to the Issuing Officer. A copy of the fully executed CONTRACT will be provided the CONTRACTOR within five (5) business days of CONTRACT execution.

Award of CONTRACT may be withdrawn if the CONTRACTOR is unable to meet CONTRACT execution requirements.

#### 5.4 CONTRACT COMMENCEMENT DATE

No work is to be undertaken by the CONTRACTOR prior to the commencement date specified in the <u>Fully Executed</u> Contract. HHSC is not liable for any work, contract, costs, expenses, loss of profits, or any damages whatsoever incurred by the CONTRACTOR prior to the official, notice to proceed "Commencement" date stated in the <u>Fully Executed</u> Contract.

#### APPENDIX A

#### SAMPLE PROPOSAL TRANSMITTAL COVER LETTER

Dear Mr. Lee:

(Name of Business) proposes to provide any and all goods and services as set forth in the "Request for Proposals for Competitive Sealed Proposals" to provide "Kona Community Hospital – hospital re-heat hot water system upgrade, RFP # HHSC 21-0044, for which fees/costs have been set. The fees/costs offered herein shall apply for (Please insert applicable period of time).

It is understood and agreed that <u>(Name of Business)</u> have read HHSC's Scope of Services described in the RFP and that this proposal is made in accordance with the provisions of such Scope of Services. By signing this proposal, <u>(Name of Business)</u> guarantees and certifies that all items included in this proposal meet or exceed any and all such Scope of Services.

| (Name of Business) agrees, if awarded             | d the contract, to provide the goods | and services set forth in the    |
|---|--------------------------------------|----------------------------------|
| RFP; and comply with all terms and con-           | ditions indicated in the RFP; and at | the fees/costs set forth in this |
| proposal. The following individual(s) ma          | y be contacted regarding this propos | sal:                             |
|   | -                                    |                                  |
|   | -                                    |                                  |
| Other information:                                |                                      |                                  |
| Business Phone<br>#:                              | Federal Tax ID #:                    |                                  |
| Facsimile #:                                      | Hawaii GET Lic. ID<br>#:             |                                  |
| E-mail address:                                   |                                      |                                  |
| (Name of Business) is a: Sole P                   | roprietor Partnership Corp           | poration  Joint Venture          |
| Other (Specify)                                   |                                      |                                  |
| State of Incorporation is: (Specify)              |                                      |                                  |
| The exact legal name of the business ι match W9): | under which the contract, if awarded | d, shall be executed is (must    |
|   |                                      |                                  |
| (Authorized Bidder's Signature, Printed N         | Name/Title)                          |                                  |

#### APPENDIX B

#### PROPOSAL SUBMISSION CHECKLIST

\*IF SPECIFIC ITEM(S) IS NOT APPLICABLE, MARK WITH "N/A"---DO NOT LEAVE BLANK.

| Please<br>Check Off<br>OFFEROR<br>Submitted | HHSC Use | Proposal Items  |
|---|----------|---|
|   |          | Proposal Received "On-Time"   |
|   |          | One (1) Original & Three (3)Copies of Proposals or one (1) e-mail                         |
|   |          | Proposal Transmittal Cover Letter:  |
|   |          | i. Official Business Letterhead   |
|   |          | ii. Authorized Signature  |
|   |          | iii. Required Information   |
|   |          | Technical Proposal  |
|   |          | i. Summary  |
|   |          | ii. Mandatory Questions   |
|   |          | Price   |
|   |          | <ul><li>i. Summary and Offer</li><li>ii. Non Applicable Proposal Requirement(s)</li></ul> |
|   |          | iii. Non Acceptance of any RFP Requirement(s)   |
|   |          | iv. HHSC Furnished Items  |
|   |          | Required Documentation/Compliance Documents   |
|   |          | i. W-9  |
|   |          | ii. Vendor's terms and conditions (if applicable)   |
|   |          | iii. Confidentiality Agreement  |
|   |          | iv. General Excise License (copy)   |
|   |          | v. General Contractor's License (copy)  |
|   |          | vi. Surety Company's letter of commitment   |
|   |          | Proposal Submission Checklist   |



#### APPENDIX C

#### **SAMPLE**

# HAWAII HEALTH SYSTEMS CORPORATION AGREEMENT FOR GOODS OR SERVIC'S BASED UPON COMPETITIVE SEALED PROPOS LS

AGREEMENT #: SAMPLE SAMPLE

THIS AGREEMENT, executed on the respense test the signer respenses of the parties shown hereafter, is effective as of xxx, bet sen Kon; sommu **Hospital**, a division of Hawaii Health Systems Corporation reing of "HHSC"), by its Regional Chief Executive Officer, (hereinafter "CEL whose Idress is 79-1019 Haukapila Street, ONTA TOR NAME | (hereinafter Kealakekua. HI 96750. and "CONTRACTOR"), a sole rietor, L der laws of the State of Hawaii, whose COIL TAC OR business address is [ ADDRESS 1 and FEIN No [ CONTRACTOP FEIN

### RECITALS

- A. The HHSC is in not d of the goods or services, or both, described in this Agreement and least contents.
- **B.** The reviewed proposals submitted in response to the request.
- **C.** The CONTRACTOR has been identified as the responsible and responsive OFFEROR whose proposal is the most advantageous for the HHSC, taking into consideration price and the evaluation factors set forth in the request.



- **D.** The HHSC desires to retain and engage the CONTRACTOR to provide the goods or services, or both, as the case may be, and the CONTRACTOR is agreeable to providing said goods or services, or both.
- **NOW, THEREFORE,** in consideration of the promises contained in this Agreement, the HHSC and the CONTRACTOR agree as follows:
- 1. <u>SCOPE OF SERVICES.</u> The CONTRACTOR shall, in a oper a satisfactory manner as determined by the HHSC, provide all the goods set fort. Attact sent 1 Scope of Services.
- 2. <u>TIME OF PERFORMANCE</u>. The performance required of the CONTRACTOR under this Agreement shall be executed in accordant with the time period set forth in the **Attachment 2 Time of Performa** which made a part of this Agreement.
- 2. COMPENSATION. The CONT AC. R shall be compensated for services performed under this Agreem. The CONT AC. R shall be compensated for services performed under this Agreem. The CONT AC. R shall be compensated for services performed under this Agreement as set forth in Attachment 3. Compensation, with its hereby in the provisions as set forth in Attachment 3.
- 5. OF CONDUCT DECLARATION. The Standards of Conduct Declaration of the ONTRACTOR is attached and is made a part of this Agreement.
- 6. OTHER TERMS AND CONDITIONS. The General Conditions and any Special Conditions are attached hereto and made a part of this Agreement (or, Any Special Conditions are attached hereto and made a part of this Agreement). In the event of a conflict between the General Conditions and the Special Conditions, the Special



Conditions shall control. In the event of a conflict among the documents, the order of precedence shall be as follows: (1) Agreement, including all attachments and addenda; (2) Request, including all attachments and addenda; and (3) Proposal.

- LIQUIDATED DAMAGES. Liquidated damages are applicable See attachment
   3.
- **TECHNICAL REPRESENTATIVE.** The Technical Representation of same on invoices. The Technical Representative is serves as the point of contract for the CONTRACTOR for "Technical Representative" is:

Mr. Roy Gille Director of Facties

Kona Community Pointal

79-1019 Haukan Stre

Kealakekua, HI 9u 70

Tele 10 808-322-4 5 Email: rgillespie@hhsc.org

9. NOTICES. As writte the required to be given by any party to this Agreement shall be (a) delivered a resonally, or (b) sent by United States first class mail, postage prep 1. Notice irecase be given to the CEO shall be sent to: Kona Community Hospital, 79-1019 Haukapila Street, Kealakekua, HI 96750. Notice to the CONTRACTOR shall be sent to the CONTRACTOR'S address as indicated in this Agreement. A notice shall be deemed to have been received three (3) days after mailing or at the time or actual receipt, whichever is earlier. The CONTRACTOR is responsible for notifying the HHSC in writing of any change of address.



#### IN VIEW OF THE ABOVE, the parties execute this Agreement by their signatures,

on the dates below, to be effective as of the date first above written.

| HI  | HSC          |                            |
|-----|--------------|----------------------------|
| SI  | IGNATURE:    |                            |
| PI  | RINTED NAME: | James Y. L                 |
|     |              | Regional CEO, 'Vest ıawaii |
| TI  | TLE:         | gion                       |
| D   | ATE:         |                            |
|     |              |                            |
| Co  | о чсто.      | [CONTRACTOR NAME]          |
| SI  | GNA UK.      |                            |
|     | 'TED IAME:   |                            |
|     |              |                            |
| The | -            |                            |
|     | 7E: _        |                            |



#### STANDARDS OF CONDUCT DECLARATION

For the purposes of this declaration:

"Controlling interest" means an interest in a business or other undertaking which is sufficient in fact to control, whether the interest is greater or less than fifty percent (50%).

"Employee" means any nominated, appointed, or elected officer or employee of the State or ASC, including members of boards, commissions, and committees, and employees under contract to the State or of the constitutional convention, but excluding legislators, delegates to the constitutional convention, justing, and judges.

On behalf of **CONTRACTOR NAME**, CONTRACTOR, the undersigned res dreare, under penalty of perjury, as follows:

- 1. CONTRACTOR IS or IS NOT a legislator or an employee or a business in which a risla or an employee has a controlling interest.\*
- 2. CONTRACTOR has not been assisted or represented by a local lator of poloyee for a per or other compensation to obtain this Agreement and will not be assisted or represented a leg tor or ployee for a fee or other compensation in the performance of the Agreement, if the local lator or exployee is the involved in the development or award of the Agreement.
- 3. CONTRACTOR has not been assisted or regression to the compensation in the award of this Agreement by a State or HHSC employee or, in the case of the egislature, by a legislator.
- 4. CONTRACTOR has not been represented or as sisted ersonal on matters related to the Agreement by a person who has been an employee of the State or HHSC which in the preceding two (2) years and who participated while in state office or employment on the matter of which the Agreement is directly concerned.
- 5. CONTRACTOR has not been reprecated or a six of on matters related to this Agreement, for a fee or other consideration by an individual who, within the ast twelve 2) months, has been a State or HHSC employee, or in the case of the Legislature, a legislature, a legislature.
- 6. CONTRACTOR has no been remarked or assisted in the award of this Agreement for a fee or other consideration by an individual no, 1 within a past twelve (12) months, served as a State or HHSC employee or in the case of the Lorislature, a legislature, and b) participated while an employee or legislator on matters related to this Agreement.

CONTRAC OR under that the Agreement to which this document is attached is voidable on behalf of the State or HHSC is vis Assemble to a serie end into in violation of any provision of chapter 84, Hawaii Revised Statutes, commonly received to as the Code of Ethics, including the provisions which are the source of the declarations above. Additionally, any fee, compensation, gift, or profit received by any person as a result of a violation of the Code of Ethics may be recovered by the Code or HHSC.

| CONTRACTOR  |  |
|-------------|--|
| SIGNATURE:  |  |
| Print Name: |  |
| Title:      |  |
| Date:       |  |







## **ATTACHMENT 1**

# **PROJECT PARAMETERS and SCOPE OF SERVICES**

Final Scope of Services will be included in the contract.





# **ATTACHMENT 2**

## TIME OF PERFORMANCE

1. The CONTRACTOR shall provide the services required under this Agreement for a period from **XX** to and including **XX**, unless sooner terminated or extended as proded.

#### -OPTIONAL-

2. OPTION TO EXTEND: The TIME OF PERFORMAL F of this Agreement may be extended for XX () additional XX () month in value ubject muture written agreement between HHSC and the CONTRACTOR, or to the d of the curent contract period. A Supplemental Agreement will be excited by CONTRACTOR and HHSC to exercise extensions.



# **ATTACHMENT 3**

#### COMPENSATION AND PAYMENT SCHEDULE

In full consideration for the services to be performed by the CONTRACTOR under this Agreement, the HHSC agrees, subject to appropriation and allotments, to pay to the CONTRACTOR a total sum of money not to exceed **XXX AND NO/100 DOLLARS (\$XXX.00)** including all applicable taxes and expenses incurred, and in accordance with the following:

- A. <u>Total Contract Award</u>. This Total Sum shall include any an all taxes apping and handling and other miscellaneous costs to complete the work a uire in the Scope of Services.
- B. <u>Invoicing Schedule</u>. Contractor shall invoice Hos it all in accordance following:
  - 1. This is a Fixed Price Agreement.
  - 2. The contractor is paid according to \* milestor table be

| Milestone | Milestone<br>Pymt<br>Amount | Description   | Mile Acc 'ance Criteria  | Schedule                                   | Subject to<br>Liquidated<br>Damages (Clause<br>9 of General<br>Conditions)     |
|-----------|-----------------------------|---|--|--|--|
| 1         | 25%                         | Materials<br>Procurement                              | ried Co. 'd'  - 'rly comple and submitted invo   | Upon Contract<br>Award                     | No   |
| 2         | 25%                         | 50% ompletic.   | Written, roval from Director of Facilities  Properly completed and submitted invoice.                    | TBD  | No   |
|           | 5%                          | bstadal<br>mpletion                                   | Written approval from Director of Facilities  Properly completed and submitted invoice.                  | TBD  | No   |
| 4         |                             | Punch list<br>completion<br>and project<br>acceptance | Acceptance by Kona Community Hospital, Director of Facilities  Properly completed and submitted invoice. | Upon project completion and KCH acceptance | Yes (\$250.00 per<br>calendar day over<br>the agreed upon<br>completion date.) |



- Travel costs are not allowable.
- 4. If the not-to-exceed value is insufficient to complete all phases of the Project, Hospital may, at their sole discretion, issue a separate agreement in accordance with their procurement policies for the remainder of the work or complete the work with Hospital personnel.
- 5. HHSC will work with the CONTRACTOR to determine a reason die construction schedule, milestone schedule and completion date.

#### C. Payment Guidelines

- 6. Company shall provide W-9 and Certificate of Insurance upon intract Av. d.
- 7. The Contract Number (XX-XXXX) and Payment Milestone up er must appear on every Invoice.
- 8. The "Invoice To" must be "Kona Community spital
- 9. The "Remit To" name on your invoice stated in ontract.
- 10. If the "Remit To" address on the invoice of crent from the address stated on the face of the Contract, we must be the "Invoice of the Contract."
- 11. Invoice shall be transmitted (ele ro. ally is ferred) to:

\*\* If your only does not contain your contract number, it may be rejected and payment delayed. \*\*\*\*



#### APPENDIX D

#### 1999 DAGS INTERIM GENERAL CONDITIONS

The Interim General Conditions may be obtained from the Division of Public Works, Department of Accounting and General Services, State of Hawaii at the following website:

### http://pwd.hawaii.gov/wp-content/uploads/2014/12/InterimGeneralConditions1999Edition.pdf

The Interim General Conditions and Special Conditions will be fully incorporated into the successful OFFEROR's Agreement.

- 1. The General Conditions are hereby amended as follows:
- a. The following terms specified in Section 1 are hereby defined:
- i) Bidder shall have the same definition as Contractor.
- ii) Comptroller shall be the Chief Financial Officer at Leahi Hospital or his authorized representative.
- iii) Department shall be HHSC or its designee.
- iv) Engineer shall be the person so designated by Leahi Hospital
- v) State shall be HHSC or its designee.
- b. Section 1.20 and 1.25 replace "State of Hawaii" with "State".
- c. The last two sentences of the third paragraph of Section 2.1.1.2, in the Interim General Conditions is deleted and is replaced with the following:
- " If the notice is faxed, the time of receipt by the CEO's fax machine shall be official. The submittal of intention to bid via fax is acceptable only to this office."
- d. Section 2.1.2.1: second sentence is hereby deleted in its entirety.
- e. The addresses specified in Section 2.6.1 of the Interim General Conditions shall be changed to HHSC West Hawaii Region, 79-1019 Haukapila Street, Kealakekua, HI 96750.
- f. Sections 2.10 through 2.11 are hereby deleted in their entirety.
- g. Paragraph 3.8.1 of the Interim General Conditions is amended to read as follows:
- "The contract shall be signed and forwarded to Hawaii Health System Corporation, by the successful bidder all within three (3) days of receipt of the contract. The performance



and payment bonds shall be received by Hawaii Health Systems Corporation within ten (10) calendar days after the bidders is awarded the contract. No proposal or contract shall be considered binding upon the State until the contract has been fully and properly executed by all parties thereto."

- h. In paragraph 3.9.2 of the Interim General Conditions, "ten (10) calendar days after such award or within such further time as the Comptroller may allow" shall be replaced with, "the time allowed in the previous section."
- i. Section 4.1: the words "accepted bid" is deleted from the first sentence.
- j. Section 4.9.3: the words "submission of bids" is replaced with the words execution of this contract".
- k. Section 5.5: the last sentence is hereby deleted in its entirety and replaced with the following:

"In the event of conflict among the Contract Documents, the order of precedence is listed in paragraph 5 of this contract and is further detailed in the following subparagraphs:"

- I. Sections 5.5.1 and 5.5.2 are hereby deleted in their entirety.
- m. Section 5.8.1: "twenty-four (24)" is hereby changed to "three (3)".
- n. Section 5.11 is hereby deleted in its entirety.
- o. Section 5.12.4 is hereby deleted in its entirety.
- p. Section 7.3.7.4, subparagraphs a and b: Replace "If the project falls within the State University System, The University of Hawaii" with "HHSC".
- q. Section 7.4.1 is hereby deleted in its entirety and replaced with the following:

"The Contractor shall prepare, process, obtain, and pay for all permits necessary for the proper execution of the work."

- r. Section 7.7.2 is amended to read as follows: "The wage rate schedule is attached to this contract."
- s. Sections 7.14.2, 7.19.2, and 7.19.4: delete "Departments and Agencies and their" and insert "directors" between "officers" and "representatives".
- t. Section 7.14.4 is hereby added and reads as follows:

"Contractor warrants that it and none of its employees, agents or subcontractors performing



services or providing goods pursuant to this Agreement are excluded from participation in federal health care programs, as defined in the Social Security Act (section 1128 and 1128A), and other federal laws and regulations relating to health care. HHSC reserves the right to verify that the above warranty is true and to immediately cancel this Agreement in the event it is violated."

- u. Section 7.15 delete "and its Departments and Agencies".
- v. Section 7.21.8.6 Delete the word "bad" before the words "weather day conditions."
- w. Section 7.35.1: the last word "earlier" is changed to "later".
- 2. CORPORATE COMPLIANCE PROGRAM. A description of the Corporate Compliance Program of HHSC is posted on the HHSC Internet (www.hhsc.org). The CONTRACTOR, by signing this contract, acknowledges that it has read said description. and that the CONTRACTOR knows of the fact and substance of the Corporate Compliance Program, which governs operations at all facilities of the HHSC. The CONTRACTOR understands and agrees that employees, agents, and contractors performing any services at any of the HHSC facilities shall be fully subject to such Corporate Compliance Program, as may be amended from time to time, as well as all federal program requirements and applicable policies and procedures of HHSC and its facilities. The Corporate Compliance Program requires periodic training, including an orientation program, of all people who provide financial, business office, personnel, coding, medical records information systems and clinical services in the facility. The CONTRACTOR agrees to cause its employees, agents, and contractors who provide any services at any financial, business office, personnel, coding, medical records information systems and clinical services at any of the HHSC facilities to participate in the orientation and training programs.
- 3. CONFIDENTIAL INFORMATION. It is acknowledged and agreed that all of the trade secrets, business plans, marketing plans, know how, data, contracts, documents, scientific and medical concepts, billing records, personnel records, medical records of any kind, and referral resources for existing or future services, products, operations, management, business, pricing, financial status, valuations, business plans, goals, strategies, objectives and agreements of HHSC and any of its facilities, affiliates or subsidiaries, and all patient information, in any form, whether written, verbal, or electronic, are confidential ("Confidential Information"); provided, however, that Confidential Information, with the exception of patient information, shall not include information that is in the public domain.
- 4. CONTRACTOR EXCLUSION FROM FEDERAL PROGRAMS. CONTRACTOR warrants that it and none of its employees, agents or subcontractors performing services or providing goods pursuant to this Agreement are excluded from participation in federal health care programs, as defined in the Social Security Act (section 1128 and 1128A), and other federal laws and regulations relating to health care. HHSC reserves the right to



verify that the above warranty is true and to immediately cancel this Agreement in the event it is violated.

- 5. CERTIFICATION OF COMPLIANCE FOR FINAL PAYMENT. In addition to the requirements for final payment as specified in Section 8.8 of the General Conditions, the CONTRACTOR must submit an original CERTIFICATE OF COMPLIANCE FOR FINAL PAYMENT.
- 6. CAMPAIGN CONTRIBUTIONS BY STATE AND COUNTY CONTRACTORS.

CONTRACTORs are hereby notified of the applicability of Section 11-205.5, HRS, which states that campaign contributions are prohibited from specified State or county government contractors during the term of the contract if the contractors are paid with funds appropriated by a legislative body. For more information, please consult with the Campaign Spending Commission, or visit its website, www.hawaii.govicampaign.



### **APPENDIX E**

### **MANDATORY QUESTIONS**

See following pages.



| Company Name & Address: Contact Name & Information:        |          |
|--|----------|
|  |          |
| QUESTION   | COMMENTS |
| 3.7.3  |          |
| A. Background, Qualifications and Experience               |          |
| Provide a brief description of Company's qualifications to |          |
| perform the Scope of Services requirements.                |          |
| Does your company have previous experience working         |          |
| with re-heat systems in the past 3 years? If yes, provide  |          |
| details of applicable projects.                            |          |
| Does your company have experience with the following       |          |
| healthcare procedures and/or policies:                     |          |
| - Infection Control  |          |
| - Fire Safety  |          |
| Does your company have any letters of                      |          |
| recommendations that can be submitted as a part of this    |          |
| RFP? If yes, please include.                               |          |
| How long has your company been in business?                |          |
| Have you ever operated under another business name?        |          |
| If yes, please list the name(s) and date(s).               |          |
| What state is your company incorporated in?                |          |
| How many employees does your company employ?               |          |
| (Direct employees only.)                                   |          |
| What is the shortest timeframe an employee has worked      |          |
| with you and what is the longest?                          |          |
| In what types of projects do you specialize?               |          |
| What sets you or your company apart from your              |          |
| competitors?   |          |



| Company Name & Address:  |           |
|--|-----------|
| Contact Name & Information:  |           |
| QUESTION   | COMMENTS  |
| What does your company offer its employees by way of job education?  |           |
| What is the longest amount of down-time your company experienced between jobs and why?   |           |
| Have you, individually or as a part of your company, ever failed to complete any construction project? If yes, explain why.                |           |
| Identification of litigation currently impacting the Company, if any. State "NONE", if none.   |           |
| Identification of any fines or violations received in the past 3 years relative to safety and environmental issues. State "NONE", if none. |           |
| State your Experience Modification Rate (EMR). This can be obtained from your insurance company.   |           |
| Have you had any legal action brought against you as the result of work you have performed? If yes, why, and what was the outcome?         |           |
| Have you or any of your company's ever declared bankruptcy?  |           |
| How will you identify with which sub-contractors to work on this Project?  |           |
| Describe your Company's warranty program.  |           |
| Describe your project close-out process.   |           |
| Is your company bondable for 100% of the project cost for both performance and payment?  | Yes or No |
| B. Project Management  |           |



|   | Company Name & Address: Contact Name & Information:                                  |          |
|---|--|----------|
|   | contact Name a micrimation.  |          |
|   | QUESTION   | COMMENTS |
|   | How much lead-time does your company need to begin                                   |          |
|   | dedicating resources to this project once the contract is                            |          |
|   | signed?  |          |
|   | Will there be a supervisor or lead carpenter on site or will                         |          |
|   | the project be managed from a different location?                                    |          |
|   | - Supervisor must be knowledgeable in all aspects                                    |          |
|   | of managing a construction site. Site Supervisor                                     |          |
|   | must be able to communicate from the site via  |          |
|   | electronic means.  |          |
|   | Conflicts between Company and KCH may occur from                                     |          |
|   | time to time during this project; how do you anticipate                              |          |
|   | mitigating disagreements as well as resolving them?                                  |          |
|   | Do you have a project management plan to ensure cost-                                |          |
|   | effective, efficient and timely performance of all project                           |          |
|   | tasks? If yes, please describe. If not,  |          |
|   | How do you track and manage questions, resolutions,                                  |          |
|   | decisions, directions and other information matters                                  |          |
|   | throughout your projects?  |          |
|   | If your company does not have a West Hawaii office, will                             |          |
|   | you be willing to discuss partnering with a locally based contractor?                |          |
|   |  |          |
|   | How many projects will your company have occurring at the same time as this project? |          |
|   | - If multiple projects, how will your company  |          |
|   | successfully manage all projects at the same   |          |
|   | time?  |          |
| l | cirrie.  |          |



| Company Name & Address:                                    |          |
|--|----------|
| Contact Name & Information:                                |          |
|  |          |
| QUESTION   | COMMENTS |
| How many outstanding bids does your company have at        |          |
| this time?   |          |
| In order to execute the project by the agreed upon         |          |
| completion date, what will you require of HHSC? What       |          |
| do you see as HHSC's responsibilities?                     |          |
| Submit a detailed yet approximate project timeline. A      |          |
| separate sheet behind the mandatory questions may be       |          |
| used if necessary.   |          |
| What steps will your company take to execute the           |          |
| project in a cost-effective, efficient and timely manner?  |          |
| How familiar are you with special requirements for         |          |
| Hospital construction? State the concerns applicable to    |          |
| this project and how OFFEROR proposes to minimize risk     |          |
| associated with the concerns.                              |          |
| What potential project risks or issues are anticipated and |          |
| how will they be addressed in order to minimize risk?      |          |
| C. Financial   |          |
| What is your company's legal structure?                    |          |
| What is your OH&P percentage for this project?             |          |
| How is OH&P calculated?                                    |          |
| How do you calculate OH&P on additive and deductive        |          |
| change orders?   |          |
| How do you ensure your subcontractors are providing        |          |
| fair pricing?  |          |
| What is your Company's bonding capacity?                   |          |



| Company Name & Address: Contact Name & Information:  |          |
|--|----------|
| QUESTION   | COMMENTS |
| If it is determined some work must be performed on off-<br>work or weekend, how will the upcharge be computed<br>with this being a fixed fee agreement?  |          |
| Do you bill monthly or according to milestones? Please explain in detail your billing method as well deposit requirements, if any.   |          |
| D. References  |          |
| Provide a brief description of three (3) past and/or present contracts demonstrating Company's qualifications, experience and performance with regard to performance of the Scope of Services requirements. Include customer name, contact name, email address and telephone number. |          |
| If KCH was to contact any of your subcontractors for a reference, what do you think they would tell us about your company and your projects?   |          |
| Who are your top 3 material suppliers?   |          |
| <ul> <li>Are your accounts in good standing? If not, why?</li> </ul>   |          |
| Why should KCH hire your company to perform the requirements of this project?  |          |
| Is there any additional information that might be valuable to KCH in determining which company to award the Re-heat hot water system upgrade project?  |          |



### **APPENDIX F**

### AGENDA FOR PRE-PROPOSAL CONFERENCE WITH TOUR OF HOSPITAL FACILITIES

| General Information  |  |   |  |
|--|--|---|--|
| Date   | TBD  |   |  |
| Location   | Kona Community Hospital Conference Room # 79-1019 Haukapila Street Kealakekua, HI 96750 Map is below   |   |  |
| Point of Contact   | Contracts Management Yvonne Taylor, Sr. Contracts Manager West Hawaii Region Email ytaylor@hhsc.org Direct (808) 322-4442 Fax (808) 322-4488  OR  Contracts Management Michelle Gray, Contracts Asst II West Hawaii Region Email mgray@hhsc.org Direct (808) 322-5830 Fax (808) 322-4488  OR |   |  |
|  | <u> </u><br>Agenda   |   |  |
| 8:20 am – 8:30 am  | Obtain temperature check at Hospital's Registrati prior to meeting. Vendors must have a signed cor or brought to the meeting.  | on entrance. Visitor badges will be provided fidentiality agreement, either already submitted |  |
| 8:30 am to 9:15 am   | Briefing, including site walk through  |   |  |
| 9:15 am to 10:00 am  | Project site tour  |   |  |
| Enter Special Services Building & go around to the back. Take elevator to 1st floor. Go right and down to end of hallway. Conference rooms are marked.  Map of Kona Community Hospital |  |   |  |



#### **APPENDIX G**

#### RFP CONFERENCE RESERVATION FORM

**Conference Information** 

Submit completed forms to Issuing Officer by the date shown in Figure 1 of the solicitation.

| RFP No:  | HHSC 21-0      | 044   |               |          |             |  |
|--|----------------|-------|---------------|----------|-------------|--|
| RFP Kona Community Hospital – Hospital Re-Heat Hot Water System Upgrade Title: |                |       |               |          | ograde      |  |
|  |                |       |               |          |             |  |
|  |                |       | OFFEROR In    | formatio | n           |  |
| Business   | Name           |       |               |          |             |  |
| Street Ad  | ldress         |       |               |          |             |  |
| City   |                |       |               |          |             |  |
| State  |                |       |               |          | Zip code    |  |
|  |                |       | T             | 1        |             |  |
| Priority   | Attendee Name, | Title | Email Address | Role in  | Procurement | Will Attend Meeting<br>& Hospital Tour |
| 1  |                |       |               |          |             |  |
|  |                |       |               |          |             |  |
|  |                |       |               |          |             |  |
|  |                |       |               |          |             |  |
| 2  |                |       |               |          |             |  |
|  |                |       |               |          |             |  |
|  |                |       |               |          |             |  |
|  |                |       |               |          |             |  |

Due to space constraints and to avoid disruption to Hospital operations, it is necessary to limit the number of attendees to two per company. Please limit Hospital Tour participants to those individuals that have a need to view the work areas in order to prepare the OFFEROR's proposal. An executed Confidentiality Agreement (Appendix H) is necessary to participate in Hospital Tour.

NOTE: KCH may find it necessary to limit attendees to one per company due to the changing COVID-19 requirements. OFFERORS will be notified in advance.

PLEASE SUBMIT RESERVATION FORM AND SIGNED CONFIDENTITALITY AGREEMENT AT LEAST 24 HOURS PRIOR TO THE MEETING



#### APPENDIX H

#### MANDATORY HOSPITAL TOUR CONFIDENTIALITY AGREEMENT

I understand that while attending the hospital tour, I may hear patients discussing their health information and I may see someone I know. I understand that I cannot disclose this confidential information to friends, relatives, co-workers or anyone else.

If I violate this agreement, I may be subject to adverse action up to and including termination of my ability to work at Kona Community Hospital. In addition, under applicable law, I may be subject to criminal or civil penalties.

I have read and understand the above and agree to be bound by it.

| OFFEROR    |      |  |
|------------|------|--|
| Name:      | <br> |  |
| Title:     |      |  |
| Company:   |      |  |
| Signature: |      |  |
| Date:      |      |  |

[THE REMAINDER OF THIS PAGE IS LEFT BLANK INTENTIONALLY.]



#### APPENDIX I

### **SUBCONTRACTOR TABLE**

\*Any changes with your subcontractor must be requested in writing to the Hospital Technical Representative prior to starting that phase of work.

| TRADE | COMPANY NAME | COMPANY ADDRESS | LICENSE<br>NUMBER | YEARS IN<br>BUSINESS |
|-------|--------------|-----------------|-------------------|----------------------|
|       |              |                 |                   |                      |
|       |              |                 |                   |                      |
|       |              |                 |                   |                      |
|       |              |                 |                   |                      |
|       |              |                 |                   |                      |
|       |              |                 |                   |                      |
|       |              |                 |                   |                      |
|       |              |                 |                   |                      |



### **APPENDIX J**


#### **DRAWINGS**

See following pages

# HVAC MODIFICATIONS FOR REHEAT SYSTEM

## KONA COMMUNITY HOSPITAL

79-1019 HAUKAPILA STREET, KEALAKEKUA, HI 96750 TMK: 7-9-010:081

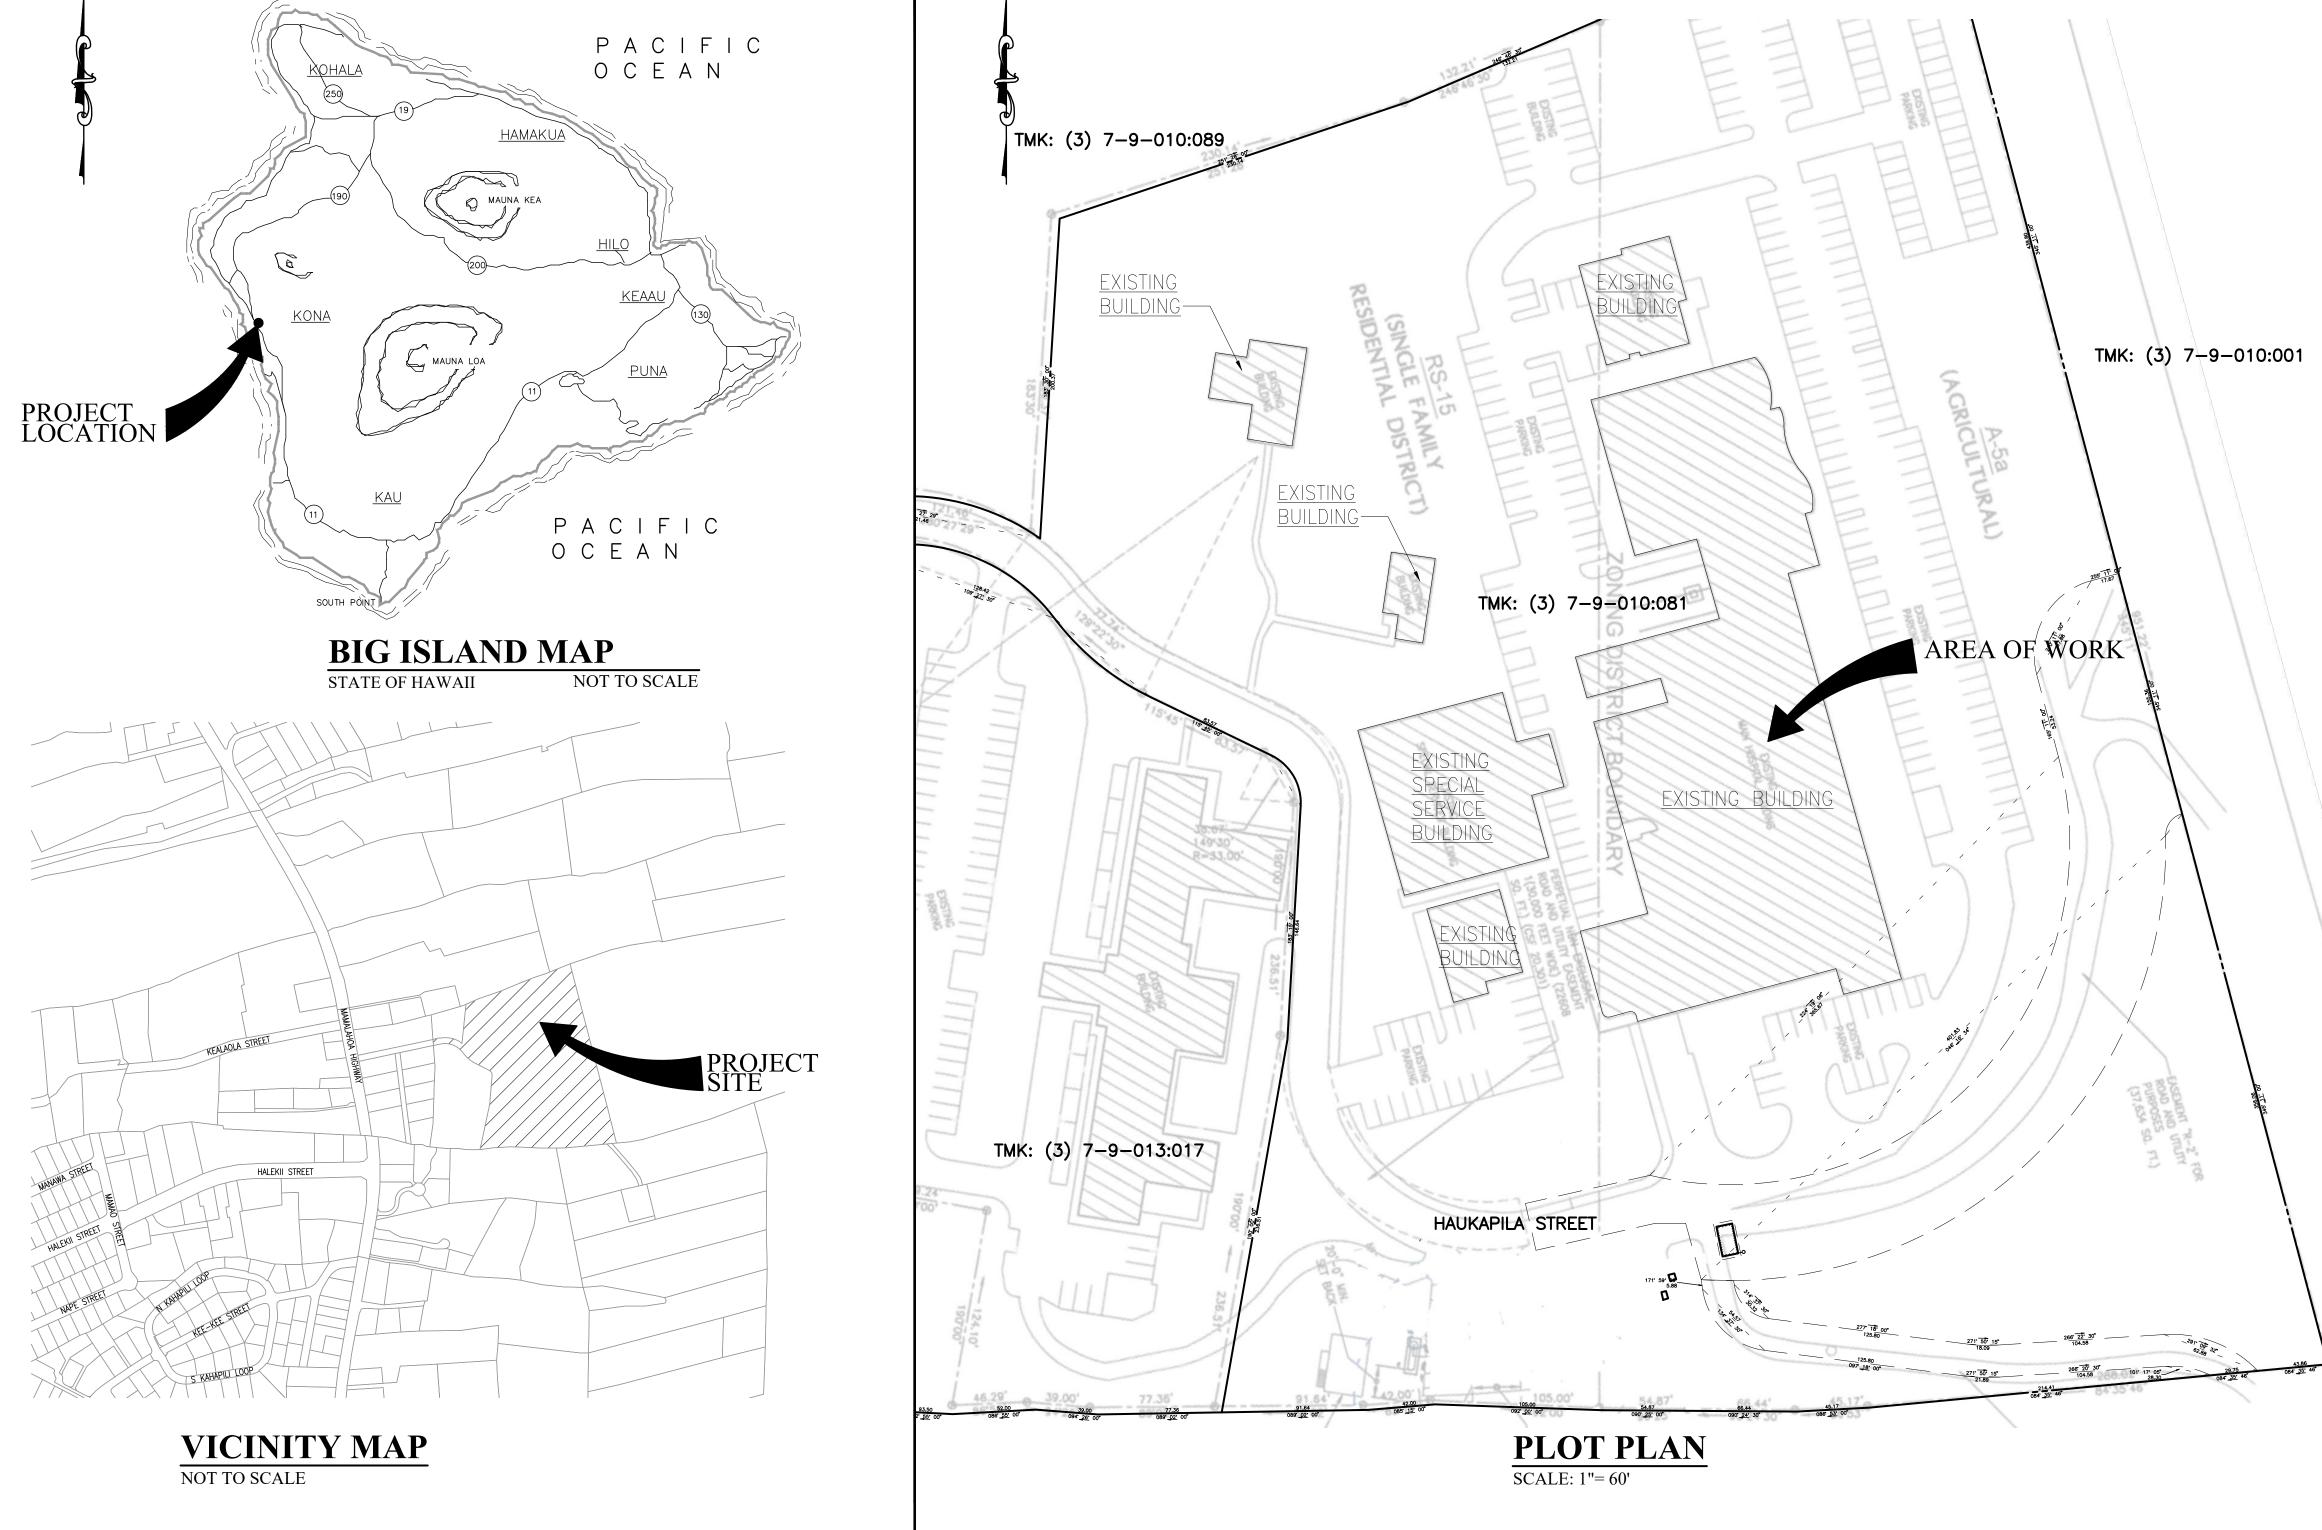

| E          |            | 1  |          |                   |
|------------|------------|----|----------|-------------------|
| EN(<br>P A | GIN<br>R T | EE | RII<br>E | N <b>G</b><br>R S |

455 E. Lanikaula St. Hilo Hawai'i 96720 Main (808) 933-7900 www.epinc.pro Hawai`i | Las Vegas



THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION, CONSTRUCTION OF THIS PROJECT WILL BE UNDER MY OBSERVATION

GINDEX, PLOT ICINITY MAP

(3) 7-9-010:081

| <b></b>    |              |
|------------|--------------|
| RAWN BY:   | DESIGNED BY: |
| S          | MS           |
| HECKED BY: | QC'D BY:     |
| YT         | DH           |
| JOB        | NO.          |

12022-17-01 DWG. NO.

T-001 SHEET NO. 01 OF 1

### PROJECT TEAM:

**DRAWING INDEX** 

MECHANICAL SCHEDULES

DESCRIPTION

MECHANICAL SYMBOLS, ABBREVIATIONS, & SPECS

HOT WATER REHEAT - GROUND FLOOR PLAN

HOT WATER REHEAT - SECOND FLOOR PLAN

HOT WATER REHEAT - ROOF PLAN PARTIAL DEMO/NEW

SEQUENCE OF OPERATIONS AND DDC POINTS LIST

ELECTRICAL SYMBOLS, IECC & ABBREVIATIONS

HOT WATER REHEAT - ROOF PLAN

REHEAT PIPING DIAGRAM AT ROOF

OVERALL ELECTRICAL ROOF PLAN

PARTIAL ELECTRICAL ROOF PLANS

MECHANICAL DETAILS

SINGLE LINE DIAGRAMS

TITLE, DRAWING INDEX, PLOT PLAN, ISLAND MAP, & VICINITY MAP

OWNER/DEVELOPER/TENANT: NAME: HAWAII HEALTH SYSTEMS CORP. PHONE: (808) 322-6970 MAILING ADDRESS: 3675 KILAUEA AVENUE, HONOLULU, HI 96816 LOCATION ADDRESS: 79-1019 HAUKAPILA STREET ENGINEERING CONSULTANT MECHANICAL, ELECTRICAL NAME: ENGINEERING PARTNERS, INC PHONE: (808) 933-7900 ADDRESS: 455 E. LANIKAULA ST., HILO, HAWAII 96720

### CODE SEARCH


SPECIAL INSPECTIONS REQUIRED..


DESIGN CRITERIA:

| ı | DEGIGIT GITTELT                                   |                             |
|---|---|-----------------------------|
| ı | BUILDING CODE                                     | 2012 IBC                    |
| l | WIND SPEED - (BASIC/EFFECTIVE)                    | 105 MPH                     |
| l | WIND CATEGORY.                                    | _                           |
| l | WIND CATEGORYSEISMIC DESIGN CATEGORY              | F                           |
| l | ROOF LIVE LOAD                                    |                             |
| l | FLOOR LIVE LOAD                                   |                             |
| ı | TEOON LIVE LOAD                                   | ONCHANGED                   |
| l | ZONING  | ۸ ۶۸۰ CIII، "II"            |
| l | ZONING  | 10 075 ACDES                |
| l | PARCEL AREA                                       | 12.073 ACRES                |
| l | OCCUPANCY CLASSIFICATION                          |                             |
| l | OCCUPANT LOAD                                     |                             |
| l | TYPE OF CONSTRUCTION                              |                             |
| l | FIRE SPRINKLERS                                   | YES [TYPE-NFPA 13]          |
| l | HEIGHT (ALLOWABLE/ACTUAL)                         | UNCHANGED                   |
| l | STORIES - (ALLOWABLE/ACTUAL)                      | UNCHANGED                   |
| l | AREA — ALLOWABLE/ACTUAL                           | 525 097 CO /ET              |
| V | ANUMBER OF FYITE ALLOWER PROVIDER                 | 323,967 3Q/F1               |
| l | NUMBER OF EXITS — ALLOWED/PROVIDED                | UNCHANGED                   |
| l | ROOF COVERING MATERIAL                            | UNCHANGED                   |
| l |   |                             |
| l | REQ. FIRE RESISTANCE OF EXT. WALLS                |                             |
| l | REQ. PROTECTION OF OPENINGS                       |                             |
| l | REQ. FIRE RESISTANCE RATING FOR BUILDING ELEMENTS | UNCHANGED                   |
| I | REQ. FIRE-RESISTANCE-RATED SEPARATIONS            | UNCHANGED                   |
| I | REQ. SEPARATION OF OCCUPANCIES                    | UNCHANGED                   |
| ĺ | I.E.C.C. CERTIFICATION                            | REFER TO SHEETS-M-001.F-001 |
| ı |   |                             |

| 1                   | NO CEAN                       |
|---------------------|-------------------------------|
|                     | 19<br>HAMAKUA                 |
|                     | TIAMANOA                      |
| '                   | 190) MAUNA KEA                |
|                     | HILO                          |
|                     | E 200 KEAAU                   |
|                     | KONA (130)                    |
|                     | MAUNA LOA PUNA                |
| PROJECT<br>LOCATION |                               |
| Localitor           |                               |
|                     | PACIFIC                       |
|                     | OCEAN                         |
|                     | SOUTH POINT                   |
|                     | BIG ISLAND MAP                |
|                     | STATE OF HAWAII NOT TO SCALE  |
|                     |                               |
|                     |                               |
|                     |                               |
|                     |                               |
|                     |                               |
|                     |                               |
|                     |                               |
|                     |                               |
|                     | MANIA STREET                  |
|                     | REALAOLA STREET  PROJECT SITE |
|                     | PROJEC SITE                   |
| STREET              |                               |
| MANAYA STREE        | PROJEC SITE                   |
| HALEKII STREET      | HALEKII STREET                |
| HALEKII STREET      | HALEKII STREET  REPLICABE     |
| HALENI STREET PH    |                               |

### MECHANICAL PIPING SYMBOLS

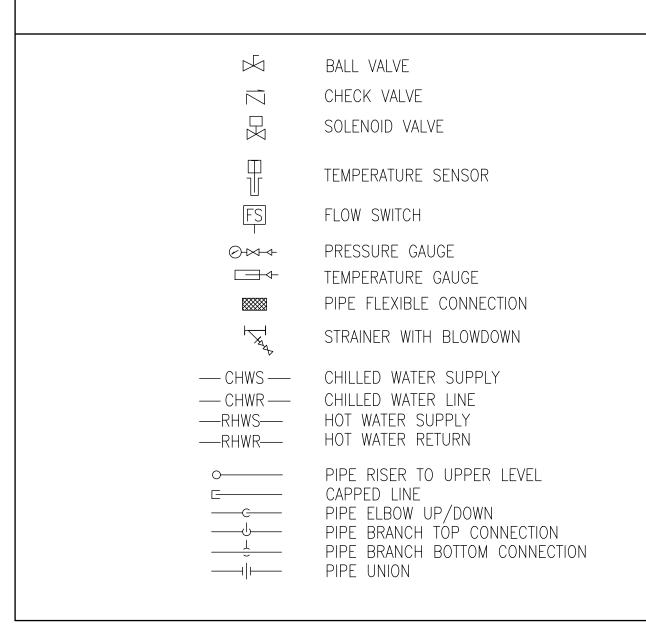

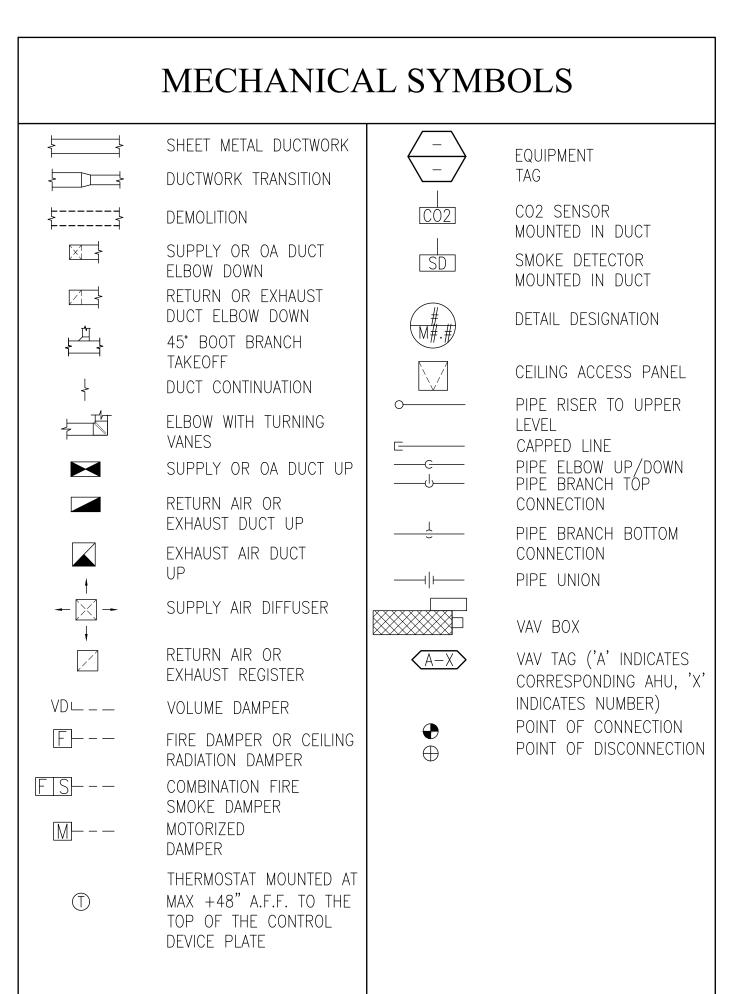

### GENERAL MECHANICAL **SPECIFICATIONS**

- 1. PROVIDE COMPLETE AND OPERATING SYSTEMS AS SPECIFIED AND INDICATED ON DRAWINGS. "PROVIDE" SHALL MEAN "FURNISH AND INSTALL" WHEN USED HEREIN.
- 2. WORK SHALL COMPLY WITH ALL LOCAL CODES AND ORDINANCES INCLUDING: ANSI B9.1/ASHRAE 15 - SAFETY CODE FOR MECHANICAL REFRIGERATION; HAWAII DOH CHAPTER 39, TITLE 11 - AIR CONDITIONING AND VENTILATION; HAWAII COUNTY BUILDING CODE; ASHRAE 62-2016 - VENTILATION STANDARD; SMACNA HVAC DUCT CONSTRUCTION STANDARDS; 2015 INTERNATIONAL ENERGY CONSERVATION CODE.
- 3. CONTRACTOR SHALL ARRANGE AND PAY FOR ALL PERMITS AND FEES.
- 4. MATERIALS AND EQUIPMENT SHALL BE NEW AND GUARANTEED FOR ONE YEAR FROM THE DATE OF ACCEPTANCE. MATERIALS AND EQUIPMENT SHALL BE AS SCHEDULED OR EQUAL, MEETING THE REQUIREMENTS OF THE SPECIFICATION. MATERIALS AND EQUIPMENT SHALL BE SUBMITTED TO THE WHFD AND/OR PROJECT MANAGER FOR APPROVAL PRIOR TO ORDER RELEASE. WORK SHALL BE GUARANTEED AGAINST DEFECTIVE WORKMANSHIP OR MATERIALS FOR A PERIOD OF ONE YEAR AFTER FINAL ACCEPTANCE OF THE PROJECT. WARRANTY WORK SHALL BE COMPLETED AT NO EXTRA CHARGE TO THE OWNERS. FURNISH MANUFACTURER'S PRODUCT WARRANTY CERTIFICATES IN A BINDER.
- 5. PRIOR TO COMMENCEMENT OF WORK AND ORDERING OF EQUIPMENT, CONTRACTOR SHALL SUBMIT 6 BOUND SETS OF PROPOSED MATERIALS AND EQUIPMENT. RECORD DRAWINGS, OPERATION MANUALS AND MAINTENANCE MANUALS SHALL BE SUBMITTED AS REQUIRED BY WHFD AND/OR PROJECT MANAGER UPON COMPLETION.
- 6. DRAWINGS SHALL NOT BE SCALED.
- 7. PENETRATIONS OF FIRE RATED WALLS OR FLOORS BY PIPE SHALL BE SEALED BY A FIRESTOPPING SYSTEM UL LISTED FOR THE APPLICATION INSTALL PENETRATION SEAL MATERIALS IN ACCORDANCE WITH PRINTED INSTRUCTIONS OF THE UL FIRE RESISTANCE DIRECTORY AND MANUFACTURERS INSTRUCTIONS. FIRESTOPPING SYSTEM SHALL BE EQUAL TO 3M FIRE BARRIER. FIRESTOPPING MATERIAL SHALL BE CAULK OR PUTTY TYPE. PROVIDE FIRE DAMPERS ON ALL DUCT PENETRATIONS THROUGH FIRE RATED WALLS AS REQUIRED TO PRESERVE THE FIRE RATING OF THE STRUCTURE.
- 8. MECHANICAL EQUIPMENT SHALL BE SECURED AND INSTALLED PER MANUFACTURERS RECOMMENDATIONS AND APPLICABLE SECTIONS OF THE INTERNATIONAL BUILDING CODE AND INTERNATIONAL MECHANICAL
- 9. ELECTRICAL CHARACTERISTICS OF MECHANICAL EQUIPMENT SHALL BE VERIFIED WITH ELECTRICAL DRAWINGS PRIOR TO ORDER RELEASE. ADDITIONAL ELECTRICAL WORK RESULTING FROM EQUIPMENT SUBSTITUTION SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.
- 10. DUCTWORK, PIPING AND EQUIPMENT SHALL BE PROVIDED WITH SEISMIC RESTRAINTS IN ACCORDANCE WITH THE SMACNA SEISMIC RESTRAINT MANUAL - GUIDELINES FOR MECHANICAL SYSTEMS.
- 11. ELECTRICAL: CONFORM TO THE REQUIREMENTS NATIONAL ELECTRICAL CODE. OBTAIN EQUIPMENT MANUFACTURER'S CONTROL WIRING DIAGRAMS FOR THE EQUIPMENT FURNISHED. ELECTRICAL EQUIPMENT SHALL BE FURNISHED WITH WEATHER PROOF (NEMA 4X WHEN POSSIBLE) ENCLOSURES FOR OUTDOOR INSTALLATIONS AND OTHERWISE INDICATED ON PLANS.
- 12. FIELD INVESTIGATIONS: VISIT THE WORK-SITE AND BECOME FULLY AWARE OF ALL EXISTING CONDITIONS. INVESTIGATE THE CONTRACT DOCUMENTS AND MAKE PROPER PROVISIONS TO AVOID INTERFERENCES OR CONSTRUCTION DELAYS. DETERMINE THE EXACT ROUTE OF EACH DUCT AND PIPE. ANY DISCREPANCY SHALL BE IMMEDIATELY BROUGHT TO THE ATTENTION OF THE WHFD AND/OR PROJECT MANAGER.
- 13. WORK CONDITIONS: FIELD VERIFY CONDITIONS AND DIMENSIONS FOR INTERFERENCES. INSTALLED WORK SHALL BE PROTECTED DURING CONSTRUCTION AND CLEANED FOR FINAL INSPECTION. TOUCH-UP PAINT ALL RAW EDGES OF METAL EXPOSED TO WEATHER. COORDINATE WITH OTHER TRADES FOR PIPE SLEEVES AND INSTALLATION OF EQUIPMENT SUPPORTS.
- 14. REQUIREMENTS: PERFORM WORK USING PERSONNEL SKILLED IN THE TRADE INVOLVED. PROVIDE COMPETENT SUPERVISION. FURNISH NEW EQUIPMENT, MATERIALS AND ACCESSORIES BEARING THE MANUFACTURER'S IDENTIFICATION AND CONFORMING TO THE RECOGNIZED COMMERCIAL STANDARDS.
- 15. EQUIPMENT INSTALLATION: INSTALL EQUIPMENT IN THE SPACE ALLOTTED WITH SUFFICIENT CLEARANCE FOR PROPER OPERATION AND MAINTENANCE AND WITH SUFFICIENT HEAD CLEARANCE ACCORDING TO THE BUILDING CODE. WHERE EQUIPMENT DIFFERS IN ARRANGEMENT OR CONNECTIONS FROM THOSE SHOWN, PROVIDE ALL REQUIRED CHANGES IN PIPING, SUPPORTS AND APPURTENANCES. PROVIDE ACCESS PANELS WHERE REQUIRED FOR MAINTENANCE ACCESS TO EQUIPMENT.

|                | MECHANICAL A               | ADDI        | XE VIA HONS             |
|----------------|----------------------------|-------------|-------------------------|
| (E)<br>(D)     | EXISTING                   | FPM         | FEET PER MINUTE         |
| [ (D)          | DEMOLISH                   | FT          | FEET                    |
| (N)            | NEW                        | HTR         | HEATER                  |
| (R)            | RELOCATED                  | HΖ          | HERTZ                   |
| À              | AMPERE                     | KW          | KILOWATT                |
| A/C            | AIR CONDITIONING           | LAT         | LEAVING AIR TEMPERATURE |
| <b>I</b> ABV   | ABOVE                      | LBS         | POUNDS                  |
| ADJ            | ADJUSTABLE                 | MAN         |                         |
| AFF            | ABOVE FINISHED FLOOR       | MAX         | MAXIMUM                 |
| ACCU           | AIR COOLED CONDENSING UNIT | MCA         | MINIMUM CIRCUIT AMPS    |
| AHU            | AR HANDLING UNIT           | MECH        | MECHANICAL              |
| APPROX<br>ARCH | APPROXIMATELY<br>ARCHITECT | MIN<br>MOCP |                         |
| BLDG           | BUILDING                   | MTD         | MOUNTED                 |
| BHP            | BRAKE HORSEPOWER           | NOM         | NOMINAL                 |
| BV             | BALL VALVE                 | OA          | OUTSIDE AIR             |
| <b>I</b> CAP   | CAPACITY                   | PH          | PHASE                   |
| CD             | CEILING DIFFUSER           | PLMB        | PLUMBING                |
| CLG            | CEILING                    | QTY,        | QUANTITY                |
| CFM            | CUBIC FEET PER MINUTE      | REQ'D       | REQ'D                   |
| CONC           | CONCRETE                   | RM          | ROOM<br>DETUDNI AID     |
| CONN           | CONNECT                    | RA          | RETURN AIR              |

RETURN AIR REGISTER

STAINLESS STEEL TOTAL DISCHARGE HEAD

VARIABLE AIR VOLUME

MANUAL VOLUME DAMPER

RUNNING LOAD AMPS

SUPPLY AIR

**TEMPERATURE** 

VENT TO ROOF

WET BULB

ZONE DAMPER

TYPICAL

WATT

WITH

CONT

DBA

EXH

**EXIST** 

SIGNATURE:

08/01/20 MECHANICAL ENGINEER

DATE:

TITLE:

CONTINUATION

EXHAUST AIR

EXHAUST FAN

EXHAUST REGISTER

ELECTRICAL

**EXHAUST** 

EXISTING

FAN COIL

FLEXIBLE

FIRE DAMPER

FULL LOAD AMPS

DECIBELS (A-WEIGHTED)

ENTERING AIR TEMPERATURE

EXTERNAL STATIC PRESSURE

DRY BULB

MECHANICAL ARREVIATIONS

HAWAII COUNTY ENERGY CODE 2015 IECC, HAWAII REVISED STATUTES HRS 107-24 TO 28 & HAWAII ADMINISTRATIVE RULES CHAPTER HAR 3-181.1 COMMERCIAL BUILDING ENERGY EFFICIENCY STANDARDS

RLA SA SQ

I CERTIFY THAT, TO THE BEST OF KNOWLEDGE, THIS PROJECTS DESIGN SUBSTANTIALLY CONFORMS TO THE BUILDING ENERGY EFFICIENCY STANDARDS PERTAINING TO THE COMMERCIAL PROVISIONS FOR MECHANICAL SYSTEMS (C403,

|      | C404, & C405) OF THE 2015 IECC WITH AMENDMENTS PER HAR 3-18    | 1.1: |     |
|------|--|------|-----|
| COMF | PLIANCE METHOD   |      |     |
| Х    | 2015 IECC AS AMENDED. MANDATORY AND PRESCRIPTIVE               |      |     |
|      | 2015 IECC AS AMENDED. MANDATORY AND TOTAL BUILDING PERFORMANCE |      |     |
|      | ASHRAE STANDARD 90.1-2013. MANDATORY AND PRESCRIPTIVE          |      |     |
|      | ASHRAE STANDARD 90.1-2013. MANDATORY AND ENERGY COST BUDGET    |      |     |
| INFO | RMATION IN CONSTRUCTION DOCUMENTS                              | YES  | N/A |
| HVAC | SYSTEMS  |      |     |
|      | EQUIPMENT CAPACITY AND EFFICIENCY.                             | X    |     |
|      | THERMOSTATIC CONTROLS.   |      | X   |
|      | GUEST ROOM DOOR SWITCHES.                                      |      | X   |
|      | VENTILATION RATE.  |      | X   |
|      | DEMAND CONTROL VENTILATION CONTROLS.                           | 1    | X   |
|      | ENCLOSED PARKING GARAGE VENTILATION CONTROL.                   | 1    | X   |
|      | ENERGY RECOVERY VENTILATION SYSTEM.                            |      | X   |
|      | KITCHEN EXHAUST SYSTEM.  |      | X   |
|      | DUCT AND PLENUM INSULATION THICKNESS/R-VALUE.                  |      | X   |
|      | DUCT AND PLENUM SEALING REQUIREMENTS.                          |      | X   |
|      | PIPE INSULATION THICKNESS/R-VALUE.                             |      | X   |
|      | FAN MOTOR HORSEPOWER.  |      | Х   |
|      | FAN EFFICIENCY.  |      | Х   |
|      | FAN MOTOR EFFICIENCY.  |      | X   |
|      | PUMP MOTOR EFFICIENCY.   | X    |     |
|      | VARIABLE-FLOW FAN CONTROL.                                     |      | Х   |
|      | STATIC PRESSURE SENSOR LOCATION.                               |      | Х   |
|      | STATIC PRESSURE RESET CONTROL.                                 |      | Х   |
|      | CHILLED WATER VARIABLE FLOW CONTROL.                           |      | Х   |
|      | CHILLER ISOLATION.   |      | Х   |
|      | COOLING TOWER FAN CONTROL.                                     |      | Х   |
|      | TERMINAL UNIT MINIMUM AND MAXIMUM AIRFLOW.                     |      | Х   |
|      | COMMISSIONING REQUIREMENTS.                                    | X    |     |
| REFR | RIGERATION   |      |     |
|      | REFRIGERATION EQUIPMENT EFFICIENCY.                            |      | X   |
|      | WALK-IN COOLERS AND FREEZERS.                                  |      | X   |
|      | REFRIGERATED WAREHOUSES.                                       |      | X   |
|      | REFRIGERATED DISPLAY CASES.                                    |      | X   |
| SERV | VICE WATER HEATING   |      | -   |
|      | HEAT RECOVERY FOR SERVICE WATER HEATING.                       |      | Х   |
|      | EQUIPMENT CAPACITY AND EFFICIENCY.                             | X    |     |
|      | PIPE INSULATION.   | X    |     |
|      | HOT WATER PIPE LENGTH/VOLUME.                                  | X    |     |
|      | HOT WATER CIRCULATION CONTROLS.                                |      | Х   |
|      | HEATED POOL AND SPA COVERS.                                    |      | X   |
|      | COMMISSIONING REQUIREMENTS.                                    |      | X   |
|      | <i>f</i>   |      |     |

NIMR Y. TAMIMI

LICENSE NO.:7936-M



455 E. Lanikaula St. Hilo Hawai`i 96720 Main (808) 933-7900 www.epinc.pro Hawai`i | Las Vegas



THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION, CONSTRUCTION OF THIS PROJECT

AL SYMBOLS, TONS, & SPECS MECHANIC ABBREVIAT

HVAC MODIFICATIONS FOR: REHEAT KONA COMMUNITY HOSPITAL

DESIGNED E CHECKED BY: QC'D BY:

> 12022-17-01 DWG. NO.

JOB NO.

M-001

SHEET NO. 02 OF 15

|             | PUMP SCHEDULE          |                 |            |               |              |             |                |                      |  |  |  |  |
|-------------|------------------------|-----------------|------------|---------------|--------------|-------------|----------------|----------------------|--|--|--|--|
| UNIT<br>NO. | SERVICE                | TYPE            | MOTOR TYPE | FLOW<br>(GPM) | HEAD<br>(FT) | MOTOF<br>HP | R DATA V/PH/HZ | PUMP<br>CONSTRUCTION | REMARKS  |  |  |  |
| RHWP<br>1   | HOSPITAL<br>AHU REHEAT | IN-LINE<br>PUMP | TEFC       | 110           | 100          | 7.5         | 460/3/60       | STAINLESS<br>STEEL   | AURORA PENTAIR PUMP OR APPROVED EQUAL. PROVIDE WITH VFD. |  |  |  |
| RHWP<br>2   | HOSPITAL<br>AHU REHEAT | IN-LINE<br>PUMP | TEFC       | 110           | 100          | 7.5         | 460/3/60       | STAINLESS<br>STEEL   | AURORA PENTAIR PUMP OR APPROVED EQUAL. PROVIDE WITH VFD. |  |  |  |

|             | PROPANE GAS BOILER SCHEDULE |                     |         |                            |                        |                       |                       |               |                    |                 |              |      |            |            |                       |              |     |   |
|-------------|-----------------------------|---------------------|---------|----------------------------|------------------------|-----------------------|-----------------------|---------------|--------------------|-----------------|--------------|------|------------|------------|-----------------------|--------------|-----|---|
| UNIT<br>NO. | SERVICE                     | LOCATION            | FUEL    | GAS<br>PRESSURE<br>MIN-MAX | MAX<br>OUTPUT<br>(MBH) | MAX<br>INPUT<br>(MBH) | MIN<br>INPUT<br>(MBH) | FLUE<br>(IN.) | THERMO<br>EFF. (%) | EWT/LWT<br>(°F) | V/PH/HZ      | AMPS | MAX<br>GPM | MIN<br>GPM | WATER VOLUME<br>(GAL) | WEIGHT (LBS) | dBA | REMARKS   |
| RHWB<br>1   | HOSPITAL<br>AHU REHEAT      | ROOF<br>(SHELTERED) | PROPANE | 4"-14"<br>WC               | 1,425                  | 1,500                 | 75                    | 3"            | 99.3               | 120/140         | 120/1/<br>60 | 16   | 225        | 25         | 27                    | 1606         | 70  | AERCO BENCHMARK OR APPROVED EQUAL. REFER TO BOILER NOTES. |
| RHWB<br>2   | HOSPITAL<br>AHU REHEAT      | ROOF<br>(SHELTERED) | PROPANE | 4"-14"<br>WC               | 1,425                  | 1,500                 | 75                    | 3"            | 99.3               | 120/140         | 120/1/<br>60 | 16   | 225        | 25         | 27                    | 1606         | 70  | AERCO BENCHMARK OR APPROVED EQUAL. REFER TO BOILER NOTES. |

|   |             | BUFFER TANK SCHEDULE |              |                                |               |                   |   |  |  |  |  |  |  |  |  |
|---|-------------|----------------------|--------------|--------------------------------|---------------|-------------------|---|--|--|--|--|--|--|--|--|
|   | UNIT<br>NO. | TYPE                 | VOLUME (GAL) | ASME PRESSURE RATING<br>(PSIG) | WEIGHT (LB)   | SYSTEM CONN. (IN) | REMARKS   |  |  |  |  |  |  |  |  |
| - | BT 1        | 2-PORT TANK          | 210          | 125                            | 2160 (FILLED) | 3"                | AERCO BUFFER TANK OR APPROVED EQUAL. PROVIDE WITH TEMPERATURE/PRESSURE RELIEF VALVE AND AUTOMATIC AIR VENT. |  |  |  |  |  |  |  |  |

## TESTING, ADJUSTING, AND BALANCING NOTES

- BALANCE, ADJUST, AND TEST: AN INDEPENDENT TEST AND BALANCE FIRM WHICH IS AABC OR NEBB CERTIFIED SHALL BE RETAINED FOR CHECK/TEST-START-UP AND TESTING AND BALANCING OF AIR AND WATER SYSTEMS. THE TEST REPORT SHALL BE IN A FORMAT APPROVED FOR SYSTEMS OF THIS TYPE AND COMPLEXITY. QUALIFICATIONS OF INDEPENDENT TEST AND BALANCE FIRM SHALL BE SUBMITTED FOR REVIEW. TAB WORK SHALL COMPLY WITH THE LATEST PROCEDURAL STANDARDS AND SMACNA'S TAB PROCEDURAL GUIDE.
- 2. TAB CONTRACTOR SHALL COORDINATE WITH MECHANICAL CONTRACTOR AND CONTROLS CONTRACTOR TO PROVIDE THE CFM AND GPM AS SHOWN ON SCHEDULES FOR EACH EQUIPMENT. CONTROLS CONTRACTOR TO COORDINATE WITH WHFD AND/OR PROJECT MANAGER AND TAB CONTRACTOR FOR ANY SHUTDOWNS OR SYSTEM OVERRIDES REQUIRED FOR TAB WORK.
- 3. CONTRACTOR SHALL BE RESPONSIBLE FOR BALANCING EXISTING SYSTEMS AS MAY BE NECESSARY TO ACHIEVE DESIGN AIRFLOW AND CHILLED WATER FLOW FOR NEW EQUIPMENT SPECIFIED ON THIS PROJECT. THE ADDITIONAL FLOW REQUIRED FOR THIS PROJECT WILL REQUIRE ADDITIONAL GPM IN THE LOOP SERVICING THE PROJECT. THIS SHALL BE ACHIEVED BY ADJUSTING THE EXISTING MAIN BRANCH BALANCING VALVES TO PROVIDE SUFFICIENT FLOW TO THE EQUIPMENT SPECIFIED.
- 4. MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING LOCATION AND PROPER OPERATION OF ALL EXISTING AND NEW BALANCING VALVES AND VOLUME DAMPERS (1) WEEK MINIMUM PRIOR TO COMMENCEMENT OF TAB WORK, AND REPORT TO THE CONSTRUCTION MANAGER ANY DEFICIENCY WHICH MAY PROHIBIT OR OTHERWISE ADVERSELY AFFECT THE TEST AND BALANCE WORK. SHOULD LACK OF SUCH EXAMINATION RESULT IN ADDITIONAL TEST AND BALANCE WORK, THE COST FOR SUCH WORK SHALL BE BORNE BY THE CONTRACTOR.
- 5. SEE WRITTEN SPECIFICATIONS FOR ADDITIONAL TAB REQUIREMENTS.

### VALVE REPLACEMENT NOTES

- 1. CONTRACTOR TO FIELD VERIFY LOCATION, SIZE, AND QUANTITY OF REHEAT HOT WATER SHUTOFF AND BALANCING VALVES, PIPING, AND ACCESSORIES. NOTIFY WHFD AND/OR PROJECT MANAGER FOR DISCREPANCIES PRIOR TO START OF WORK.
- 2. SEE WRITTEN SPECIFICATIONS FOR REQUIREMENTS FOR POST CONSTRUCTION FIELD DOCUMENTATION.

### WORK PHASING/SCHEDULING

- 1. CONTRACTOR COORDINATE WITH WHFD AND/OR PROJECT MANAGER PRIOR TO SCHEDULING ANY WORK WITHIN THE FACILITY.
- 2. MAXIMUM SHUTDOWN TIME SHALL NOT EXCEED 4 HOURS AT ANY GIVEN TIME. CONSIDERATION SHOULD BE GIVEN TO SCHEDULING WORK THAT WILL CRITICALLY IMPACT THE HOSPITALS FUNCTIONING TO EARLY MORNINGS, EVENING HOURS AND/OR WEEKENDS.
- 3. WORK PHASING SHALL FOLLOW THE SEQUENCE (VEIFY WITH WHFD AND/OR PROJECT MANAGER):
  - a. INSTALL ALL LOOP VALVES AND ACCESSORIES ON EACH LOOP.
  - b. INSTALL BY-PASS VALVE AND DIFFERENTIAL PRESSURE SENSOR AND PIPING AS SHOWN ON PLAN.
  - c. INSTALL NEW BOILERS, BUFFER TANK AND RELATED PIPING PRIOR TO REMOVAL OF EXISTING RINNAL WATER HEATERS AND STORAGE TANK.
- d. REPLACE EXISTING COMPRESSION TANK, AIR SEPARATOR AND INTERCONNECTING PIPING.
- e. REMOVE EXISTING RINNAI WATER HEATERS, HOT WATER STORAGE TANK AND INSTALL NEW PIPING TO CONNECT NEW SYSTEM TO EXISTING REHEAT SYSTEM.
- f. REPLACE REHEAT HOT WATER PUMP 1, RELATED PIPING, VALVES, VFD & ACCESSORIES.
- g. REPLACE REHEAT HOT WATER PUMP 2, RELATED PIPING, VALVES, VFD & ACCESSORIES.

### **NOTES**

- 1. PROVIDE PSX 700 OR APPROVED EQUAL FOR ALL EXTERNAL FAN BLADES AND OUTDOOR EQUIPMENT HOUSINGS (INTERNAL & EXTERNAL).
- 2. PROVIDE FRANKLIN VFD. PROVIDE AC LINE REACTOR TO REDUCE HARMONICS. PROVIDE DC FILTERS WHEN CABLE LENGTHS ARE GREATER THAN 20'.

### **DUCT AND PLENUM INSULATION NOTES**

- 1. DUCT INSULATION THICKNESS SHALL BE GREATER THAN OR EQUAL TO R-6 FOR SUPPLY AND RETURN DUCTS AND PLENUMS LOCATED IN UNCONDITIONED SPACES.
- 2. DUCT INSULATION THICKNESS SHALL BE GREATER THAN OR EQUAL TO R-8 FOR SUPPLY AND RETURN DUCTS AND PLENUMS LOCATED OUTDOORS.
- 3. DUCTS AND PLENUMS TO BE SEALED PER IMC 2015.

### PIPING INSULATION NOTES

1. PROVIDE PIPE INSULATION THICKNESSES PER IECC 2015 TABLE C403.2.10

### BOILER NOTES


- 1. PROVIDE WITH FACTORY BOILER MANAGEMENT SYSTEM, BMS.
- PROVIDE WITH AL29-4C STAINLESS STEEL
   PROVIDE WITH ZERO CLEARANCE KIT.
   VENTING PER UL1738



455 E. Lanikaula St. Hilo Hawai`i 96720 Main (808) 933-7900 www.epinc.pro Hawai`i | Las Vegas



THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION, CONSTRUCTION OF THIS PROJECT WILL BE UNDER MY OBSERVATION.

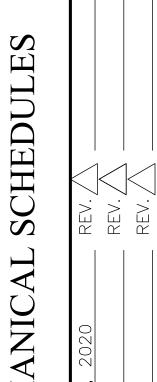

DATE: JULY, 2020 REV. A REV. A

MEC

IMIMIUINI I Y L PILA ST, KEALAKEKUA, HI 967

HOSPIT PESIGNED B

79-1019 HAU
TMK: (3) 7-9


CHECKED BY: QC'D BY: DH


JOB NO.

12022-17-01 DWG. NO.

M-002

SHEET NO. 03 OF 15

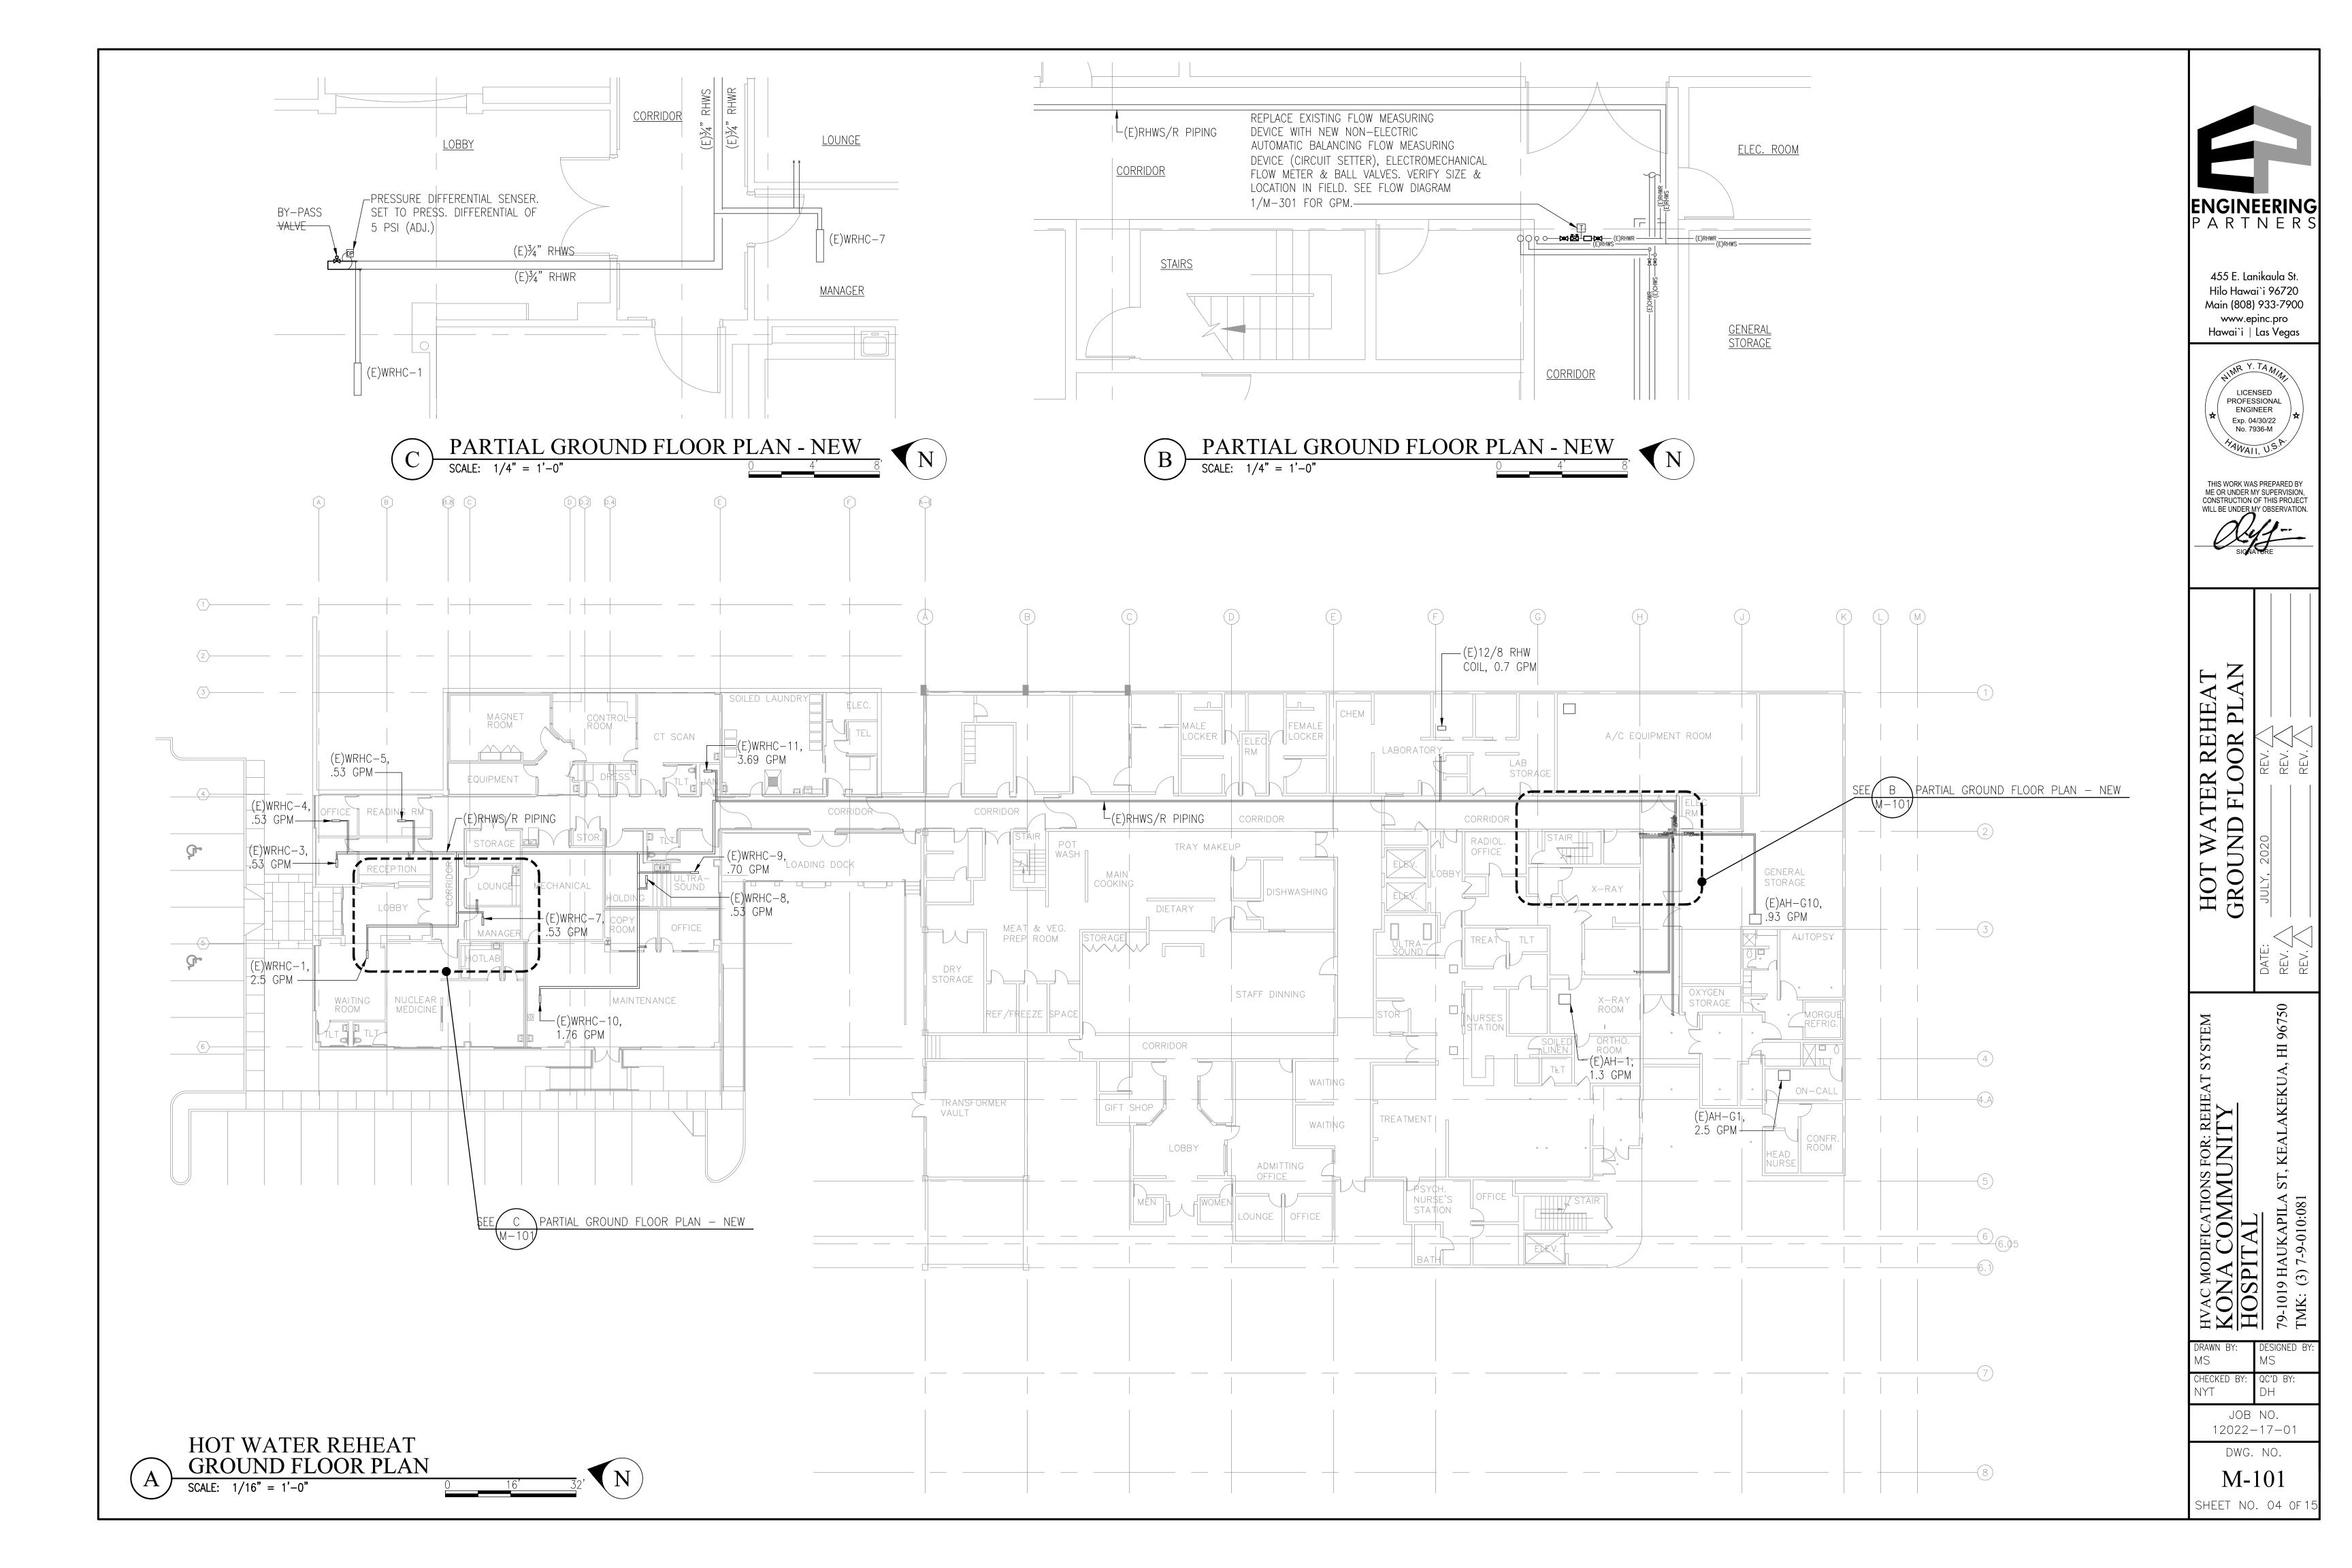

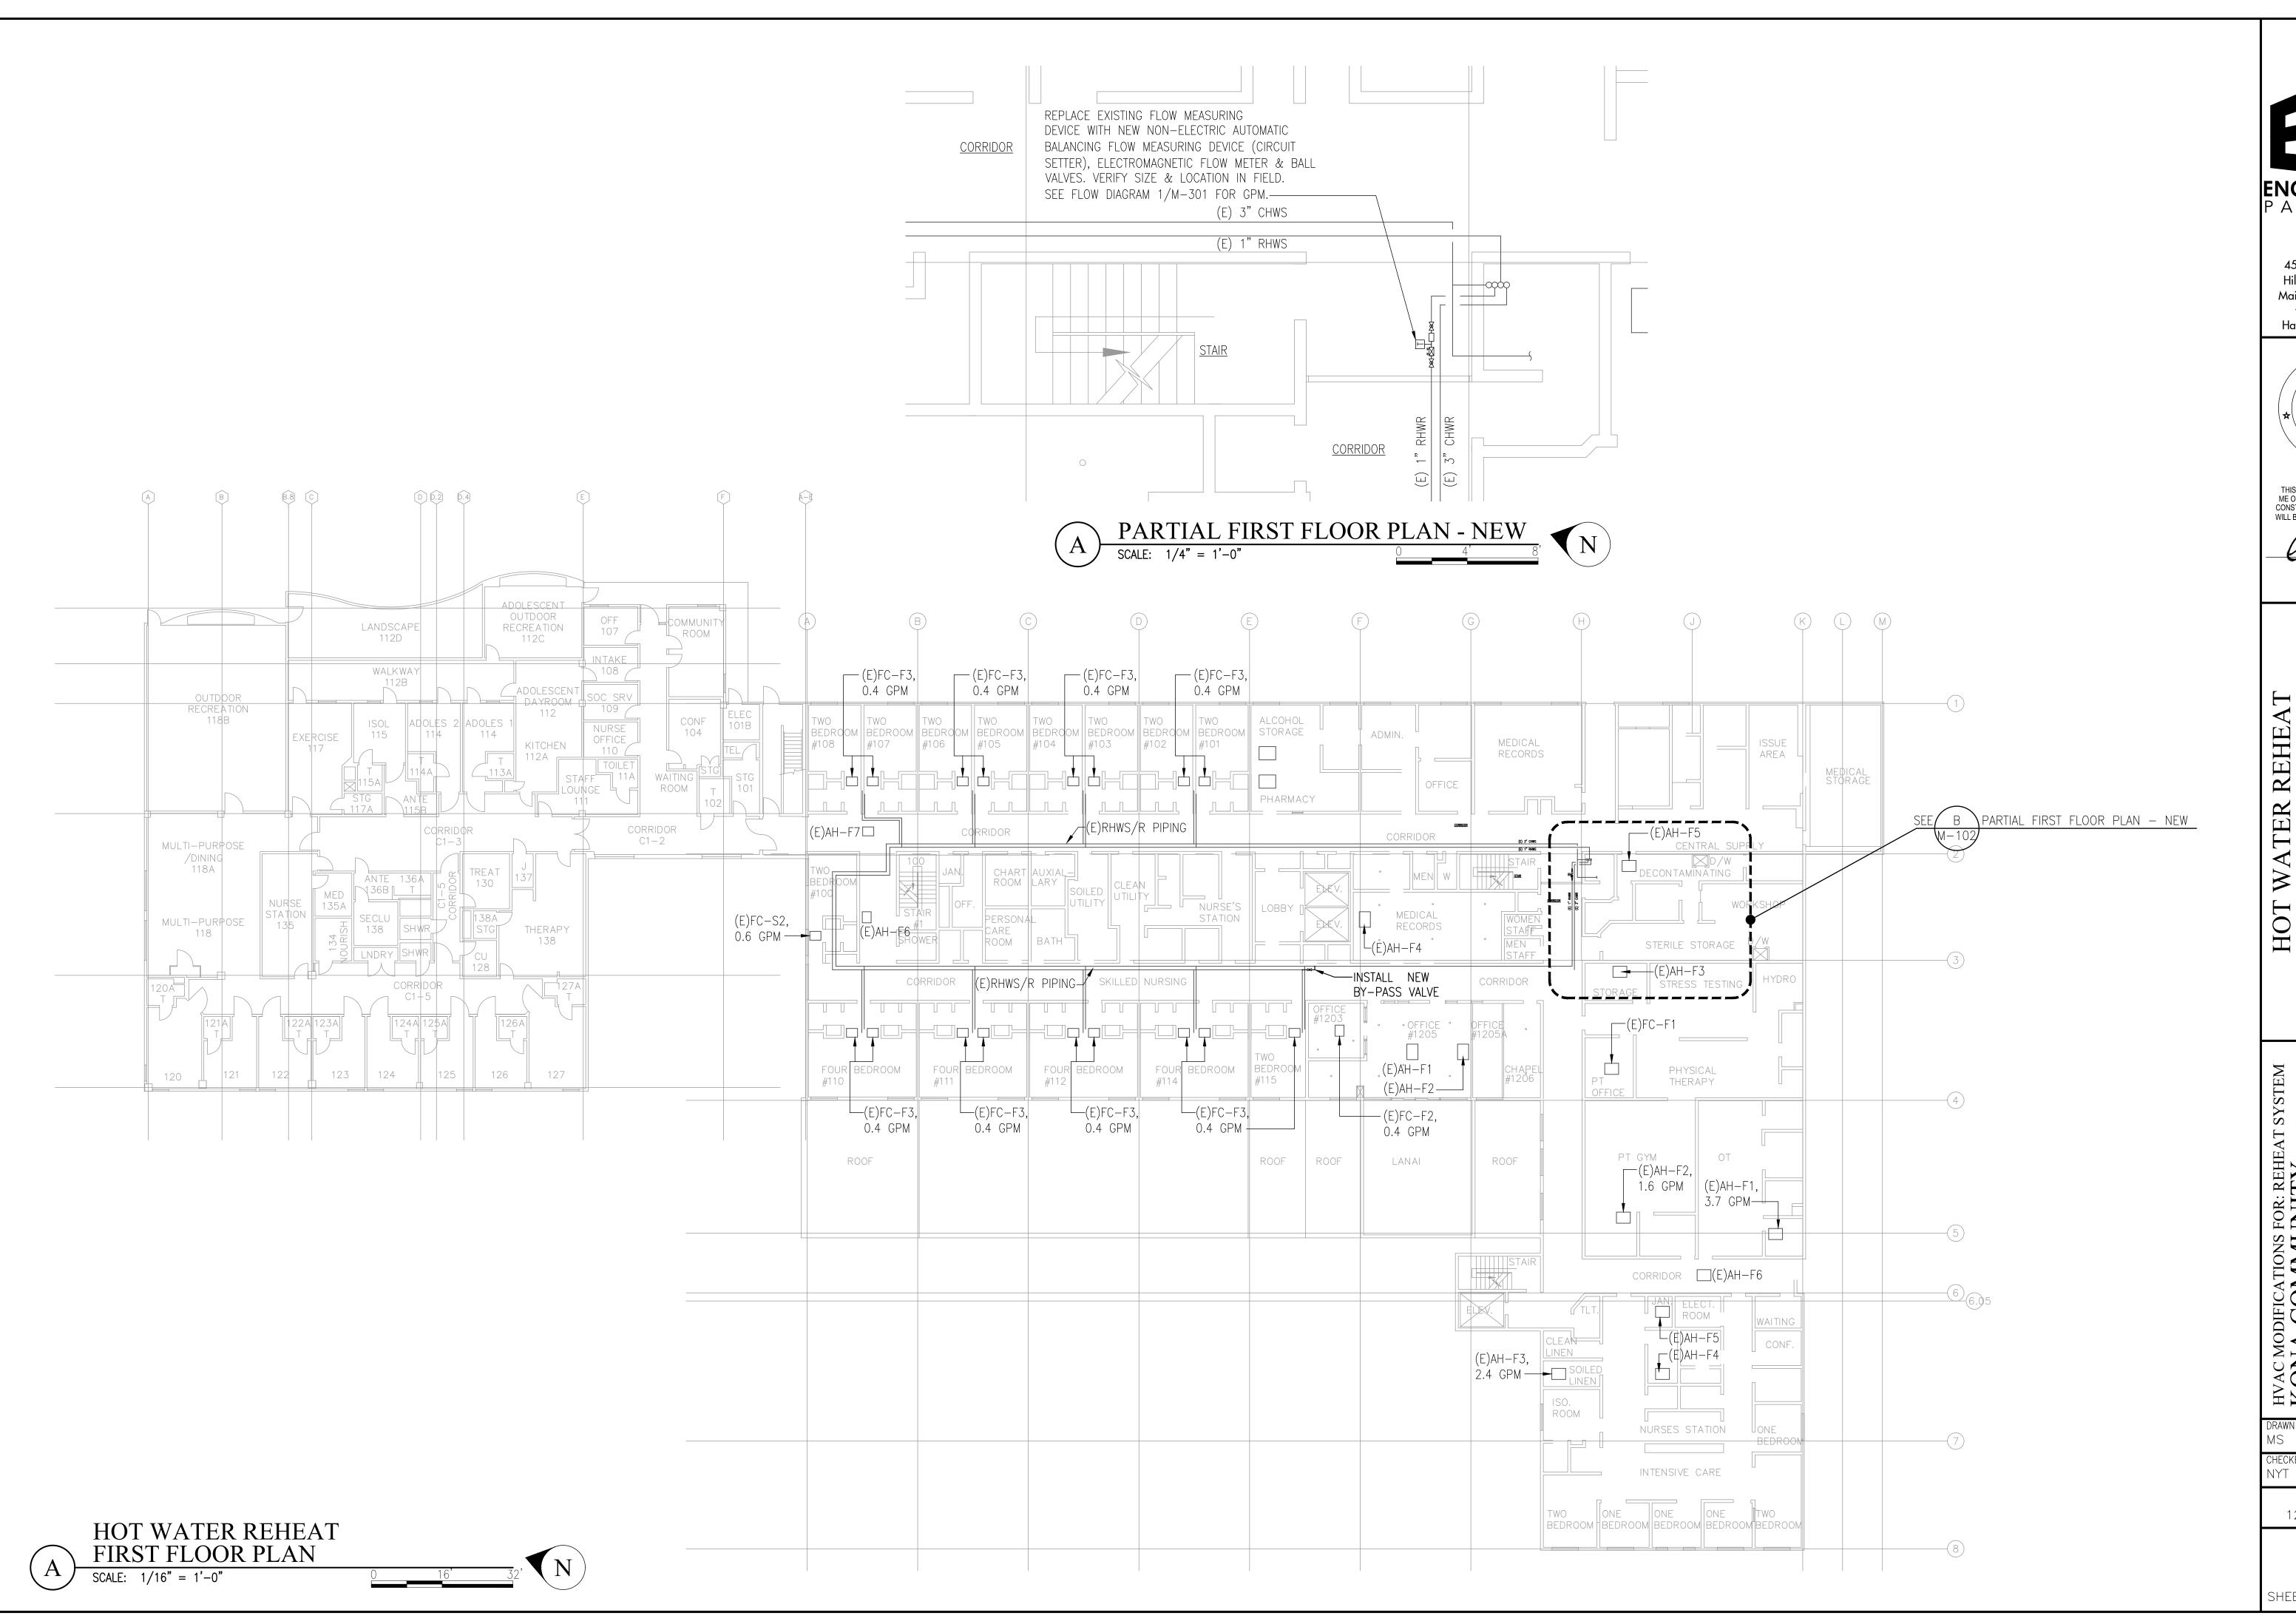

ENGINEERING PARTNERS

455 E. Lanikaula St. Hilo Hawai`i 96720 Main (808) 933-7900 www.epinc.pro Hawai`i | Las Vegas



THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION, CONSTRUCTION OF THIS PROJECT WILL BE UNDER MY OBSERVATION.

ATER REHEAT FLOOR PLAN HOT WAT FIRST FI

HVAC MODIFICATIONS FOR: REHEAT SYSTEM KONA COMMUNITY HOSPITAL


79-1019 HAUKAPILA ST, KEALAKEKUA, HI TMK: (3) 7-9-010:081

CHECKED BY: QC'D BY: JOB NO.

12022-17-01 DWG. NO.

M-102

SHEET NO. 05 OF 1

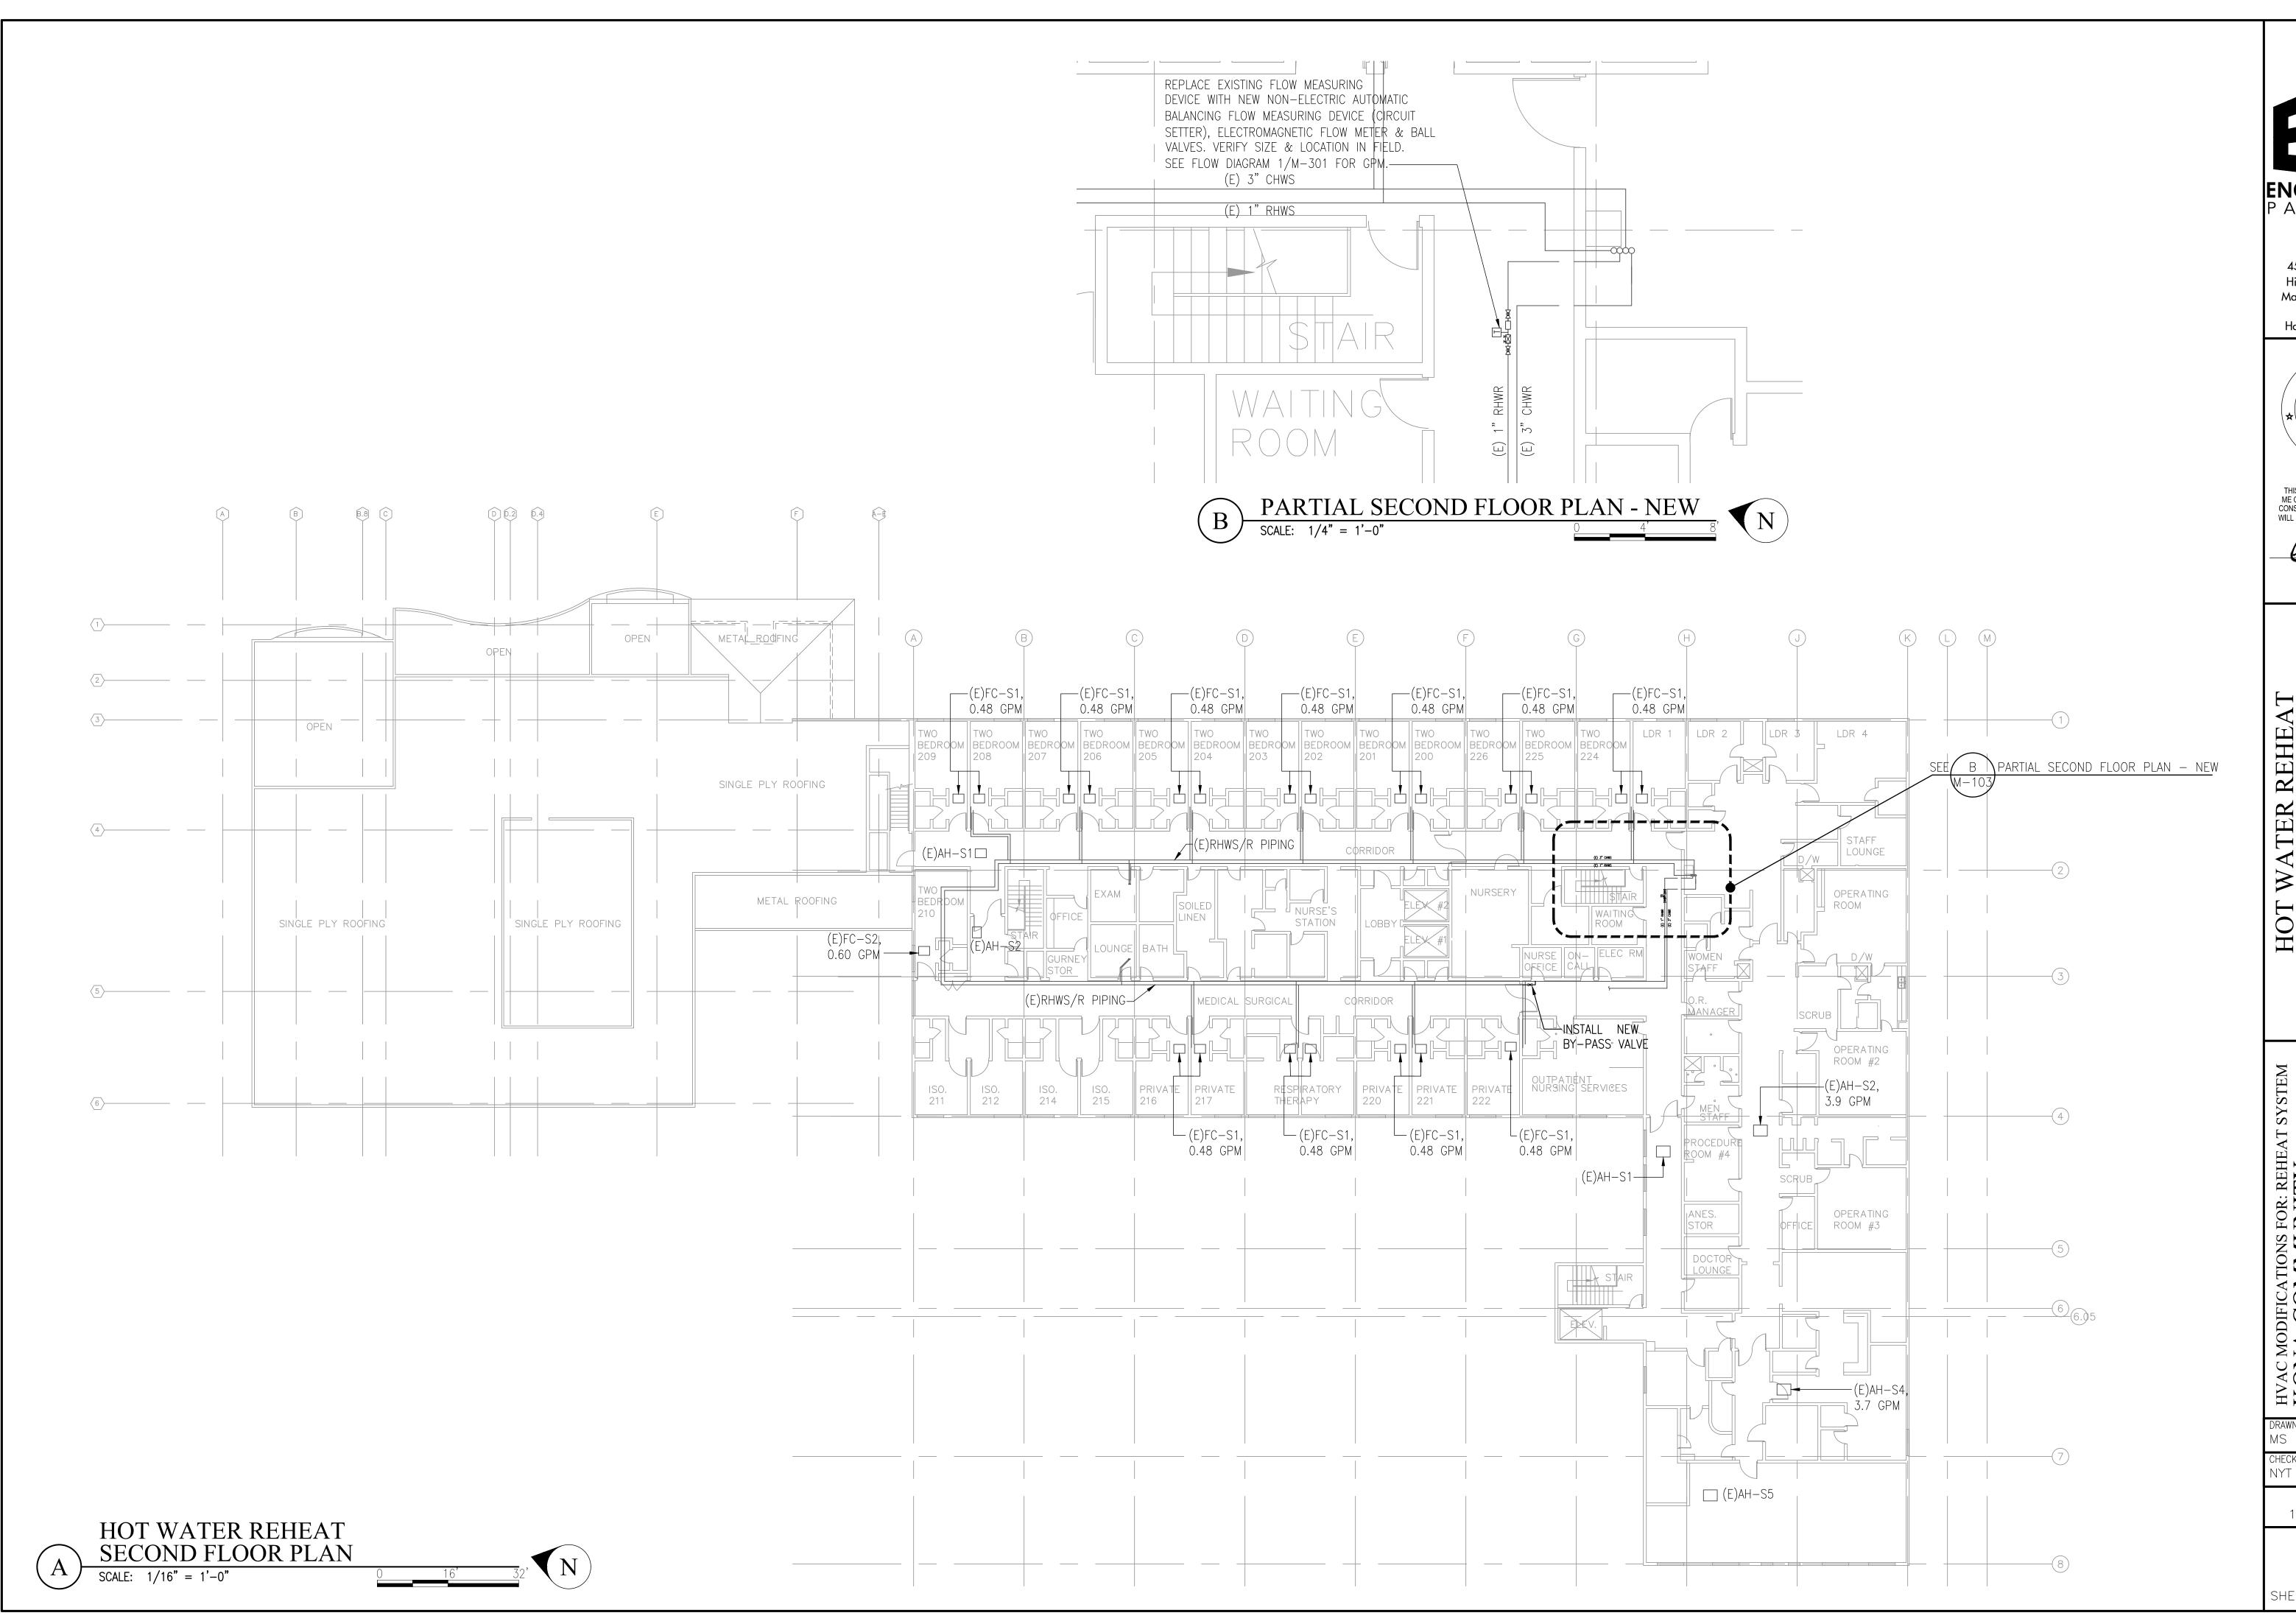



455 E. Lanikaula St. Hilo Hawai`i 96720 Main (808) 933-7900 www.epinc.pro Hawai`i | Las Vegas



THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION, CONSTRUCTION OF THIS PROJECT WILL BE UNDER MY OBSERVATION.

ATER REHEAT FLOOR PLAN


79-1019 HAUKAPILA ST, KEALAKEKUA, HI 96750 TMK: (3) 7-9-010:081 HVAC MODIFICATIONS FOR: REHEAT SYSTEM KONA COMMUNITY HOSPITAL

JOB NO.

12022-17-01

DWG. NO. M-103

SHEET NO. 06 OF 1

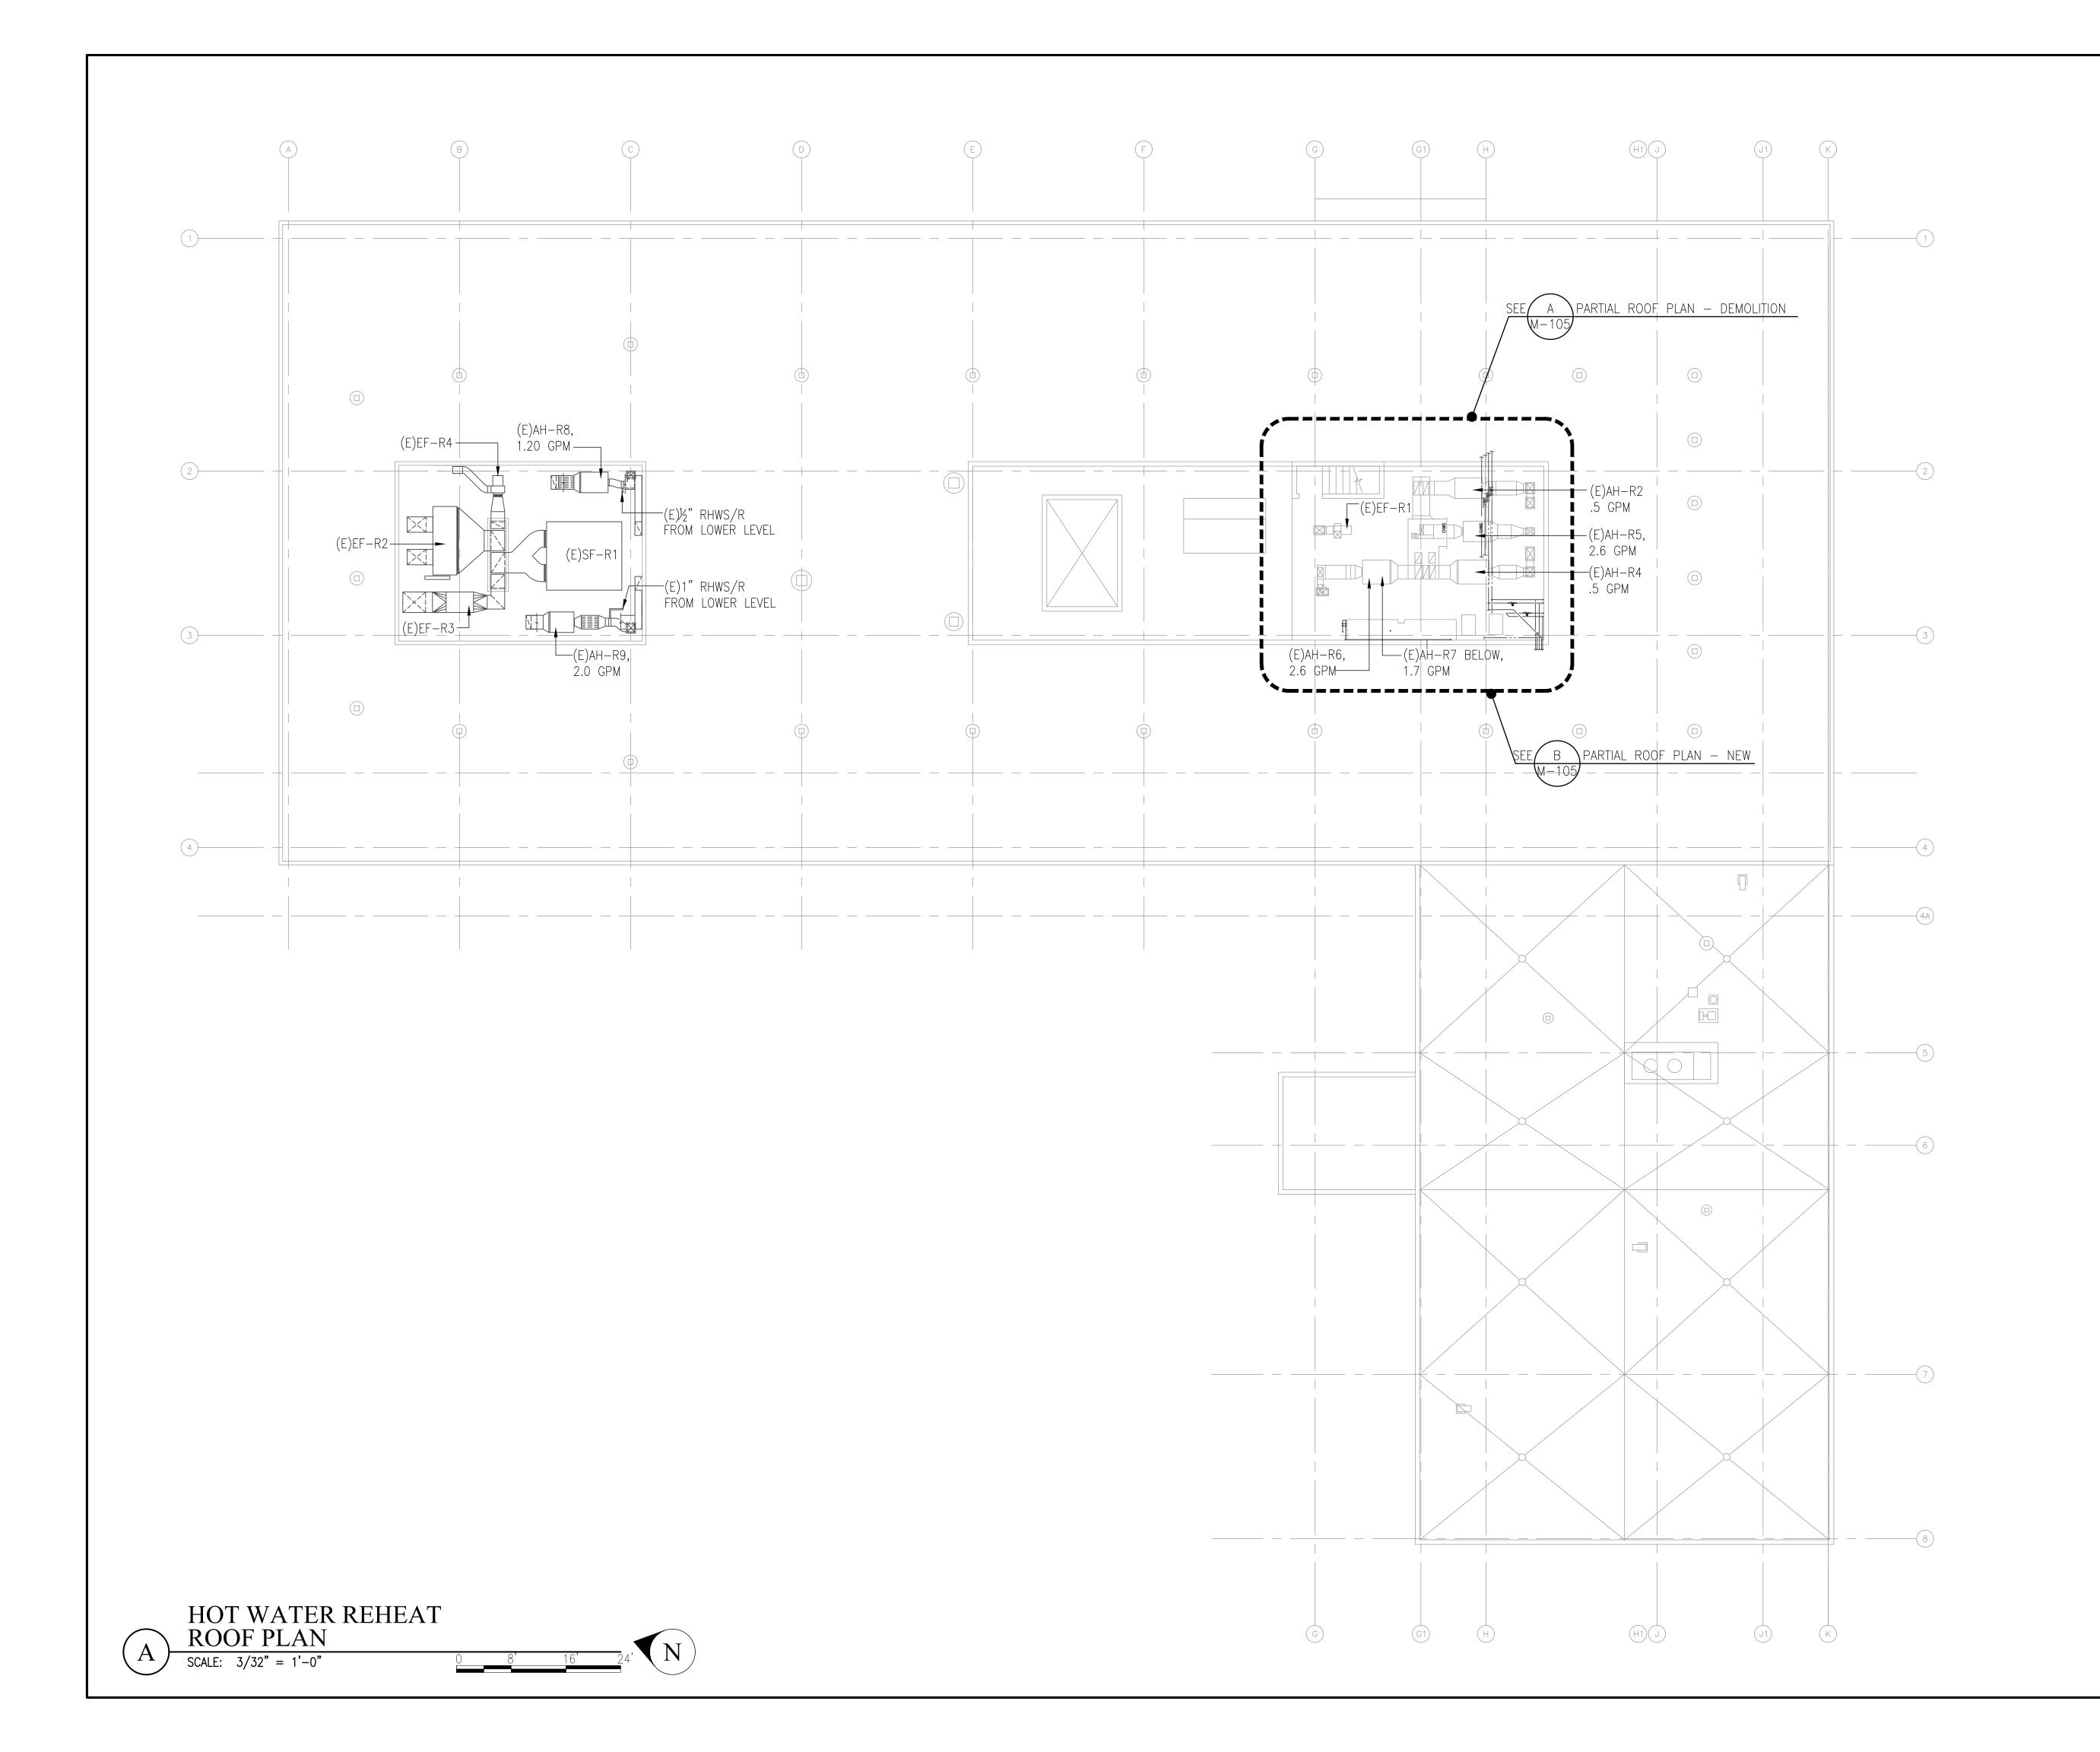



455 E. Lanikaula St. Hilo Hawai`i 96720 Main (808) 933-7900 www.epinc.pro Hawai`i | Las Vegas



THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION, CONSTRUCTION OF THIS PROJECT WILL BE UNDER MY OBSERVATION.

SIGNATURE

HOT WATER REHEAT ROOF PLAN

NS FOR: REHEAT SYSTEM

TUNITY

DATE:

HVAC MODIFICATIO
KONA COMIN
HOSPITAL
79-1019 HAUKAPILA

DRAWN BY: DESIGNED MS

CHECKED BY: QC'D BY: NYT DH

JOB NO. 12022-17-01

DWG. NO. M-104

M-104
SHEET NO. 07 OF 1

### **NOTES** REMOVE EXISTING PUMP AND RELATED PIPING AND VALVES SHOWN HATCHED. ② REMOVE EXISTING STORAGE TANK AND RELATED PIPING AND VALVES SHOWN HATCHED. 3 REMOVE EXISTING CIRCULATING PUMP AND RELATED PIPING AND VALVES SHOWN HATCHED. 4 REMOVE EXISTING WATER HEATERS AND RELATED PIPING AND VALVES AND HEATER FLUE SHOWN HATCHED. PATCH ROOF PENETRATION TO MATCH EXISTING. 5 REMOVE EXISTING HOT WATER SUPPLY AND RETURN PIPING AND VALVES SHOWN HATCHED.



455 E. Lanikaula St. Hilo Hawai`i 96720 Main (808) 933-7900 www.epinc.pro Hawai`i | Las Vegas

6 REMOVE EXISTING GAS LINES SERVING WATER

8 CONNECT NEW 2" RHWS PIPING TO EXISTING 2"

ONNEXT NEW RHWR PIPING TO EXISTING RHWR

CONNECT NEW 2" GAS LINE TO EXISTING 2" GAS

VFD. PROVIDE 36" MIN. CLEARANCE IN FRONT OF THE VFDS. FRANKLIN Q-LINK SERIES ARE NOT

11) PROVIDE NEW FRANKLIN P SERIES OR EATON

PIPING AT AIR SEPARATOR.

REMOVE EXISTING VFDS.

RHWS PIPING.

ACCEPTABLE.

LINE.

HEATERS BACK TO HEADER AND CAP PIPING.



THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION, CONSTRUCTION OF THIS PROJECT

REHEAT PARTIAI N - DEMO/NEW HOT WATER ROOF PLA


HVAC MODIFICATIONS FOR: REHEAT SYSTEM KONA COMMUNITY HOSPITAL


CHECKED BY JOB NO.

12022-17-01 DWG. NO.

M-106

SHEET NO. 08 OF 1

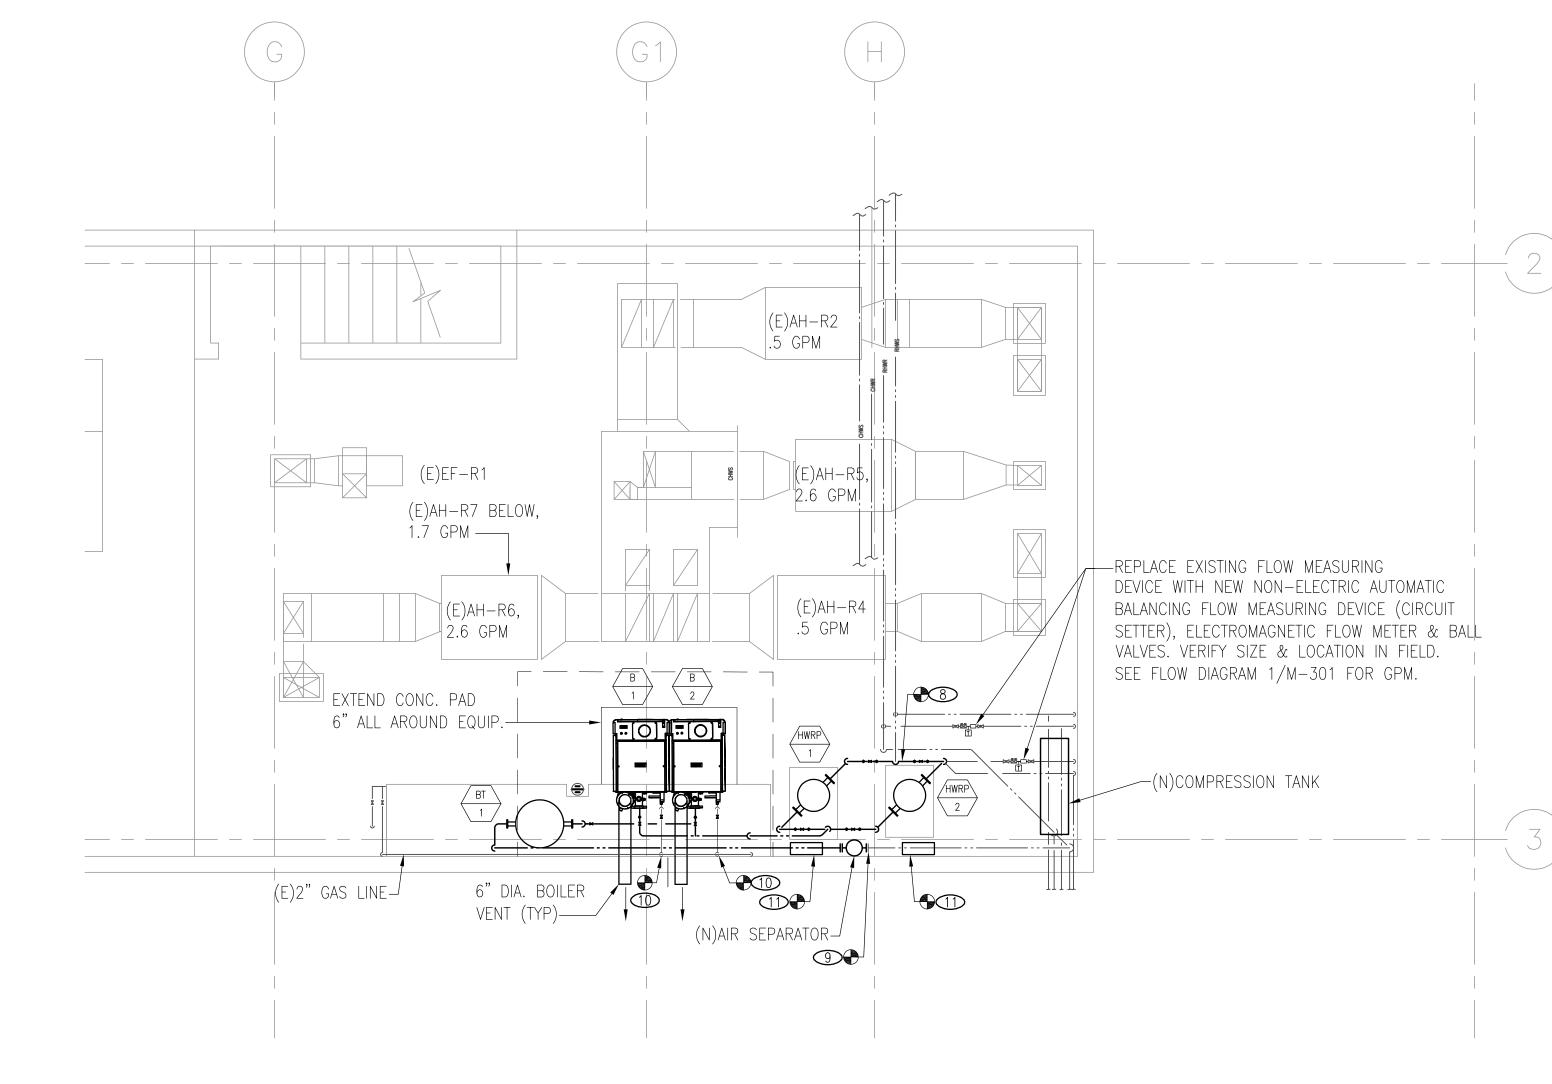

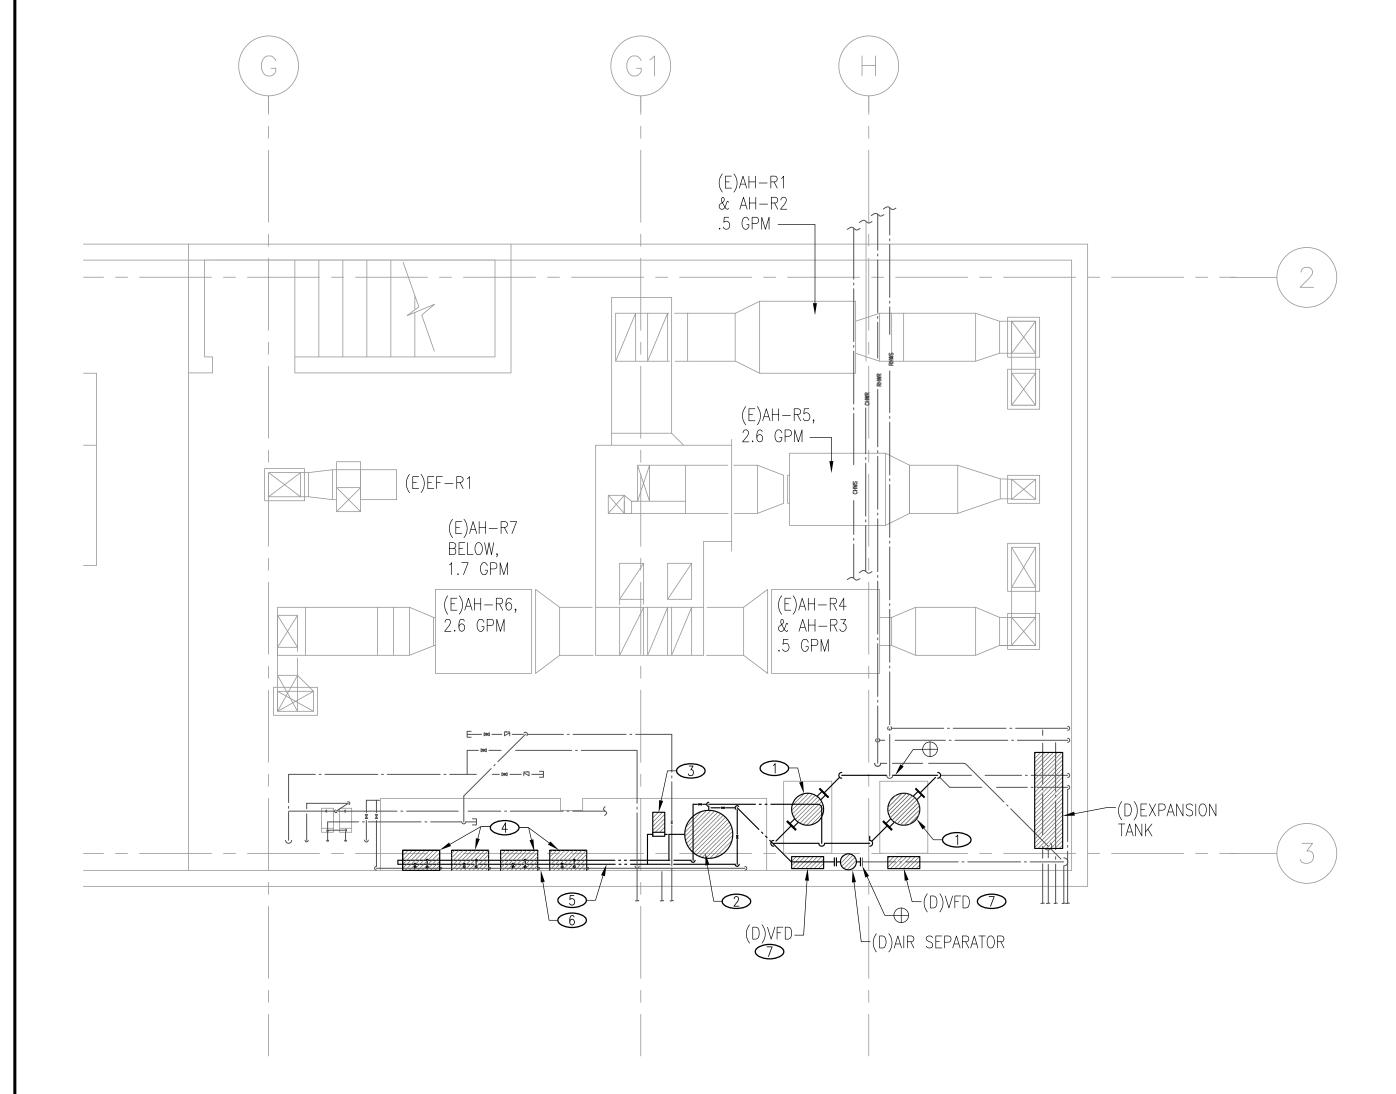




HOT WATER REHEAT
PARTIAL ROOF PLAN - NEW WORK

SCALE: 1/4" = 1'-0"

N

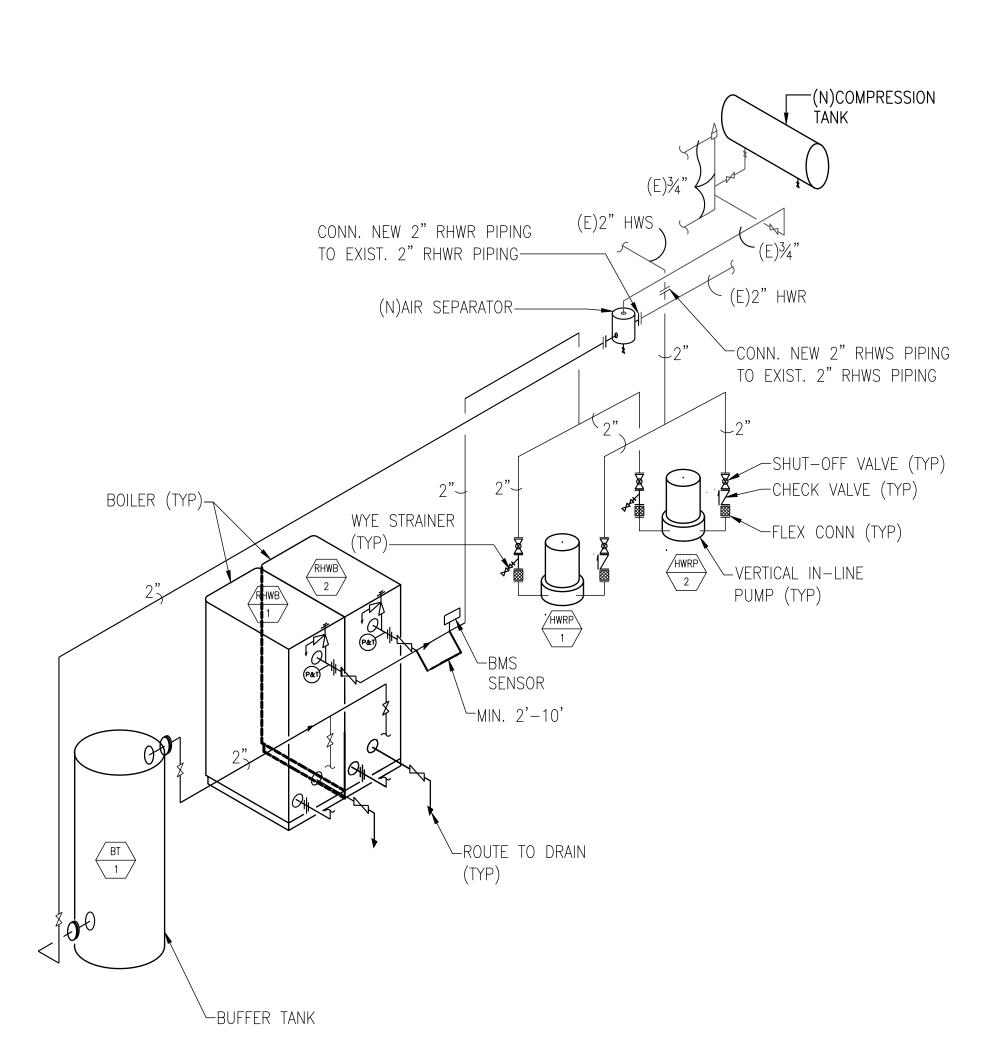



455 E. Lanikaula St. Hilo Hawai`i 96720 Main (808) 933-7900 www.epinc.pro Hawai`i | Las Vegas

LICENSED PROFESSIONAL ENGINEER Exp. 04/30/22 No. 7936-M

THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION, CONSTRUCTION OF THIS PROJECT WILL BE UNDER MY OBSERVATION.

PING PI REHEAT

HVAC MODIFICATIONS FOR: REHEAT SYSTEM KONA COMMUNITY
HOSPITAL

JOB NO. 12022-17-01

DWG. NO.

M-201SHEET NO. 09 OF 15

### SEQUENCE OF OPERATION

### REHEAT HOT WATER (RHW) SYSTEM

THE REHEAT HOT WATER(RHW) SYSTEM CONSISTS OF TWO GAS BOILERS (ONE BEING REDUNDANT) AND TWO REHEAT HOT WATER PUMPS (ONE BEING REDUNDANT) TO SERVE THE AIR HANDLING UNIT AND VAV REHEAT COILS. THE BOILERS ARE FURNISHED WITH A UNIT CONTROL PANEL (UCP) WITH AN INTEGRAL DISPLAY FOR READOUT AND LOCAL OPERATOR'S OVERRIDE CAPABILITY. THE UCP MONITORS ALL CRITICAL FUNCTIONS, AND CONTROLS THE CAPACITY OF THE SYSTEM OUTPUT. THE UCP IS INTERFACED TO THE EXISTING BUILDING MANAGEMENT SYSTEM (BMS) FOR REMOTE MONITORING & SYSTEM CONTROL. REHEAT HOT WATER PUMPS (ONE BEING REDUNDANT) ARE EQUIPPED WITH A VARIABLE FREQUENCY DRIVE (VFD) TO VARY PUMP SPEED.

START-STOP SEQUENCE: UPON START-UP, ENABLE THE RHW PUMPING SYSTEM AND BOILERS. UPON SHUTDOWN, DISABLE ALL RHW PUMPING SYSTEMS AND DISABLE BOILERS. THIS SEQUENCE SHALL BE FUNCTIONAL FOR ANY REASON THE PUMP STARTS-STOPS IN ANY MODE OF OPERATION (ALL H-O-A MODES, ALL VFD MODES, ALL AUTOMATIC AND SAFETY FUNCTIONS, AND LOCAL MANUAL START-STOP).

### PUMP CONTROL (LEAD/STANDBY EACH PUMP SIZED AT 100%):

1. ONCE ENABLED THE PUMP SPEED SHALL BE MODULATED TO MAINTAIN THE CALCULATED DIFFERENTIAL PRESSURE SETPOINT.

- 2. SOFTWARE LEAD/STANDBY PUMP CONTROL FUNCTION SHALL ALLOW EITHER OF THE RHW WATER PUMPS TO ACT AS THE LEAD PUMP, WHILE DESIGNATING THE OTHER PUMP AS A STANDBY PUMP. 3. <u>DIFFERENTIAL PRESSURE RESET CONTROL</u>: THE BAS SHALL CONTINUOUSLY POLL THE VALVE POSITION OF ALL REHEAT HOT WATER COILS. THE BAS SHALL RESET DIFFERENTIAL PRESSURE SET—POINT UP OR DOWN TO CONTINUALLY RESET THE SYSTEM DIFFERENTIAL PRESSURE SETPOINT FOR OPTIMUM PERFORMANCE. WHEN TWO REMOTE DIFFERENTIAL PRESSURE SENSORS ARE USED, CONTROL TO THE SENSOR
- 4. IN THE EVENT REMOTE DIFFERENTIAL PRESSURE SENSORS BECOME UNRELIABLE, UTILIZE LOCAL DIFFERENTIAL PRESSURE FOR PUMP CONTROL TAKING INTO CONSIDERATION THE ADJUSTED SETPOINT
- 5. ALARM ON PUMP FAILURE DETECTED VIA CURRENT SENSING SWITCH. UPON FAILURE OF THE LEAD PUMP, THE STANDBY PUMP SHALL START AUTOMATICALLY. THE BAS SHALL MAINTAIN A START COMMAND AT THE LEAD PUMP AND RESUME CONTROL WHEN THE LEAD PUMP HAS RETURNED TO NORMAL OPERATION.
- 6. A FAILURE OF ANY PUMP WILL SHUT DOWN THAT PUMP, SUSPEND BOILER OPERATION, START THE ASSOCIATED STAND-BY PUMPS WILL ALARM THE BMS. FAILURE OF BOTH HEATING WATER PUMPS WILL
- ALARM THE BMS AND SHUT DOWN THE REHEAT HOT WATER SYSTEM.
- 7. LEAD PUMP DESIGNATION SHALL BE ROTATED WEEKLY (ADJ) IN ACCORDANCE WITH THE BAS SCHEDULE. 8. IF BYPASS FAILS TO OPEN AND SYSTEM PRESSURE INCREASES BEYOND AN ADJUSTABLE LIMIT, RECIRCULATION PUMPS SHALL SHUT DOWN AND AN ALARM SHALL BE ISSUED TO THE BMS.

### PUMP ROTATION: UPON SIGNAL FROM THE BAS TO ROTATE THE PUMPS, EXECUTE THE FOLLOWING SEQUENCE.

- 1. INITIATE ROTATION IN ACCORDANCE WITH A BAS SCHEDULE OR BY MANUAL INITIATION. 2. WHILE THE CURRENT LEAD PUMP IS STILL ACTIVE START THE STANDBY PUMP AND DESIGNATE AS THE NEW LEAD PUMP.
- 3. UPON PROOF OF NEW STANDBY PUMP RUNNING STATUS VIA CURRENT SENSING RELAY, COMMAND THE NEWLY DESIGNATED STANDBY PUMP TO OFF AND CLOSE ASSOCIATED ISOLATION VALVES.
- 4. MAINTAIN DIFFERENTIAL PRESSURE CONTROL WITH THE NEW LEAD PUMP.


### BOILER CONTROL (LEAD/STANDBY EACH PUMP SIZED AT 100%): UPON SIGNAL FROM THE BAS TO RUN THE BOILER SYSTEM SHALL START.

- THE BAS SHALL SEND AN ENABLE COMMAND TO THE BOILER CONTROL SYSTEM.
- THE BOILER CONTROL SYSTEM SHALL DETERMINE THE OPTIMUM RUN CONDITION OF ALL BOILERS AND MAINTAIN THE HEATING HOT WATER SUPPLY TEMPERATURE SETPOINT, 140 DEG F (ADJ.)
- 3. BOILER ISOLATION VALVES SHALL BE INTERLOCKED WITH THE BOILER TO OPEN ONLY WHEN THE BOILER IS ACTIVE.
- 4. THE ACTIVE BOILER SHALL HAVE A MINIMUM RUN TIME OF 15 MINUTES (ADJ.).

|   |                |                 | I                | DD                | C P               | OII                   | NT                          | LIS                         | ST                       |                          |                            |            |                       |            |                 |          |                 |       |  |  |
|---|----------------|-----------------|------------------|-------------------|-------------------|-----------------------|-----------------------------|-----------------------------|--------------------------|--------------------------|----------------------------|------------|-----------------------|------------|-----------------|----------|-----------------|-------|--|--|
|   |                | INPUTS          |                  |                   |                   |                       |                             |                             |                          |                          |                            |            |                       | OUTPUTS    |                 |          | CVCTEM FEATURES |       |  |  |
|   |                | ANALOG DIGITAL  |                  |                   |                   |                       |                             |                             |                          |                          |                            |            | ANALOG                | 5 Y        | SYSTEM FEATURES |          |                 |       |  |  |
|   | 4-20mA H20     | 4-20mA H20      | Ļ                | CPM               | ĻĻ.               | Ļ                     | Ļ                           | Ļ.                          | PERCENT OPEN             | 4-20mA H20               | ON/OFF                     | ON/OFF     | PERCENT               | START/STOP |                 |          |                 |       |  |  |
|   | INLET PRESSURE | OUTLET PRESSURE | TANK TEMPERATURE | REHEAT WATER FLOW | INLET TEMPERATURE | OUTLET<br>TEMPERATURE | REHEAT WATER<br>SUPPLY TEMP | REHEAT WATER<br>RETURN TEMP | BYPASS VALVE<br>POSITION | DIFFERENTIAL<br>PRESSURE | SHUT OFF VALVE<br>POSITION | RUN STATUS | PUMP SPEED<br>CONTROL | START/STOP | VFD CONTROL     | SCHEDULE | TREND           | ALARM |  |  |
| EQUIPMENT LIST:                             |                |                 |                  |                   |                   |                       |                             |                             |                          |                          |                            |            |                       |            |                 |          |                 |       |  |  |
| REMOTE DIFFERENTIAL PRESSURE SENSOR         |                |                 |                  |                   |                   |                       |                             |                             |                          | X                        |                            |            |                       |            |                 |          | X               | X     |  |  |
| MOTORIZED BYPASS VALVES (TYP.)              |                |                 |                  |                   |                   |                       |                             |                             | Χ                        |                          |                            | Χ          |                       |            |                 |          | Χ               | Χ     |  |  |
| MOTORIZED ISOLATION VALVES (TYP.)           |                |                 |                  |                   |                   |                       |                             |                             |                          |                          | X                          | Χ          |                       |            |                 |          |                 | Χ     |  |  |
| P-1,2                                       | Χ              | X               |                  | X                 |                   |                       | Χ                           | X                           |                          |                          |                            | Χ          | X                     | X          | Χ               | X        | Χ               | X     |  |  |
| B-1,2                                       |                |                 |                  | V                 | X                 | X                     | X                           | X                           |                          |                          |                            | Χ          |                       | X          |                 | X        | X               | X     |  |  |
| REHEAT HOT WATER SUPPLY TEMPERATURE SENSORS |                |                 |                  | X                 |                   |                       | X                           |                             |                          |                          |                            |            |                       |            |                 |          | X               | X     |  |  |
| REHEAT HOT WATER RETURN TEMPERATURE SENSORS |                |                 |                  |                   |                   |                       |                             | X                           |                          |                          |                            |            |                       |            |                 |          | X               | X     |  |  |
| BUFFER TANK                                 |                |                 | X                |                   | X                 | X                     |                             |                             |                          |                          |                            |            |                       |            |                 |          | Χ               | X     |  |  |


### NOTES

- 1. ALL POINTS TO SHOW ON EXISTING DELTA BMS GRAPHICS.
- 2. ALL CONTROL WIRING SHALL BE INSTALLED AS SPECIFIED BY MFR (TYP.).
- 3. ALL CONTROL WIRING SHALL BE INSTALLED IN EMT/FMC (TYP.).

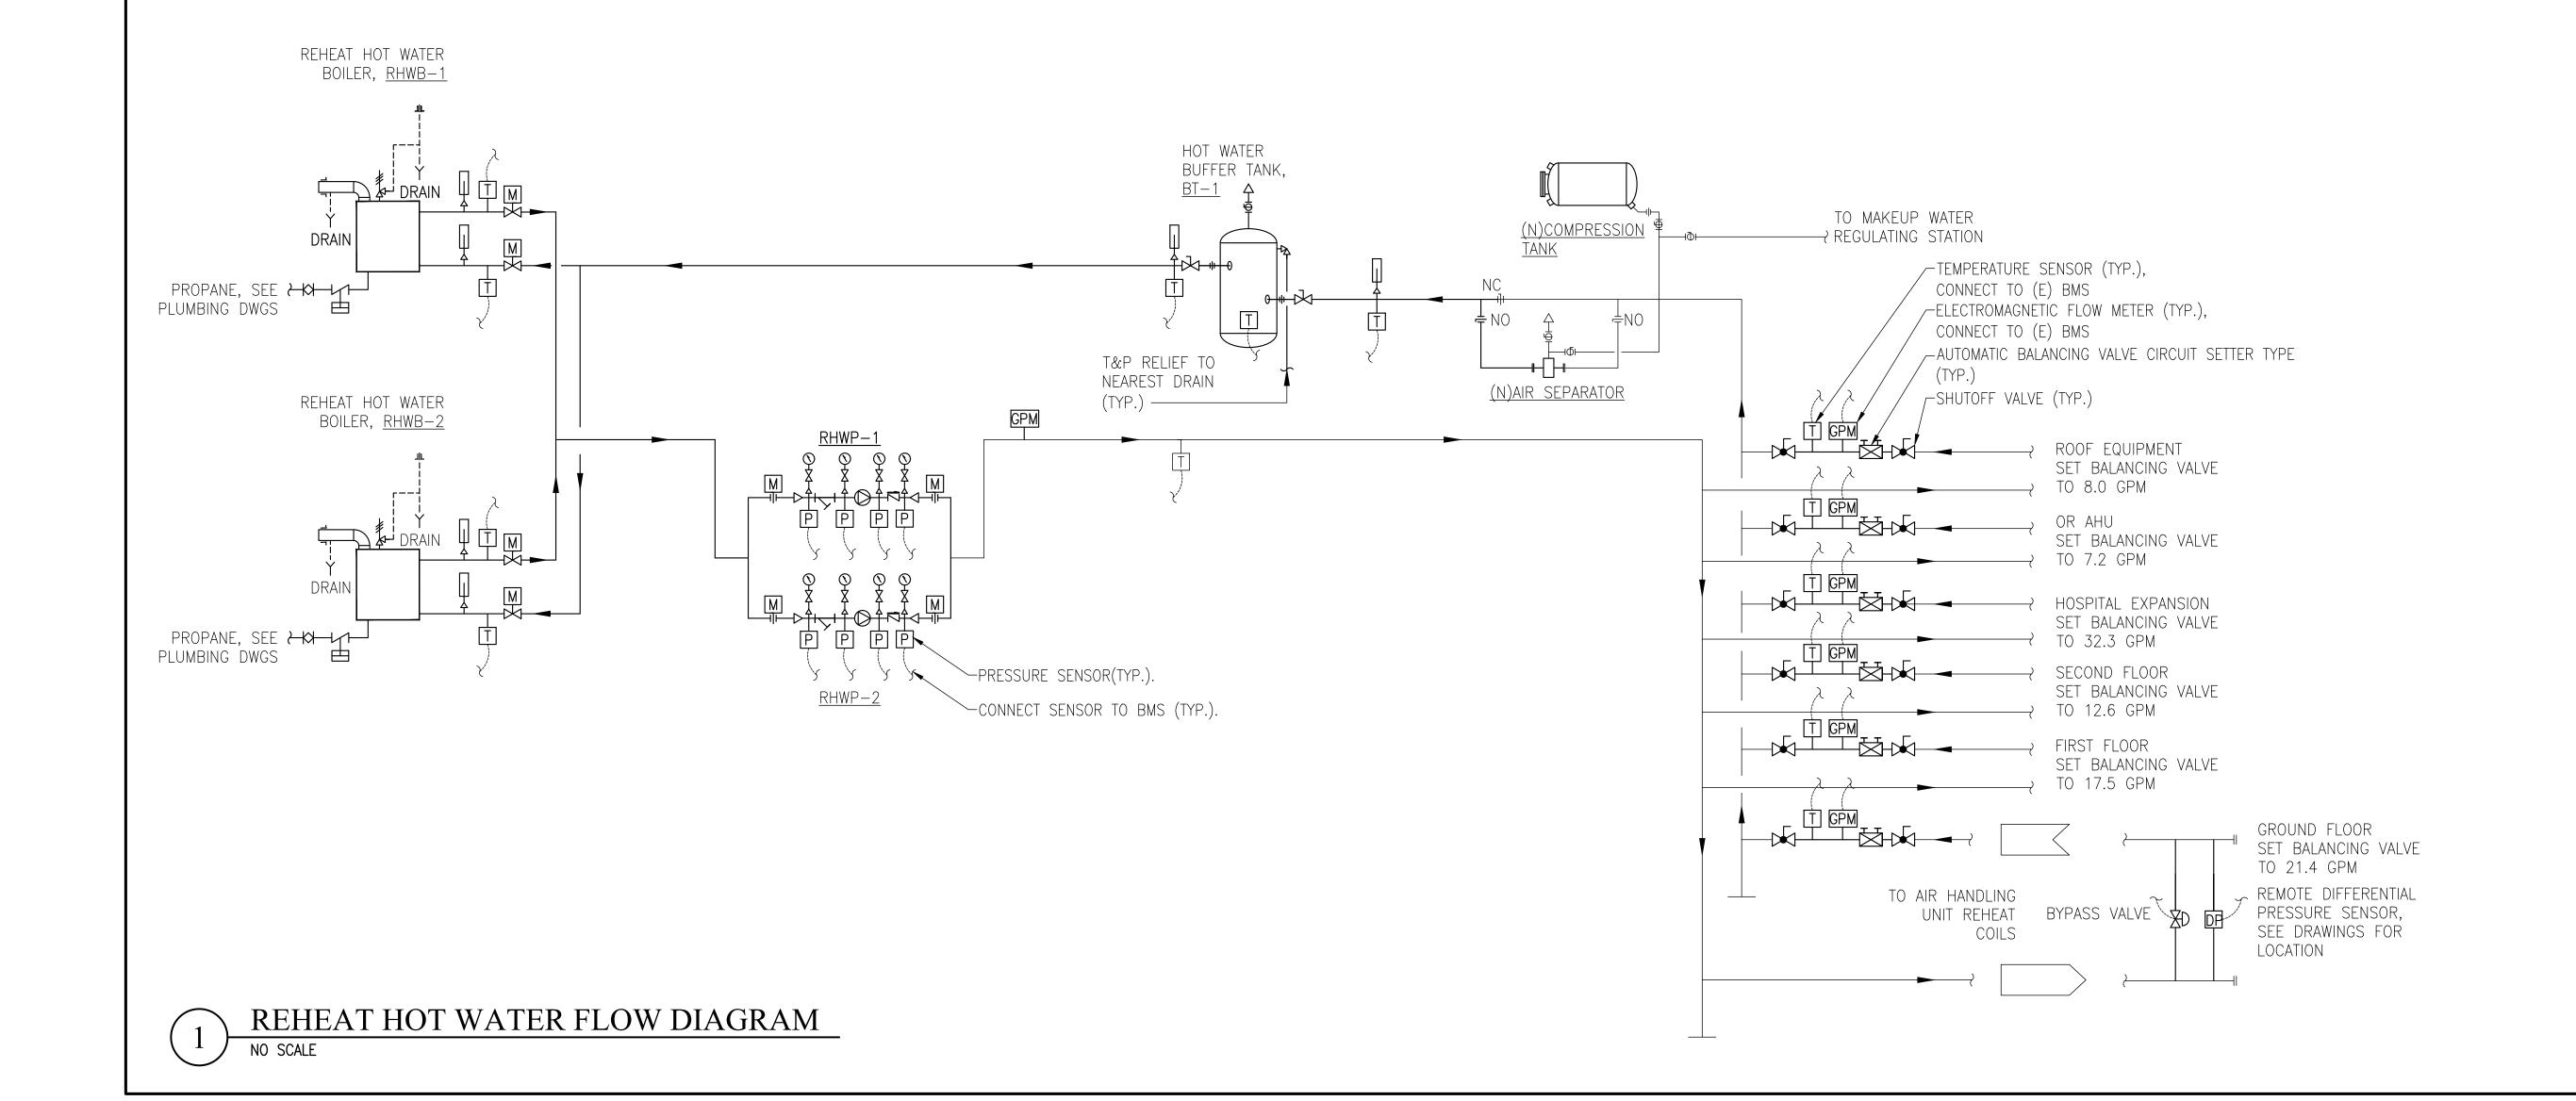



455 E. Lanikaula St. Hilo Hawai`i 96720 Main (808) 933-7900 www.epinc.pro Hawai`i | Las Vegas



ME OR UNDER MY SUPERVISION, CONSTRUCTION OF THIS PROJECT


OPER/OINTS SEQUENCE OF (DDC PC

HVAC MODIFICATIONS FOR: REHEAT SYSTEM KONA COMMUNITY HOSPITAL

CHECKED BY: QC'D BY: JOB NO.

12022-17-01 DWG. NO.

M-301SHEET NO. 10 OF 1

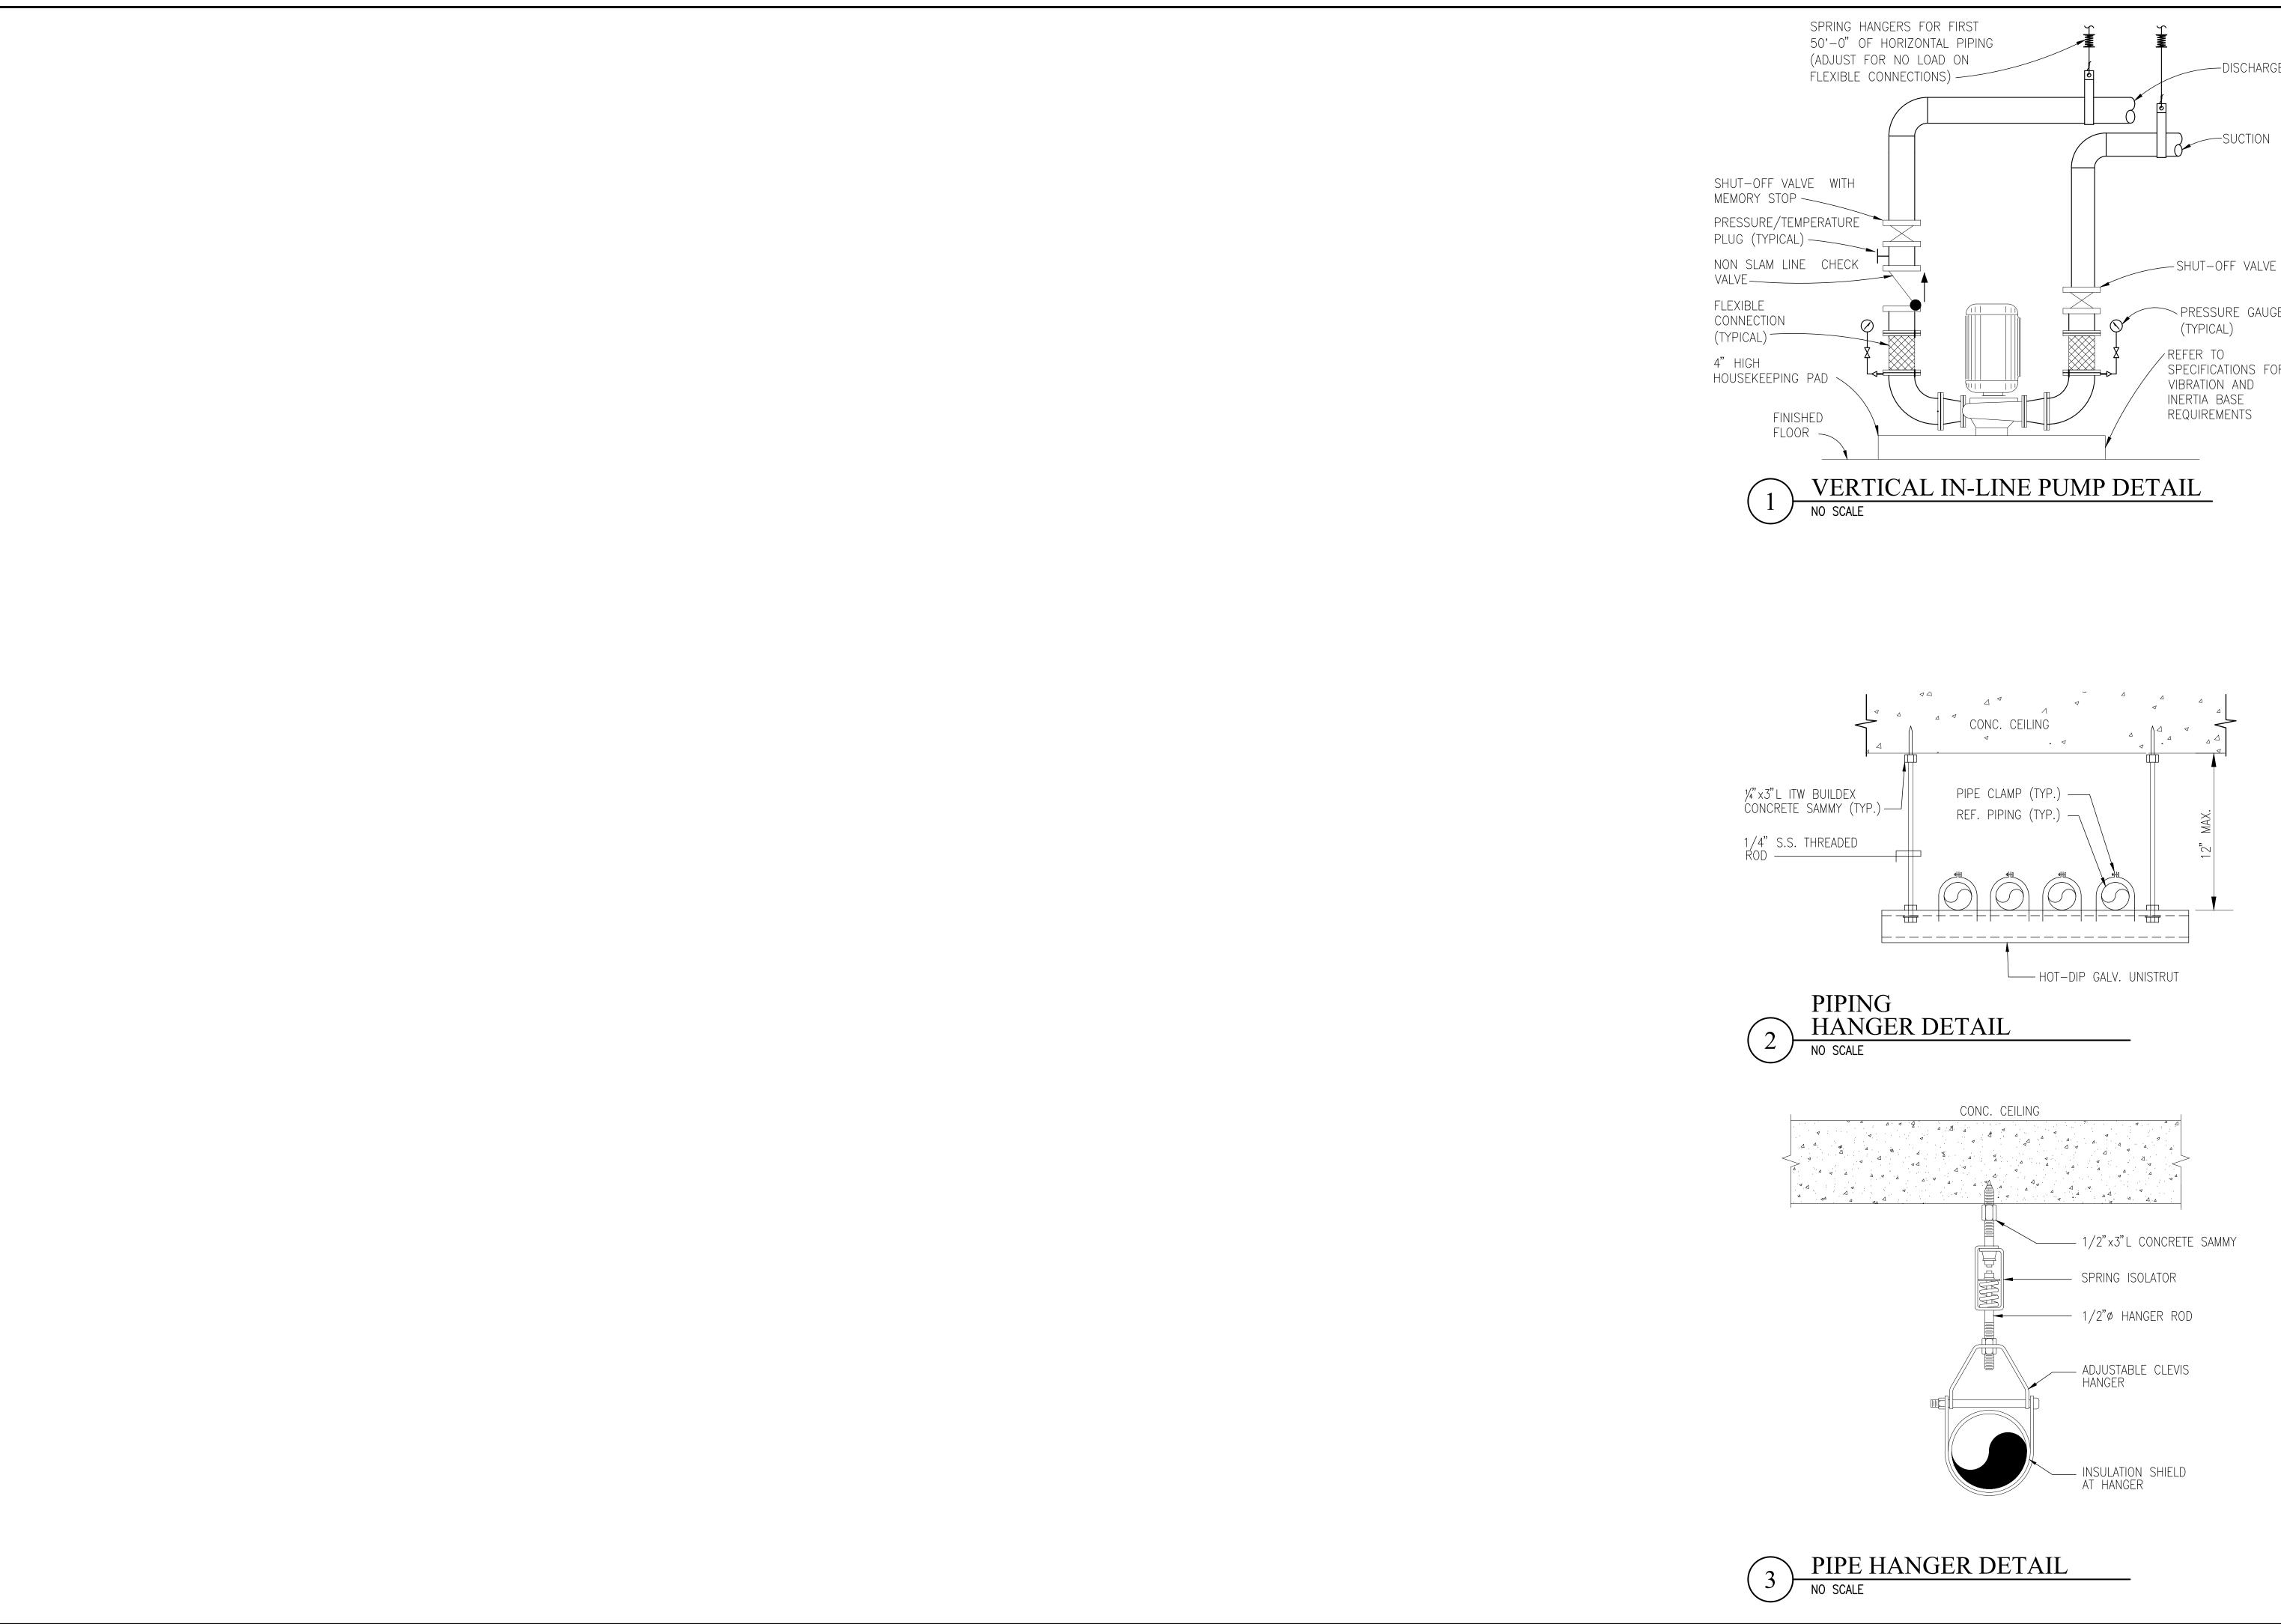

SUCTION

ENGINEERING
PARTNERS

455 E. Lanikaula St.
Hilo Hawai`i 96720
Main (808) 933-7900
www.epinc.pro
Hawai`i | Las Vegas

LICENSED PROFESSIONAL ENGINEER Exp. 04/30/22 No. 7936-M

THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION, CONSTRUCTION OF THIS PROJECT WILL BE UNDER MY OBSERVATION.

SIGNATURE

DET

HVAC MODIFICATIONS FOR: REHEAT SYSTEM

KONA COMMUNITY

HOSPITAL

79-1019 HAUKAPILA ST, KEALAKEKUA, HI 96750

TMK: (3) 7-9-010:081

REV. A

REV. A

REV. A

REV. A

CHECKED BY: QC'D BY:

JOB NO. 12022-17-01

DWG. NO.


M-401

SHEET NO. 11 OF 1

### GENERAL ELECTRICAL **SPECIFICATIONS**

- 1. DO NOT SCALE DRAWINGS. VERIFY DIMENSIONS IN FIELD PRIOR TO COMMENCEMENT OF WORK.
- 2. THE ELECTRICAL DRAWINGS ARE DIAGRAMMATIC IN NATURE. INSTALL CONDUIT RUNS AS SPECIFIED WITH SCHEMATIC REPRESENTATION INDICATED ON THE DRAWINGS AND AS SPECIFIED.
- WHERE CONDUITS ARE SHOWN AS "HOME RUNS" ON THE CONTRACT DRAWINGS, OR STATED TO BE FURNISHED, BUT NOT EXPLICITLY SHOWN AS PART OF THE SCOPE OF WORK, THE CONTRACTOR SHALL PROVIDE ALL CONDUITS, FITTINGS, BOXES, WIRING, CONDUIT SEALS, ETC., AS REQUIRED FOR COMPLETION OF THE RACEWAY SYSTEM IN COMPLIANCE WITH THE NEC AND THE CONTRACT DOCUMENTS.
- 4. MODIFY CONDUIT RUNS TO SUIT FIELD CONDITIONS, AS ACCEPTED BY THE OWNER'S REPRESENTATIVE.
- 5. FINAL CONNECTIONS & ROUGH-IN REQUIREMENTS TO EQUIPMENT SHALL BE PER MANUFACTURER'S APPROVED WIRING DIAGRAMS, DETAILS AND INSTRUCTIONS. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO PROVIDE MATERIALS AND EQUIPMENT COMPATIBLE WITH EQUIPMENT ACTUALLY SUPPLIED.
- 6. CONTRACTOR SHALL REVIEW ARCHITECTURAL, STRUCTURAL, MECHANICAL AND OTHER DRAWINGS PRIOR TO
- 7. CONTRACTOR SHALL VISIT SITE PRIOR TO BID AND VERIFY THAT CONDITIONS ARE AS INDICATED. CONTRACTOR SHALL REPORT DISCREPANCIES TO THE ARCHITECT AND INCLUDE IN ITS BID ALL COSTS REQUIRED TO MAKE HIS WORK MEET EXISTING CONDITIONS.
- 8. WORK SHALL BE PERFORMED IN A WORKMANLIKE MANNER TO THE SATISFACTION OF THE OWNER'S REPRESENTATIVE.
- 9. WORK, MATERIALS AND EQUIPMENT SHALL CONFORM TO THE LATEST EDITIONS OF LOCAL, STATE AND NATIONAL CODES AND ORDINANCES.
- 10. ALL ELECTRICAL SYSTEMS COMPONENTS SHALL BE LISTED OR LABELED BY U.L. OR OTHER RECOGNIZED TESTING FACILITY.
- 11. PROVIDE PERMITS AND INSPECTIONS REQUIRED.
- 12. GUARANTEE THE INSTALLATION AGAINST DEFECTS IN MATERIALS AND WORKMANSHIP WHICH MAY OCCUR UNDER NORMAL USAGE FOR A PERIOD OF ONE YEAR AFTER OWNER'S ACCEPTANCE. DEFECTS SHALL BE PROMPTLY REMEDIED WITHOUT COST TO THE OWNER.
- 13. PROVIDE RECORD DRAWINGS TO THE OWNER'S REPRESENTATIVE. DRAWINGS SHALL INCLUDE ALL ADDENDUM ITEMS, CHANGE ORDERS, ALTERATIONS, REROUTINGS, ETC.
- 14. VERIFY EXACT LOCATION AND ELECTRICAL CHARACTERISTICS OF EQUIPMENT TO BE FURNISHED BY OTHER DISCIPLINES PRIOR TO ROUGH-IN.
- 15. SYSTEMS SHALL BE TESTED FOR PROPER OPERATION. IF TESTS SHOW THAT WORK IS DEFECTIVE, CONTRACTOR SHALL MAKE CORRECTIONS NECESSARY AT NO COST TO OWNER.
- 16. CONTRACTOR SHALL BE RESPONSIBLE FOR REPLACING EQUIPMENT WHICH IS DAMAGED DUE TO INCORRECT FIELD WIRING PROVIDED UNDER THIS SECTION OR FACTORY WIRING IN EQUIPMENT PROVIDED UNDER THIS SECTION.
- 17. CONTRACTOR'S FAILURE TO ORDER OR RELEASE ORDER FOR MATERIALS AND/OR EQUIPMENT WILL NOT BE ACCEPTED AS A REASON TO SUBSTITUTE ALTERNATE MATERIALS OR EQUIPMENT.
- 18. SYSTEMS SHALL BE COMPLETE, OPERABLE AND READY FOR CONTINUOUS OPERATION. LIGHTS, SWITCHES, RECEPTACLES, MOTORS, ETC., SHALL BE CONNECTED AND OPERABLE.
- 19. PRESENT SUBMITTAL DATA AT ONE TIME BOUND IN PDF FORMAT OR PER THE OWNER'S REQUIREMENTS. SUBMITTALS SHALL BE INDEXED IN A NEAT AND ORDERLY MANNER. PARTIAL SUBMITTALS WILL NOT BE ACCEPTED. SUBMITTALS SHALL INCLUDE ALL EQUIPMENT SPECIFIED UNDER THIS PROJECT. SHOULD CONTRACTOR FAIL TO PROVIDE SUBMITTALS, CONTRACTOR PROCEEDS AT ITS OWN RISK AND ANY COST FOR CORRECTIVE WORK WILL BE BORNE BY THE CONTRACTOR.
- 20. PENETRATIONS OF FIRE RATED WALLS OR FLOORS BY PIPE SHALL BE SEALED BY A FIRESTOPPING SYSTEM UL LISTED FOR THE APPLICATION. INSTALL PENETRATION SEAL MATERIALS IN ACCORDANCE WITH PRINTED INSTRUCTIONS OF THE UL FIRE RESISTANCE DIRECTORY AND MANUFACTURERS INSTRUCTIONS. FIRESTOPPING SYSTEM SHALL BE EQUAL TO 3M FIRE BARRIER. FIRESTOPPING MATERIAL SHALL BE CAULK OR PUTTY TYPE. FIRESTOP ALL PENETRATIONS THROUGH FIRE RATED WALLS AS REQUIRED TO PRESERVE THE FIRE RATING OF THE STRUCTURE.

### ELECTRICAL SYMBOLS

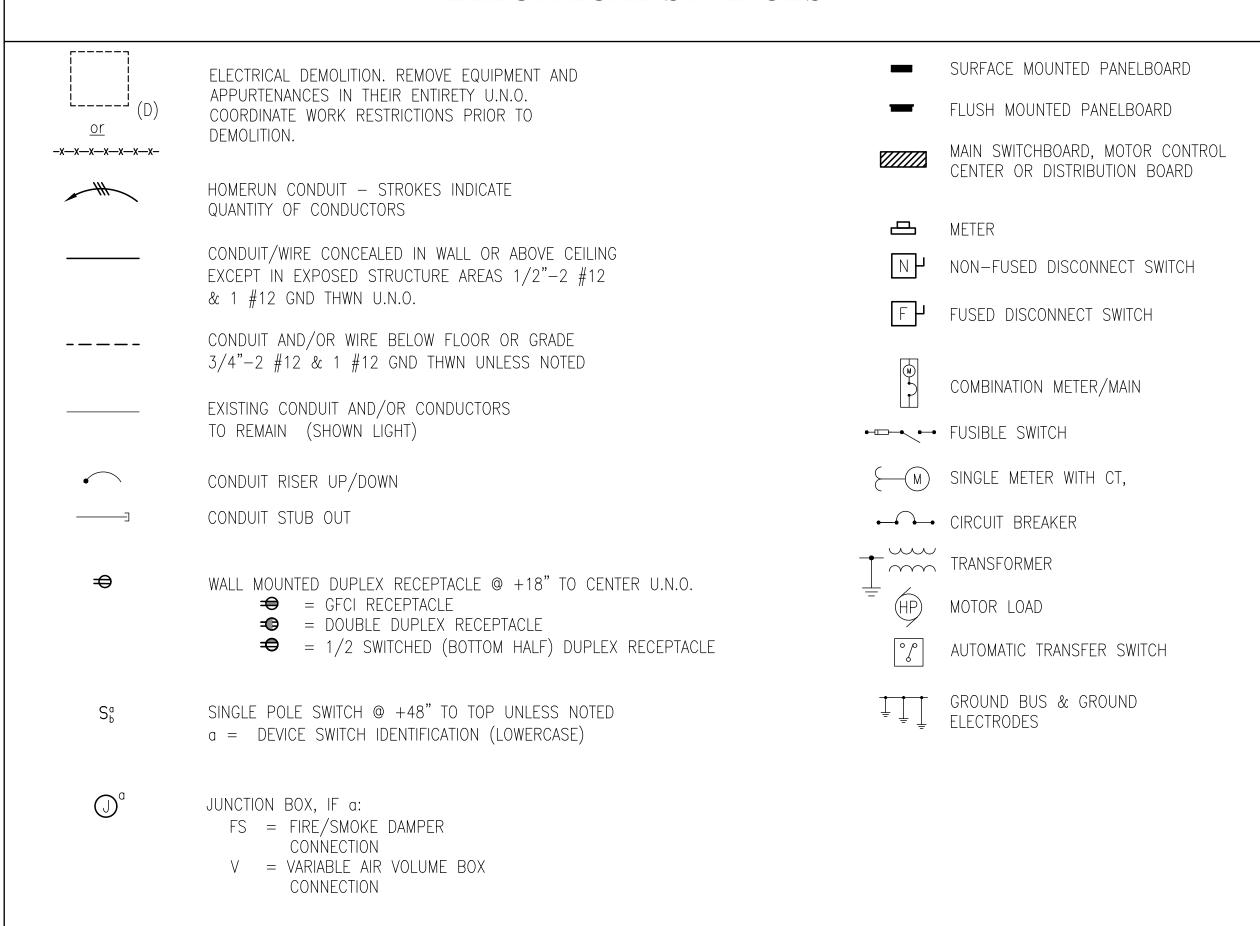

### ELECTRICAL ABBREVIATIONS

INDICATES MOUNTING HEIGHTS ARE TO CENTERLINE OF DEVICE AFF OR AFG AMP FUSE (FOR FUSES), AMP FRAME (FOR CIRCUIT BREAKERS) ABOVE FINISHED FLOOR ABOVE FINISHED GRADE LOCAL AUTHORITY HAVING JURISDICTION AMP TRIP AUTOMATIC TRANSFER SWITCH MANUAL TRANSFER SWITCH CONDUIT CONTINUATION CONT COPPER COLD WATER PIPE INDICATES ARC FAULT CIRCUIT INTERRUPTER WITH DEDICATED NEUTRAL GROUND FAULT CIRCUIT INTERRUPTER WITH DEDICATED NEUTRAL GROUND FAULT CIRCUIT INTERRUPTER WITH DEDICATED NEUTRAL GROUND FAULT PROTECTION GND GROUND ELECTRICAL UTILITY COMPANY IN-USE WEATHER-PROOF (NEMA 3R) LUGS ONLY (SEE ALSO MLO) MAIN CIRCUIT BREAKER MAIN LUGS ONLY NATIONAL ELECTRICAL CODE, AS ADOPTED BY THE AHJ POLE PHASE INDICATES PANEL SOLID NEUTRAL TYP TYPICAL UNINTERRUPTIBLE POWER SYSTEM WEATHER-PROOF (NEMA 3R) TRANSFORMER UNO UNLESS NOTED OTHERWISE DEMOLITION EXISTING NEW

### HAWAII COUNTY ENERGY CODE

2015 IECC. HAWAII REVISED STATUTES HRS 107-24 TO 28 & HAWAII ADMINISTRATIVE RULES CHAPTER HAR 3-181.1

### COMMERCIAL BUILDING ENERGY EFFICIENCY STANDARDS

I CERTIFY THAT, TO THE BEST OF MY KNOWLEDGE, THIS PROJECTS DESIGN SUBSTANTIALLY CONFORMS TO THE BUILDING ENERGY FEFICIENCY STANDARDS PERTAINING TO THE <u>COMMERCIAL PROVISIONS FOR ELECTRICAL & LIGHTING SYSTEMS</u> (C405, & C408) OF THE 2015 IECC WITH AMENDMENTS PER HAR 3-181.1:

### COMPLIANCE METHOD

RELOCATE/RELOCATED

X | 2015 IECC AS AMENDED. MANDATORY AND PRESCRIPTIVE 2015 IECC AS AMENDED. MANDATORY AND TOTAL BUILDING PERFORMANCE ASHRAE STANDARD 90.1-2013. MANDATORY AND PRESCRIPTIVE ASHRAE STANDARD 90.1-2013. MANDATORY AND TOTAL BUILDING PERFORMANCE INFORMATION IN CONSTRUCTION DOCUMENTS YES N/A INTERIOR LIGHTING OCCUPANT SENSOR CONTROLS C405.2.1 TIME SWITCH CONTROLS C405.2.2 DAYLIGHT RESPONSIVE CONTROLS C405.2.3 DAYLIGHT ZONES ON PLANS C405.2.3.2 & C405.2.3.3 GUEST ROOM CONTROLS C405.2.4 INTERIOR LIGHTING FIXTURE SCHEDULE INPUT POWER FOR INTERIOR LIGHTING FIXTURES C405.4.1 INTERIOR LIGHTING FIXTURE LOCATIONS C403.2.8 LIGHTING CONTROL FUNCTIONAL PERFORMANCE TESTING REQUIREMENT C408.3 EXTERIOR LIGHTING EXTERIOR LIGHTING CONTROLS C405.2.5 EXTERIOR LIGHTING FIXTURE SCHEDULE INPUT POWER FOR EXTERIOR LIGHTING FIXTURES

NOTES:

ELECTRICAL

SIGNATURE: DATE: NAME: ELI B. WALTZ TITLE: ELECTRICAL ENGINEER LICENSE NO.:18572-E


TENANT SUBMETERING

EXTERIOR LIGHTING FIXTURE LOCATIONS

ELECTRICAL TRANSFORMER EFFICIENCY

**ENGINEERING** IP A R T N E R S

> 455 E. Lanikaula St. Hilo Hawai'i 96720 Main (808) 933-7900 www.epinc.pro Hawai`i | Las Vegas



THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION, CONSTRUCTION OF THIS PROJECT WILL BE UNDER MY OBSERVATION Gl Wat

MBOL N H TRICAL

H

REHE. TY

C405.7

C405.10


DESIGNED E CHECKED BY: QC'D BY: JOB NO.

12022-17-01

DWG. NO.


E-001

SHEET NO. 12 OF 1

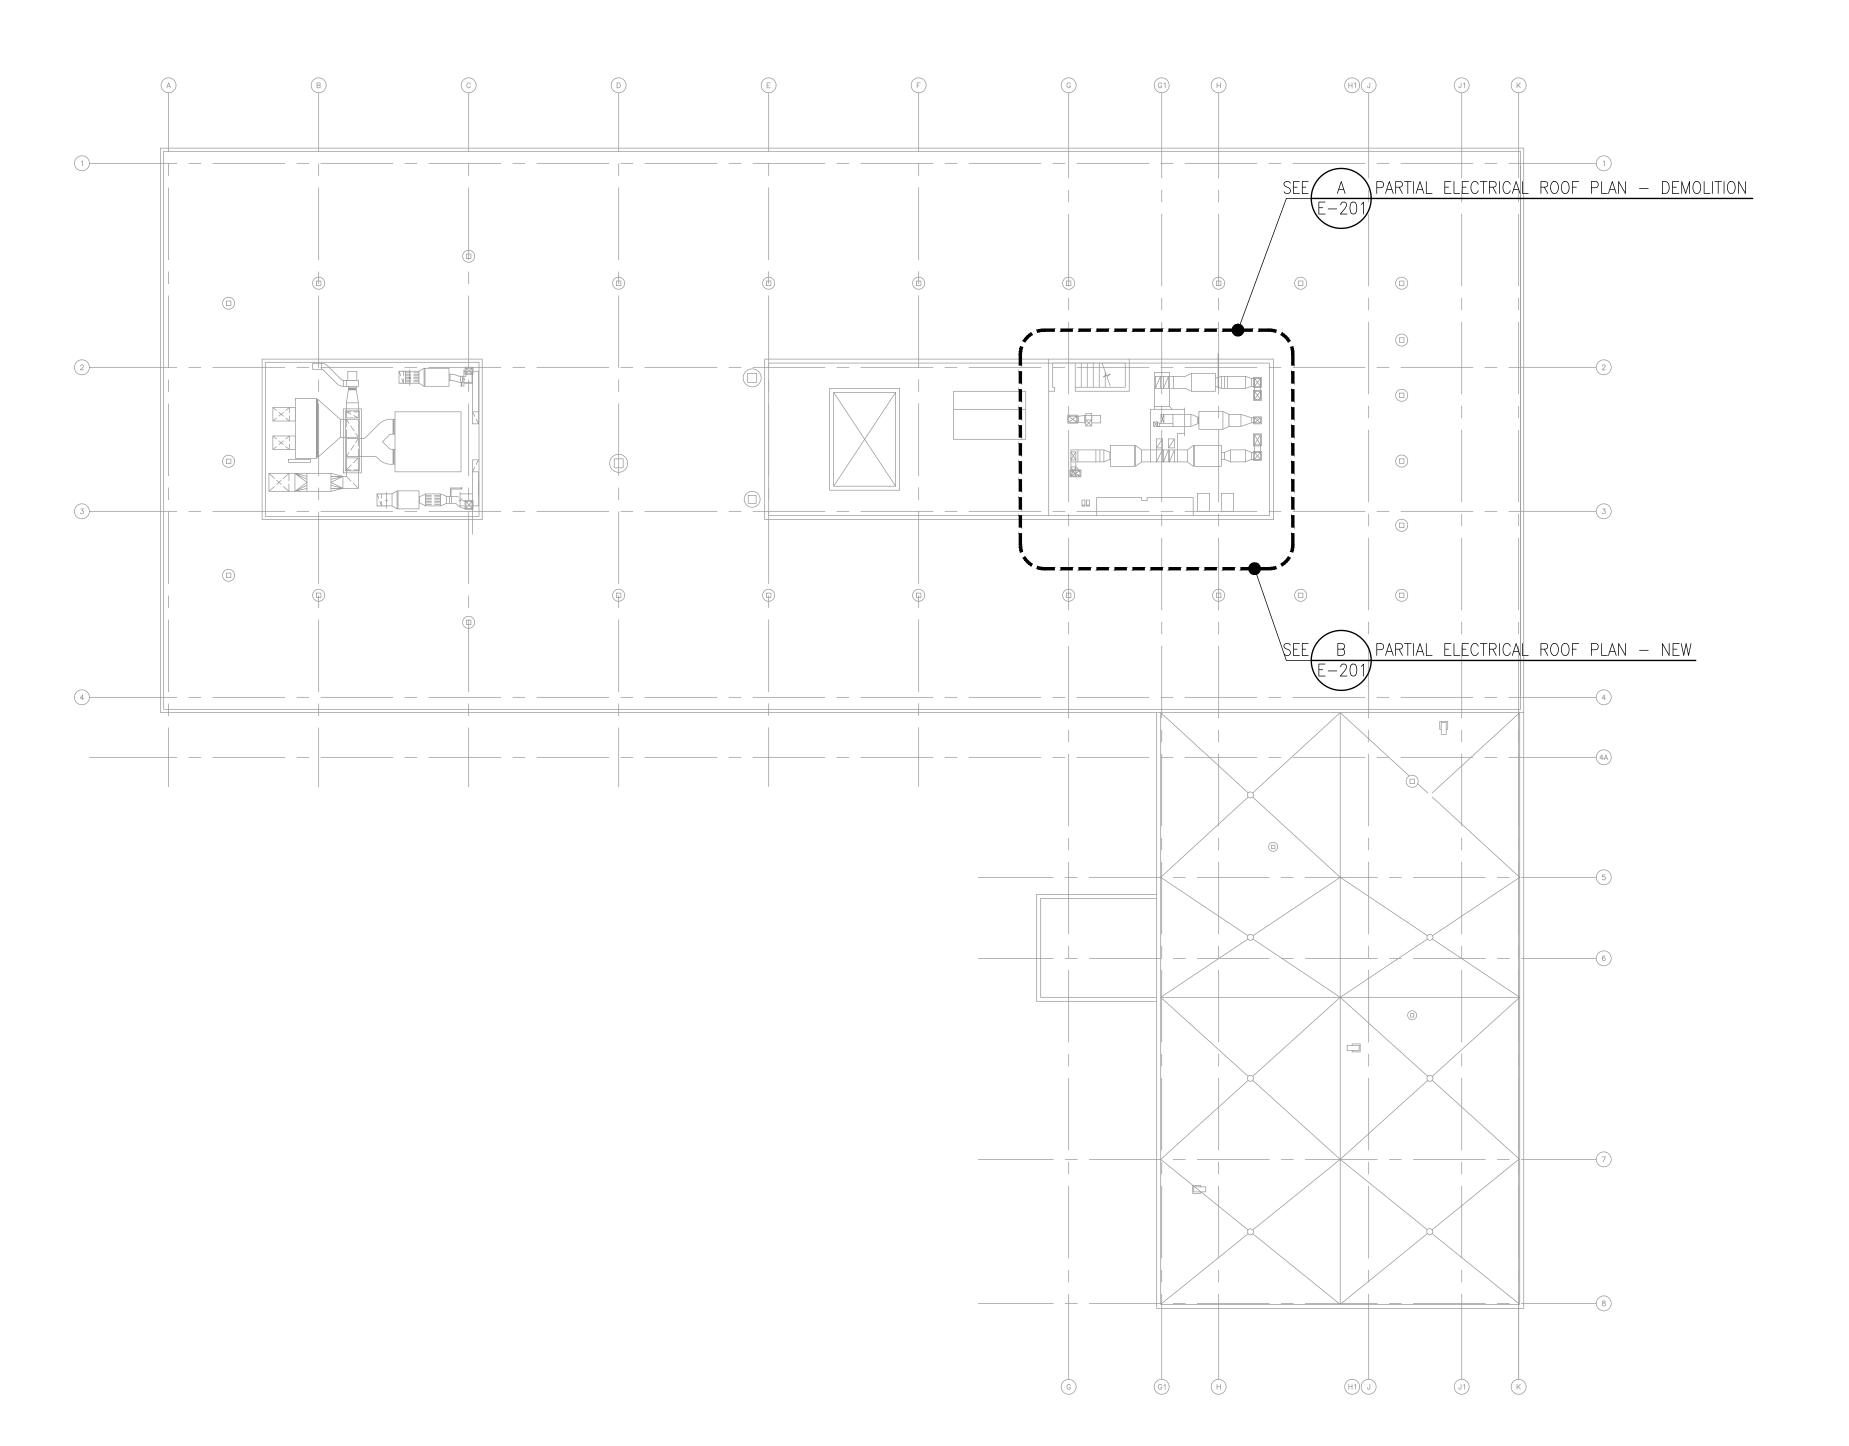



455 E. Lanikaula St. Hilo Hawai`i 96720 Main (808) 933-7900 www.epinc.pro Hawai`i | Las Vegas



THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION, CONSTRUCTION OF THIS PROJECT WILL BE UNDER MY OBSERVATION.

ROOF ELECTRICAL OVERALL

HVAC MODIFICATIONS FOR: REHEAT SYSTEM
KONA COMMUNITY
HOSPITAL

JOB NO. 12022-17-01

DWG. NO.

E-101 SHEET NO. 13 OF 1

OVERALL ELECTRICAL ROOF PLAN

SCALE: 1/16" = 1'-0"

O 16' 32'

N

### NOTICES

- 1. CONTRACTOR SHALL VERIFY EXISTING CONDITIONS PRIOR TO START OF WORK AND NOTIFY ENGINEER OF ANT DISCREPANCIES.
- 2. MINIMUM CONDUIT SIZE FOR ALL BRANCH CIRCUITS SHALL BE 3/4°C.
- 3. ALL CONDUIT SHALL BE EMT UNLESS OTHERWISE NOTED.
- 4. MAXIMUM LENGTH FOR FLEXIBLE METALLIC CONDUIT SHALL BE 6'.
- 5. ALL COVER PLATES, JUNCTION BOXES, EQUIPMENT/ DISCONNECT ENCLOSURES SHALL BE IDENTIFIED WITH PANEL AND CIRCUIT NUMBER ON WHITE STICKER LABEL WITH BLACK LETTERING. SEE SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
- 6. ALL DDC CONTROL WIRING SHALL BE ROUTED IN EMT CONDUIT, SEE MECHANICAL DRAWINGS.

### NOTES

- 1 REMOVE EXISTING MECHANICAL EQUIPMENT, CONDUIT AND CONDUCTORS BACK TO PANEL SOURCE.
- 2 DEMOLISH CONNECTION TO MECHANICAL EQUIPMENT, RETAIN CIRCUIT FOR CONNECTION TO NEW EQUIPMENT.
- 3 VFD FURNISHED BY MECHANICAL CONTRACTOR, INSTALLED BY ELECTRICAL CONTRACTOR. LOCATE AS INDICATED ON MECHANICAL DRAWINGS, MAINTAIN CLEARANCE PER NEC.
- $\bigcirc$  PROVIDE 3/4"C (3)#12 & (1)#12 GND BACK TO
- 5 PUMPS SHALL BE INTERLOCKED VIA BUILDING MANAGEMENT SYSTEM FOR LEAD/ STANDBY OPERATION, SEE MECHANICAL DRAWINGS FOR MORE DETAIL.



455 E. Lanikaula St. Hilo Hawai`i 96720 Main (808) 933-7900 www.epinc.pro Hawai`i | Las Vegas




THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION, CONSTRUCTION OF THIS PROJECT WILL BE UNDER MY OBSERVATION.


**ROO** ECTRICAL J

JOB NO. 12022-17-01

DWG. NO.

E-201 SHEET NO. 14 OF 1

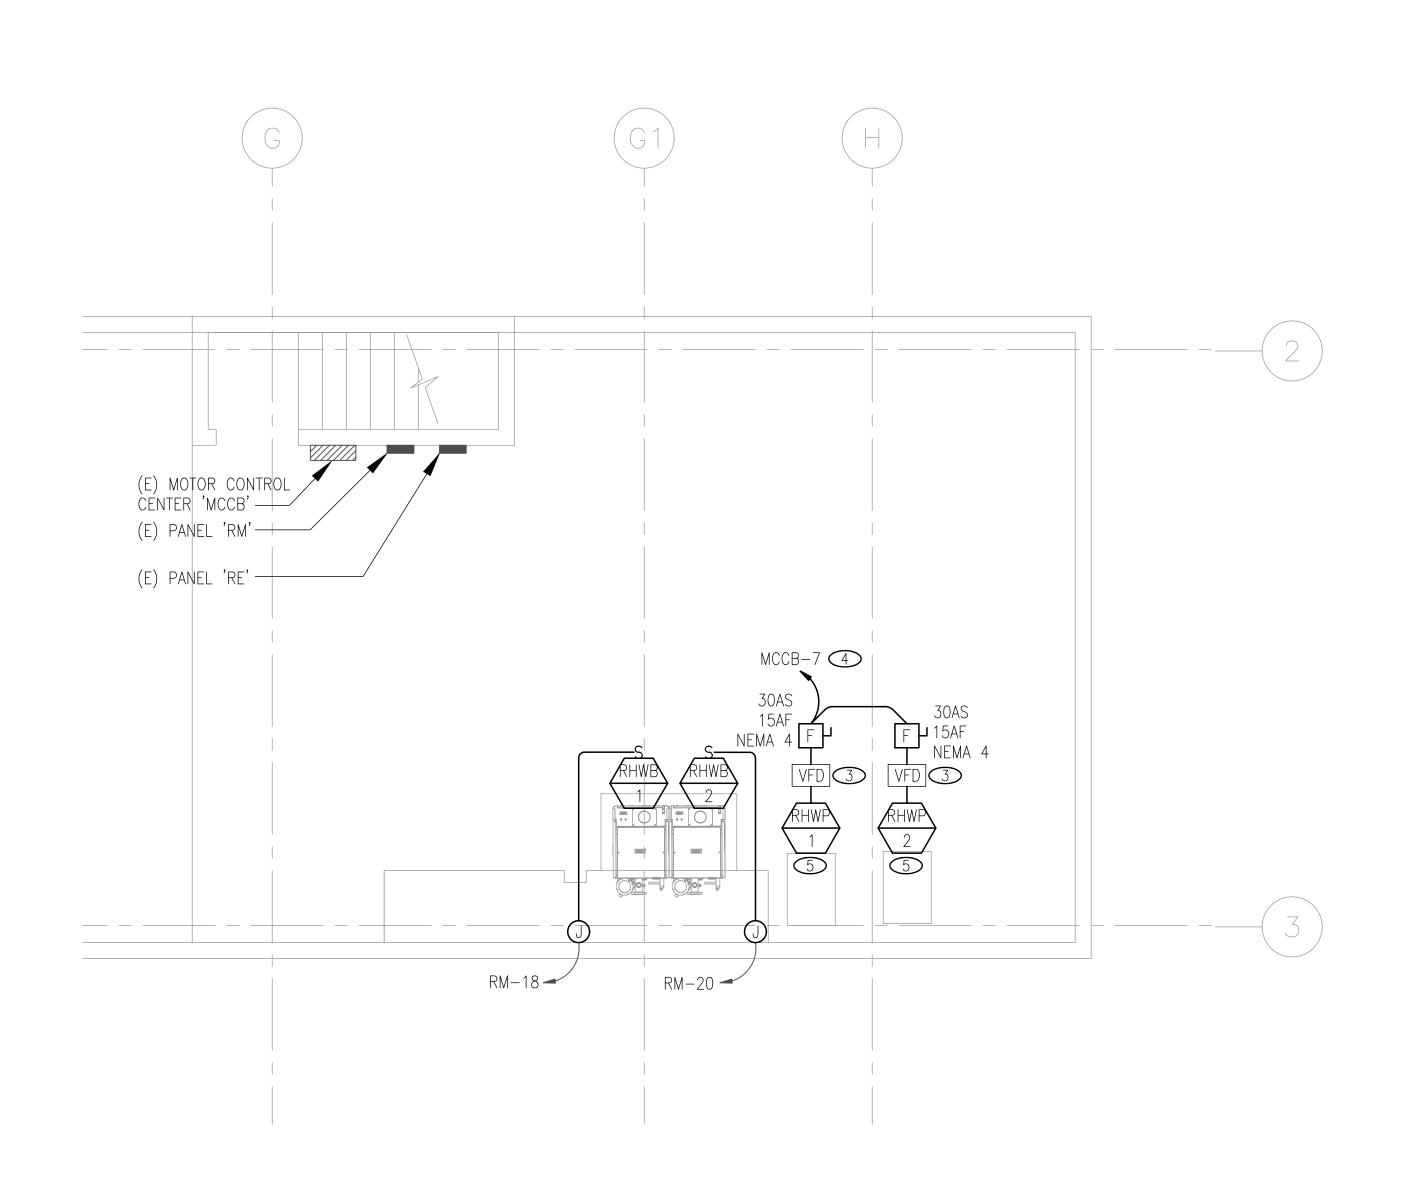

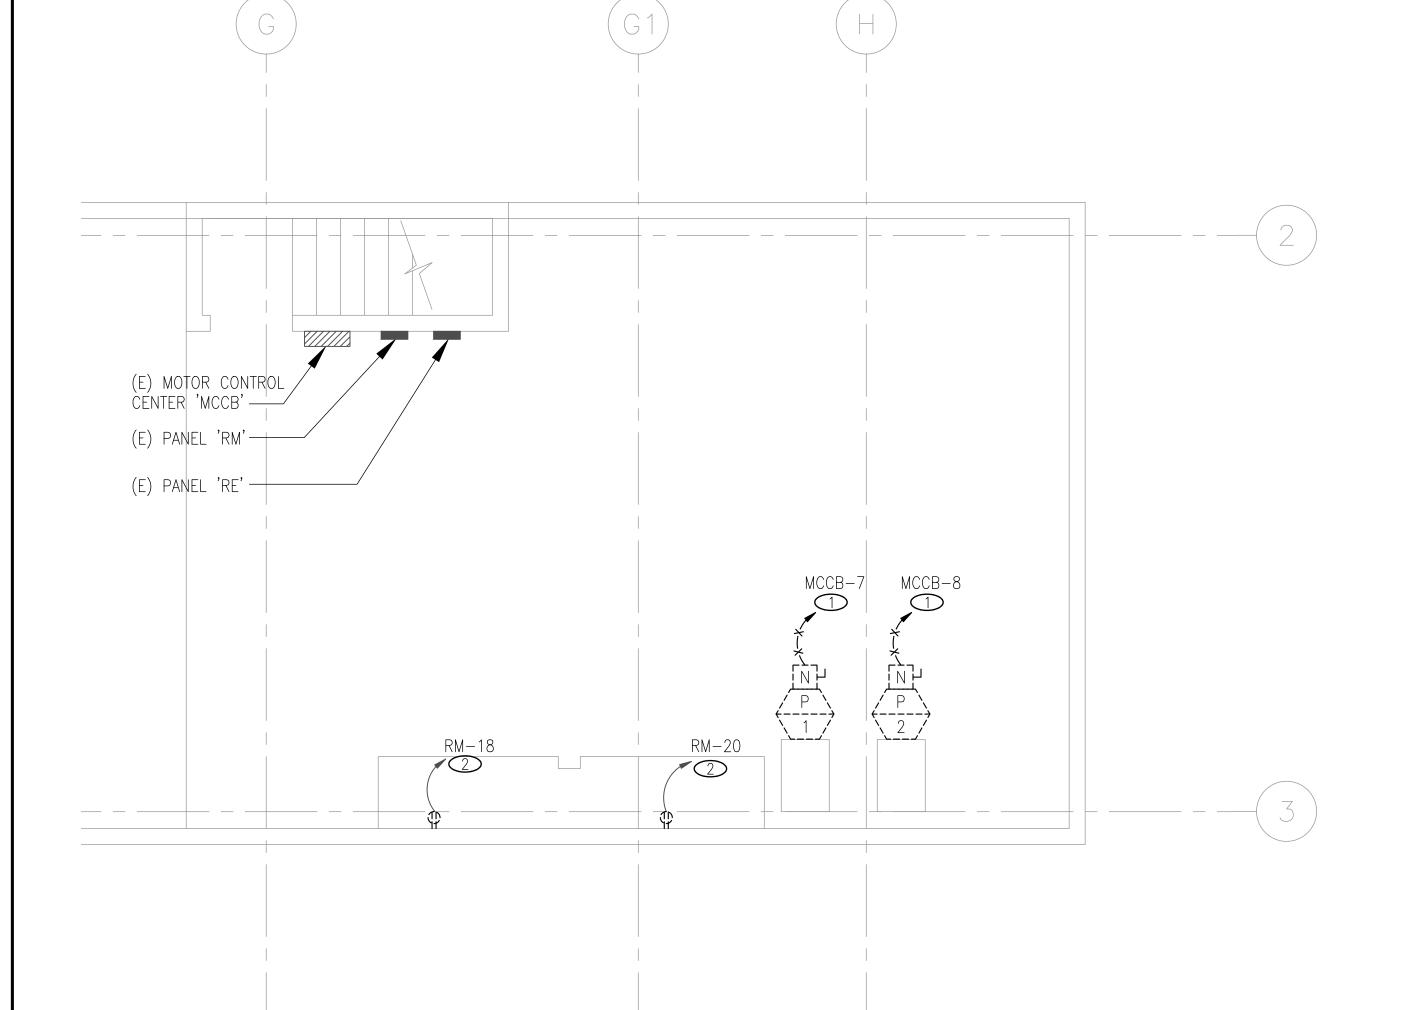






| <u>E</u> | (IS  | 11T   | ١G       |                   |                  |   |      |        |              |     |         |                    |              |          |                  |      |      |   |    |      |   |        |
|----------|------|-------|----------|-------------------|------------------|---|------|--------|--------------|-----|---------|--------------------|--------------|----------|------------------|------|------|---|----|------|---|--------|
| P/       | ١N   | EL    |          | RM                | VOI              | TAGE:   |      |        | 1            | 120 | 1Ø 3W   |                    |              | CIRCUIT  | CODE:            | blaı | nk c |   |    |      |   |        |
|          |      |       |          | 9/24/20 1:11 PM   |                  | BUS:  |      |        |              | 1.0 | CATION: | - POOI             | <del>-</del> |          |                  |      |      | L: LONG-CONTINUOUS<br>R: DEMANDABLE RECEPTACLES |    |      |   |        |
|          |      |       |          | 12022-17-01       |                  | MAINS: M.L.O. LOCATION: ROOF RATING: EXISTING MOUNTING: SURFACE |      |        |              |     |         |                    |              |          |                  |      |      |   |    |      |   |        |
| Н        |      |       | <u>Т</u> | 12022-17-01       |                  | ATING.  | . LX | ISTIIV | CONNECTED VA |     |         |                    |              |          |                  |      |      |   |    |      |   |        |
| CKT NO   | 핌    | ₫     | POLE     |                   | LOAD DESIGNATION |   | _    | _      | $\dashv$     |     | _       |                    |              |          | LOAD DESIGNATION |      |      |   |    |      | 핌 | CKT NO |
|          | 8    | TRIP  | _        |                   | DESCRIPTION      | (NOTE)  | ) M  | R      | L            | ØA  | ØB      | АВ                 | ØA           | ØВ       | L R              | М    |      | TE) DESCRIPTION                                 | _  | POLE | 8 |        |
| 1        |      | 20    |          | EF-R4             |                  |   | ┖    | Ц      | Щ            |     |         | Ш                  |              |          | $\bot$           | Ц    |      | PRV 20,21,22                                    | 20 | 1    |   | 2      |
| 3        |      | 20    | 1        | PRV 16,17,18      |                  |   | ┖    | Ш      | Ш            |     |         | Ш                  |              |          | $\perp$          |      |      | PRV 23/ EF-R7                                   | 20 | 1    |   | 4      |
| 5        |      | 20    | 1        | PRV 10            |                  |   | ┖    | Ш      | Щ            |     |         | ш                  |              |          | $\perp$          |      |      | PRV 2,3,  | 15 | 1    |   | 6      |
| 7        |      | 15    | 1        | PRV 14,15         |                  |   |      | Ш      | Ш            |     |         | ш                  |              |          |                  |      |      | PRV 24  | 20 | 1    |   | 8      |
| 9        |      | 15    | 1        | PRV 9,12          |                  |   |      |        |              |     |         | $\ \cdot\ $        |              |          |                  |      |      | PRV 10,27                                       | 20 | 1    |   | 10     |
| 11       |      | 15    | 1        | PRV 7,12,13       |                  |   |      |        |              |     |         |                    |              |          |                  |      |      | HW RECIRCULATOR                                 | 15 | 1    |   | 12     |
| 13       |      | 15    | 1        | SPARE             |                  |   |      |        |              |     |         | $ \cdot $          |              |          |                  |      |      | EF-R1   | 15 | 1    |   | 14     |
| 15       |      | 20    | 1        | PRV 23            |                  |   |      |        |              |     |         | $  \cdot  $        |              |          |                  |      |      | PRV 28  | 15 | 1    |   | 16     |
| 17       |      | 20    | 1        | ROOF LIGHTS       |                  |   |      |        |              |     |         |                    |              |          |                  |      | 1    | RHW BOILER 1                                    | 20 | 1    |   | 18     |
| 19       |      | 20    | 1        | ROOF RECEPT       |                  |   |      |        |              |     |         |                    |              |          |                  |      | 1    | RHW BOILER 2                                    | 20 | 1    |   | 20     |
| 21       |      | 20    | 1        | EF-R5             |                  |   |      |        |              |     |         | $ \cdot $          |              |          |                  |      |      | SPACE   |    |      |   | 22     |
| 23       |      |       |          | SPACE             |                  |   |      |        |              |     |         | $  \cdot  $        |              |          |                  |      |      | AIR HANDLER A-R8                                | 20 | 1    |   | 24     |
| 25       |      | 20    | 1        | NITE LIGHT        |                  |   |      |        |              |     |         | $\cdot$            |              |          |                  |      |      | SPARE   | 20 | 1    |   | 26     |
| 27       |      | 40    | abla     | PANEL 'ELR'       |                  |   |      |        |              |     |         | $\Pi \cdot$        |              |          |                  |      |      | PRV 24,25,26                                    | 20 | 1    |   | 28     |
| 29       |      |       | 2        | _                 |                  |   | T    |        |              |     |         | $\overline{\cdot}$ | -            |          |                  |      |      | CHILLER   | 20 | 1    |   | 30     |
| 31       |      |       |          |                   |                  |   | T    |        |              |     |         | $\Pi \cdot \Pi$    |              |          |                  |      |      |   |    |      |   | 32     |
| 33       |      |       |          |                   |                  |   |      |        |              |     |         | $\cdot$            |              |          |                  |      |      |   |    |      |   | 34     |
| 35       |      |       | П        |                   |                  |   |      |        |              |     |         | $\Pi \cdot$        |              |          |                  |      |      |   |    |      |   | 36     |
| 37       |      |       |          |                   |                  |   |      |        |              |     |         | $\cdot$            |              |          |                  |      |      |   |    |      |   | 38     |
| 39       |      |       |          |                   |                  |   |      |        |              |     |         | $\Pi \cdot \Pi$    |              |          |                  |      |      |   |    |      |   | 40     |
| 41       |      |       |          |                   |                  |   |      |        |              |     |         | $\cdot$            |              |          |                  |      |      |   |    |      |   | 42     |
| PAN      | EL N | NOTE  | S        | •                 |                  | PH  | IASE | TOT    | ALS          | Ø   | A: 0    |                    | Ø            | 3: 0     | •                |      |      | TOTAL CONNECTED VA                              |    | 0    |   | $\neg$ |
|          |      |       |          |                   |                  |   |      |        | ٠            |     |         |                    |              | <u> </u> |                  |      |      | CONNECTED VA (CODE N)                           |    | 0    |   | コ      |
| 1. R     | EUS  | E EX  | ISTIN    | IG BREAKR FOR NEV | W LOAD           |   |      |        |              |     |         |                    |              |          |                  |      |      | CONNECTED VA (CODE L)                           |    | 0    |   |        |
|          |      |       |          |                   |                  |   |      |        |              |     |         |                    |              |          |                  |      |      | CONNECTED VA (CODE R)                           |    | 0    |   |        |
|          |      |       |          |                   |                  |   |      |        |              |     |         |                    |              |          |                  |      |      | CONNECTED VA (CODE K)                           |    | 0    |   |        |
|          |      |       |          |                   |                  |   |      |        |              |     |         |                    |              |          |                  |      |      | PANEL CONNECTED KVA                             |    | 0.0  | ) | ヿ      |
|          |      |       |          |                   |                  |   |      |        |              |     |         |                    |              |          |                  |      |      | PANEL DEMAND KVA                                |    | 0.0  | ) |        |
| 30 (     | IRC  | UIT F | PANE     | L                 |                  |   |      |        |              |     |         |                    |              |          |                  |      |      | PANEL DEMAND AMPS                               |    | 0.0  | ) |        |
|          |      |       |          |                   |                  |   |      |        |              |     |         |                    |              |          |                  |      |      | HIGH Ø AMPS w/ DEMAND                           |    | 0.0  | ) |        |

### **NOTES**

REPLACE EXISTING STARTER/ DISCONNECT WITH NEW CIRCUIT BREAKER AS INDICATED. MATCH EXISTING MANUFACTURER AND AIC RATING.

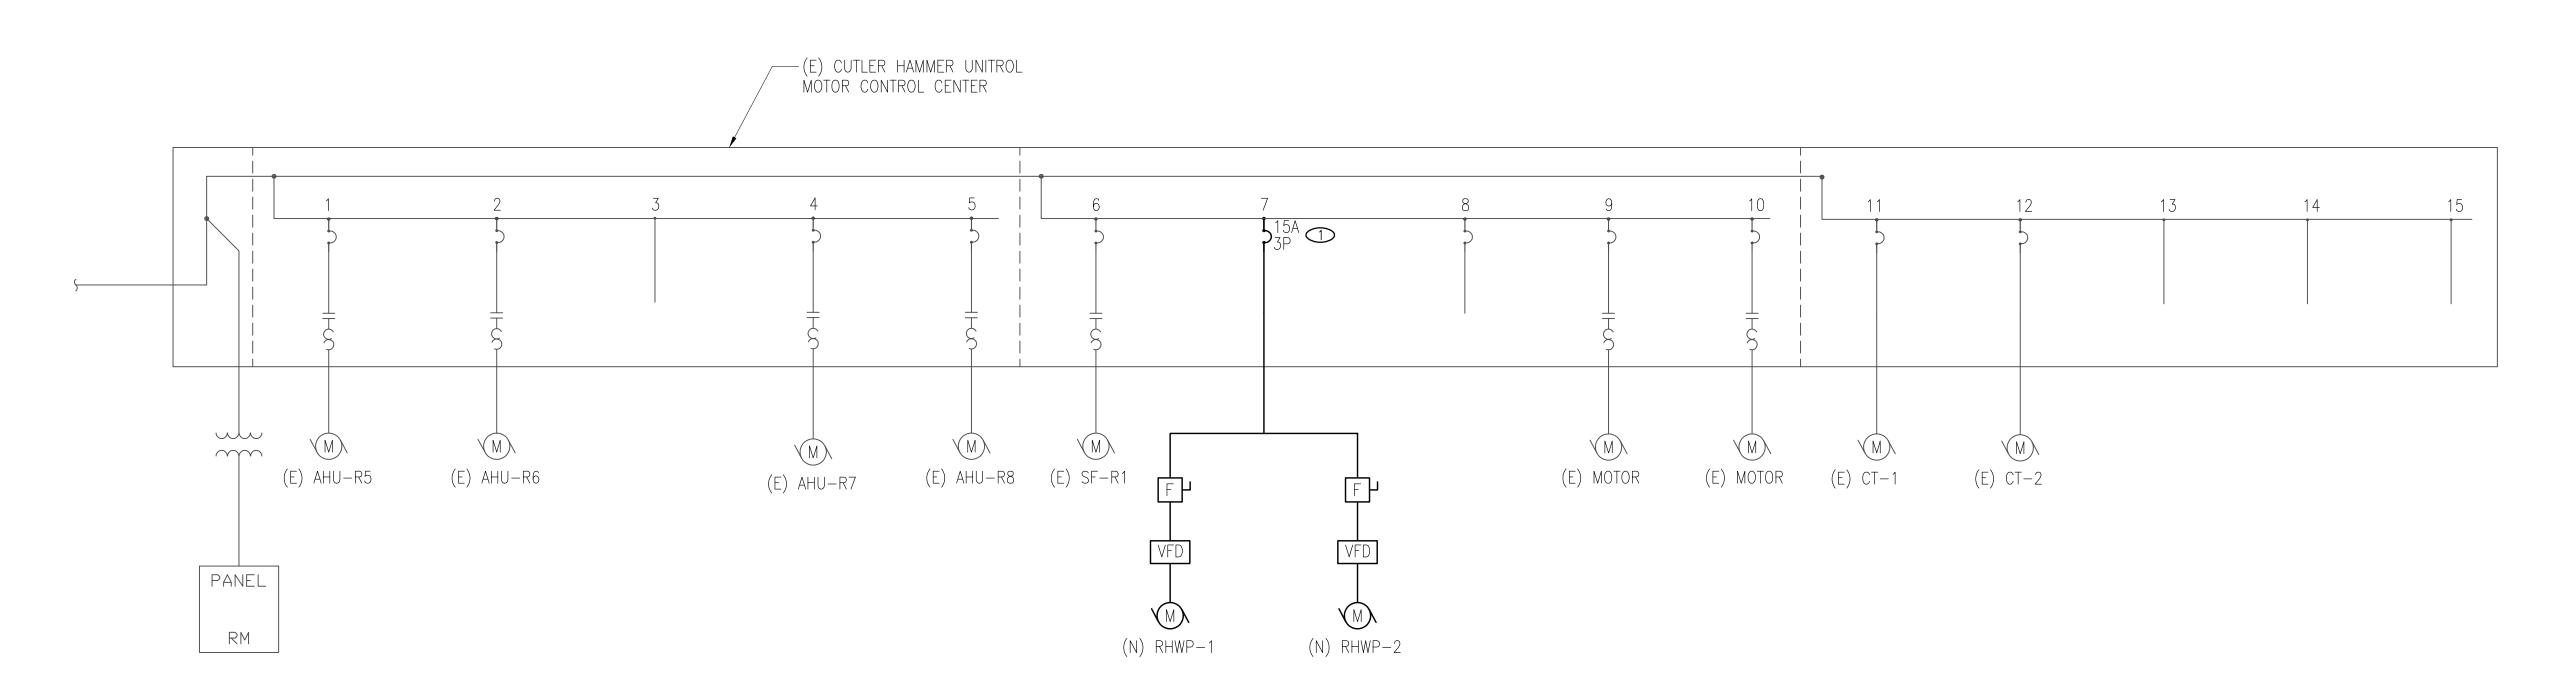

ENGINEERING PARTNERS

> 455 E. Lanikaula St. Hilo Hawai`i 96720 Main (808) 933-7900 www.epinc.pro Hawai`i | Las Vegas



THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION, CONSTRUCTION OF THIS PROJECT WILL BE UNDER MY OBSERVATION.

SINGLE LINE DIAGRAM

DATE: JULY, 2
REV.

HVAC MODIFICATIONS FOR: REHEAT SYSTEM
KONA COMMUNITY
HOSPITAL
79-1019 HAUKAPILA ST, KEALAKEKUA, HI 96750
TMK: (3) 7-9-010:081

| •          | •            |
|------------|--------------|
| RAWN BY:   | DESIGNED BY: |
| (D         | KD           |
| HECKED BY: | QC'D BY:     |
| 1S         | EW           |
| IOR        | NO           |

JOB NO. 12022-17-01 DWG. NO.

E-301

SHEET NO. 15 OF 1

A

SINGLE LINE DIAGRAM
NO SCALE



### **APPENDIX K**

### SPECIFICATIONS/PROJECT MANUAL

See following pages

### KONA COMMUNITY HOSPITAL

**HVAC** Reheat System Improvements Kealakekua, Island of Hawaii, Hawaii

> HAWAII HEALTH SYSTEMS Kona Community Hospital 79-1019 Haukapila Street Kealakekua, HI 96750

SPECIFICATIONS

CONSTRUCTION SUBMITTAL

SEPTEMBER 2020

#### KONA COMMUNITY HOSPITAL

### HVAC Reheat Water System Improvements Kealakekua, Island of Hawaii, Hawaii

#### **TABLE OF CONTENTS**

#### **DIVISION 1 - GENERAL REQUIREMENTS**

| Section 01100 Section 01120 Section 01260 Section 01290 Section 01310 Section 01330 Section 01400 Section 01500 Section 01600 Section 01730 Section 01732 Section 01770 Section 01783 | Summary of Work  Alteration Project Procedures  Contract Considerations  Payment Procedures  Project Management and Coordination  Submittal Procedures  Quality Requirements  Temporary Facilities & Controls  Project Requirements  Execution  Cutting and Patching  Closeout Procedures  Project Record Documents | 1 - 7<br>1 - 6<br>1 - 11<br>1 - 4<br>1 - 3<br>1 - 7<br>1 - 7<br>1 - 2<br>1 - 3 |
|---|---|--|
| Section 15000 Section 15250 Section 15400 Section 15700 Section 15901 Section 15950  DIVISION 16 – ELEC   | General Mechanical Requirements   | 1 - 4<br>1 - 5<br>1 - 26   |
| Section 16010 Section 16047 Section 16060 Section 16073 Section 16075 Section 16120 Section 16130 Section 16410 Section 16491   | Basic Electrical Requirements  Electrical Demolition  Grounding & Bonding  Hangers & Supports For Electrical Systems  Electrical Identification  Conductors & Cables  Raceways & Boxes  Enclosed Switches & Circuit Breaker  Fuses  | 1 - 4<br>1 - 4<br>1 - 3  |

#### **DIVISION 1 - GENERAL REQUIREMENTS**

#### **SECTION 01100 - SUMMARY OF WORK**

#### PART 1 - General

#### 1.01 SECTION INCLUDES

- A. Contract description.
- B. Contract use of premises.
- C. WEST HAWAII FACILITIES DIRECTOR (WHFD) AND/OR PROJECT MANAGER furnished/WHFD AND/OR PROJECT MANAGER installed products.
- D. WHFD AND/OR PROJECT MANAGER furnished/contractor installed products.
- E. Hospital occupancy.

#### 1.02 CONTRACT DESCRIPTION

- A. HVAC Reheat System Improvements at the Kona Community Hospital.
- B. The Work of the contract generally consists of the following:
  - 1. Removal of existing pumps, water heaters and associated valves, piping and appurtenances associated with the hospital's central reheat water system.
  - 2. Installation of new LPG boilers and pumps.
  - 3. Installation of new balancing valves and sensors throughout the hospital's reheat system.
  - 4. Building Management Controls modifications for the new devices.
  - 5. Testing and Balancing.
  - 6. Electrical work associated with the new equipment.

#### 1.03 <u>CONTRACTOR USE OF PREMISES</u>

- A. Limit the use of premises to allow for continued Hospital occupancy.
- B. Emergency Building Exits During Construction: Must remain open and unblocked at all times. Maintain access for staff, patients, and public. Egress must be maintained and way finding signage during construction.
- C. Construction Operations: Limited to areas noted on Drawings.
- D. Staging and Parking

 Staging area and limited contractor employee parking will be made available on site. Contractor and vendor parking is designated. Any new parking arrangements require prior approval by the WHFD AND/OR PROJECT MANAGER.

#### E. Time Restrictions for Performing Work:

- 1. General 6:00 am to 2:30 pm. Coordinate w/ WHFD AND/OR PROJECT MANAGER, work necessary outside these normal operating hours. Submit written notice a minimum three days in advance.
- F. Cooperate with Hospital to minimize conflict and to facilitate Hospital's operations. Coordinate operations with WHFD AND/OR PROJECT MANAGER.
- G. Access to adjacent floors must be approved in advance by the WHFD AND/OR PROJECT MANAGER. Submit written notice not less than seven days in advance of intended work on adjacent floors.
- H. Do not close or obstruct roadways without first consulting with the WHFD AND/OR PROJECT MANAGER. Conduct operations with minimum interference to public or private roadways.
- I. Maintain vital services (as defined by the WHFD AND/OR PROJECT MANAGER) with the minimum of interruption. Outages and interruptions must be approved in advance by the WHFD AND/OR PROJECT MANAGER. Submit written notices of outages and interruptions not less than seven days in advance.

#### J. Contractor's personnel:

- 1. It is preferred that contractors park off site and carpool to hospital.
- 2. Contractor's personnel may use the hospital cafeteria.
- 3. Smoking is not permitted anywhere on KHC property. Consumption of food and beverages will not be permitted on the premises except in designated areas.
- 4. Playing of radios will not be permitted.
- 5. Shall be properly attired for work. (No tank tops, cut-off jeans, slippers, etc.)
- 6. Shall conduct themselves with decorum and courtesy toward staff, patients, and public.
- 7. Shall not use loud and offensive language.
- 8. Shall read and sign the Contractor's Guidelines Handbook.

#### K. Construction Zone Accessibility Requirements

1. General: Hawaii Revised Statutes (HRS) 103-05 requires this project to conform to the requirements of the Americans with Disabilities Act Accessibility Guidelines (ADAAG).

- 2. Ensure accessible routes to emergency entrances and exits to and from accessible parking public pedestrian routes during the construction period as required by ADAAG 4.1.1(4).
- Temporary buildings and facilities that are not of permanent construction but are extensively used or are essential for public use for a period of time shall be accessible. Egress must be maintained and way finding signage during construction.
- 4. Provide temporary safe pedestrian passageway around a construction site.
  - a. Areas that are used only as work areas shall be designed and constructed so that individuals with disabilities can approach, enter, and exit the areas.
  - b. These guidelines do not require that any areas used only as work areas be constructed to permit maneuvering within the work area or be constructed or equipped (i.e., with racks or shelves) to be accessible.
  - c. Follow OSHA guidelines concerning scaffolding and debris and dust protection.

# 1.04 WHFD AND/OR PROJECT MANAGER FURNISHED/WHFD AND/OR PROJECT MANAGER INSTALLED PRODUCTS

- A. Items noted "OFOI" (WHFD AND/OR PROJECT MANAGER Furnished/WHFD AND/OR PROJECT MANAGER Installed) will be furnished and installed by the WHFD AND/OR PROJECT MANAGER, including but not limited to:
  - 1. Medical equipment.
- B. Hospital's Responsibilities:
  - 1. Arrange for and deliver Hospital reviewed shop drawings, product, data and samples, to Contractor.
  - 2. Upon delivery, inspect products jointly with Contractor.
- C. Contractor's Responsibilities:
  - 1. Review WHFD AND/OR PROJECT MANAGER's provided shop drawings, product data, and samples.
  - 2. Provide any necessary utility roughs and backing, and install in accordance with manufacturer's instructions.
  - 3. Arrange and pay for product delivery to site.
  - 4. Submit claims for transportation damage and replace damaged, defective or deficient items.
  - 5. Arrange for manufacturers' warranties, inspections and service.

#### 1.05 HOSPITAL OCCUPANCY

- A. The Hospital will remain operational during entire period of construction for the conduct of normal operations.
- B. The Contractor is to coordinate the work and details within each phase, to minimize disruption to WHFD AND/OR PROJECT MANAGER's operation. Advanced notification of a minimum of one week for disruption due to noise and other construction activity is required as well as posting of signage in advance to advise occupants of such disruption.
- C. Provide dust and noise barriers where specified under other portions of the contract documents. Follow ICRA procedures during construction, i.e., Policy #125-54 as attached. Walk off mats at site entrance shall be changed as needed. HEPA filtration units are to be utilized 24 hours per day throughout the construction process. Complete ISLM check sheet daily.
- D. Schedule the Work, and cooperate with Hospital to minimize conflict with work involving dust and noise and odor.

PART 2 - Products (Not Used)

PART 3 - Execution (Not Used)

#### SECTION 01120 - ALTERATION PROJECT PROCEDURES

#### **PART 1 - Products**

#### 1.01 <u>SALVAGED MATERIALS</u>

- A. Salvage sufficient quantities of cut or removed material to replace damaged work of existing construction, when materials not readily obtainable on current market.
- B. Incorporate salvaged or used material only as indicated or with permission of the Hospital.

#### 1.02 PRODUCTS FOR PATCHING AND EXTENDING WORK

- A. New Materials: Match existing products and work for patching and extending work.
- B. Type and Quality of Existing Products: Determine by inspection and testing products where necessary, referring to existing Work as a standard.

#### **PART 2 - Execution**

#### 2.01 EXAMINATION

- Verify that demolition is complete, and areas are ready for installation of new Work.
- B. Beginning of restoration Work means acceptance of existing conditions.

## 2.02 PREPARATION

- A. Cut, move or remove items as necessary for access to alterations and renovation Work. Replace and restore at completion.
- B. Remove unsuitable material not marked for salvage, such as rotted wood, corroded metals, and deteriorated masonry and concrete. Replace materials as specific for finished Work.
- C. Remove debris and abandoned items from area and from concealed spaces.
- D. Prepare surface and remove surface finishes to provide for proper installation of new work and finishes.
- E. Close openings in exterior surfaces to protect existing work and salvage items from weather and extremes of temperature and humidity. Insulate duct work and piping to prevent condensation in exposed areas.
- F. Do not demolish, chip, or penetrate existing structural members without the expressed approval of the Prime Consultant.
- G. Perform cutting and removal work to remove minimum necessary, and in a manner to avoid damage to adjacent work and provide proper surfaces to receive installation of repair and new Work.

#### 2.03 INSTALLATION

- A. Coordinate work of alterations and renovations to expedite completion and to accommodate Owner occupancy.
- B. Project areas and Finishes: Complete in all respects including operational, carpentry, casework, mechanical and electrical work.
- C. Remove, cut, and patch Work in a manner to minimize damage and to provide a means of restoring Products and finishes to original or specified condition as appropriate.
- D. Refinish visible existing surfaces to remain in renovated rooms and spaces, to specified condition for each material, with a neat transition to adjacent finishes.
- E. In addition to specified replacement of equipment and fixtures, restore existing plumbing, ventilation, air conditioning, air balancing and electrical systems to full operational condition.

#### 2.04 TRANSITIONS

- A. Where new Work abuts or aligns with existing, perform a smooth and even transition. Patched Work to match existing adjacent Work in texture and appearance.
- B. Cut finish surfaces such as masonry, tile, plaster, or metals by methods to terminate surfaces in a straight line at a natural point of division.
- C. When finished surfaces are cut so that a smooth transition with new Work is possible, terminate existing surface along a straight line at a natural line of division. Provide trim appropriate to finished surface subject to approval of Hospital's Representative.

#### 2.05 ADJUSTMENTS

- A. Where removal of partitions or walls result in adjacent spaces becoming one, rework floors, walls and ceiling to a smooth plane without breaks, steps or bulkheads.
- B. Where a change of plane ¼ inch or more occurs, submit recommendation for providing a smooth transition for the WHFD AND/OR PROJECT MANAGER review.
- C. Trim existing doors as necessary to clear new floor finish. Refinish trim as required.
- D. At penetrations of fire-rated wall, ceiling or floor construction, completely seal voids with fire rated, fire resistant material, full thickness of the construction element.

#### 2.06 REPAIR OF DAMAGED SURFACES

- A. Patch or replace portions of existing surfaces which are damaged, lifted, discolored, or showing other imperfections.
- B. Repair substrate prior to patching finish.

#### 2.07 FINISHES

- A. Finish surfaces as specified in individual Product Sections.
- B. Finish patches to product uniform finish and texture over entire area. When finish cannot be matched, refinish entire surface to nearest intersection with written approval of the WHFD AND/OR PROJECT MANAGER.

## 2.08 CLEANING

- A. In addition to cleaning as specified in this specifications. Wet mop owner-occupied areas daily utilizing hospital's EPA approved disinfectant. Remove and replace soiled walk off (sticky) mats daily.
- B. Clean spillage, over-spray, and dust in Owner- occupied areas immediately.

#### PART 3 - Execution (Not Used)

#### SECTION 01260 - CONTRACT CONSIDERATIONS

#### PART 1 - General

#### 1.01 <u>SECTION INCLUDES</u>

- A. Schedule of values.
- B. Application for payment.
- C. Change procedures.

#### 1.02 RELATED SECTIONS

A. Section 01100- SUMMARY OF WORK: for allowances.

#### 1.03 SCHEDULE OF VALUES

- A. Submit a printed schedule of AIA Form G703- Application and Certificate for Payment Continuation Sheet. Contractor's standard form or electronic media printout will be acceptable.
- B. Submit Schedule of Values in duplicate within 15 days after date of Owner Contractor Agreement.
- C. Format: Utilize the Table of Contents of this Project Manual. Identify each line item with number and title of the major specification Section. Identify site mobilization and bonds and insurance.
- D. Include in each line item, the amount of Allowances specified in this section. For unit cost Allowances, identify quantities taken from Contract Documents multiplied by the unit cost to achieve the total for the item.
- E. Include within each line item, a direct proportional amount of Contractor's overhead and profit.
- F. Revise schedule to list approved Change Orders, with each Application For Payment.

#### 1.04 APPLICATIONS FOR PAYMENT

- A. Submit each application electronically on AIA Form G702- Application and Certificate for Payment and AIA G703- Continuation Sheet or Contractor's own invoice with all appropriate information. Contractor's electronic media printout will be acceptable.
- B. Content and Format: Utilize Schedule of Values for listing items in Application for Payment.
- C. Payment Period: Invoice to be submitted to Hospital Technical Representative for the preceding month's work by the 5<sup>th</sup> day of the month that follows. (The State of Hawaii does its best to pay within 30 days).

D. Waiver of Liens: Provide unconditional waiver of liens. Use contractor's form.

#### 1.05 CHANGE PROCEDURES

- A. The following documents will be used. Sample forms are attached.
- B. Request for Information: Standard Contractor form. A request for information shall be used by the Contractor to the Prime Consultant to request solutions to problems which are discovered during construction, to request drawings and cost and/or schedule impacts in the Request for Information.
- C. Instruction Notice: Attachment 1. standard form.
  - 1. Instruction Notice will be issued by the Prime Consultant for instructions to the Contractor which do not involve a change in the Contract Sum or construction period.
  - 2. Instruction Notice authorizes the Contractor to proceed at once with the instruction included therein.
  - 3. Instruction Notice which does affect the Contract Sum or construction period must have written authorization by the Owner's Project Manager. Such instruction shall have the note "Change Order to Follow" and then be followed with a Quotation Request, cross referenced to the Field Order.
  - 4. Instruction Notice will be distributed as follows:
    - a. Two copies to Contractor
    - b. One copy to the Prime Consultant
    - c. One copy to each appropriate Consultant
    - d. One copy to WHFD AND/OR PROJECT MANAGER
- D. Quotation Requests: Attachment 2, standard Prime Consultant form.
  - 1. Proposed changes to the Contract will be initiated by the Prime Consultant in the form of a Quotation Request.
  - 2. A Quotation Request, indicating the party suggesting the change, will clearly describe the proposed Contract variation, accompanied by the required drawings, if necessary.
  - 3. Construction work shall not proceed on the strength of a Quotation Request only.
  - 4. Quotation Requests will be distributed as follows:
    - a. Two copies to Contractor.
    - b. One copy to Prime Consultant

- c. One copy to each appropriate Consultant
- d. One copy to Owner's Project Management
- 5. The Contractor shall respond to the Quotation Request within the time stated on the form.
- E. Change Proposal. Standard Contract Form.
  - 1. This form shall be issued by the Contractor for any claims he may have and in response to a Quotation Request.
  - 2. The Change proposal shall include a description of the work and the requested change to the Contract sum and construction time.
  - 3. All supporting documents, materials and subcontract quotations, time sheets, labor estimates, etc., shall be itemized and attached to the Change Proposal as necessary for proper checking by the Prime Consultant, Consultants and Owner's Project Manager.
  - 4. Change proposals, if acceptable, will be signed by the WHFD AND/OR PROJECT MANAGER and Prime Consultant with one executed copy returned to Contractor. The Contractor shall thus have the authority to proceed with the work and Change Order will follow.
- F. Change Order. Attachment 3, standard form.
  - 1. This document is issued to the Contractor as an instruction for him to make a change to the work of the contract Documents.
  - 2. Change Order documents are prepared by the Prime Consultant and countersigned by the Owner and Contractor.
  - 3. Approved Change orders record the following information:
    - a. Cross-reference to Change Proposal.
    - b. Summarized description of change in work required.
    - c. Change in completion date.
    - d. Change in Contract sum.
    - e. Identification of party/individual initiating change.
- G. Record of Variations: Variations in construction from the plans and specifications shall be recorded by the Contractor as required in Division 1. These variations shall be brought to the attention of the Prime Consultant and WHFD ANS/OR PROJECT MANAGER by the Contractor.
- H. Timeliness of Processing: Instruction notices, Quotation Requests and Change Proposals will be processed and one copy provided the WHFD AND/OR PROJECT MANAGER the same day the document is prepared.

- I. Time and Material Change Order: Submit itemized account and supporting data after completion of change, within time limits indicated in the Conditions of the Contract Time as provided in the Contract Documents.
- J. Maintained detailed records of work done on Time and Material basis. Provide full information required for evaluation of proposed changes, and to substantiate costs for changes in the Work.

PART 2 - Products (Not Used)

PART 3 - Execution (Not Used)

## **OPTIONAL**

| INSTRUCTION NOTICE  |  |              |  |  |  |  |  |  |
|---|--|--------------|--|--|--|--|--|--|
| DATE:<br>PROJI  |  | PROJECT NO:  |  |  |  |  |  |  |
| Reference:  Specifications: Drawings: Other:  YOU ARE HEREBY DIRECTED TO PROMPTLY EXECUTE THIS INSTRUCTION NOTICE WHICH REPRESENTS THE CONTRACT DOCUMENTS OR ORDERS MINOR CHANGES IN THE WORK. If you consider that a change in Contract Sum or Contract Time is required, submit your itemized proposal to the Prime Consultant immediately and before proceeding with the work. If your proposal is found to be satisfactory and in proper order, this Instruction Notice will be superseded by a Change Order. |  |              |  |  |  |  |  |  |
| COPIE   | ES TO: WHFD AND/OR PROJECT MANAGER Contractor Prime Consultant Structural Mechanical Electrical Civil Landscape Others | Attachment 1 |  |  |  |  |  |  |

Kona Community Hospital HVAC Reheat System Improvements 01260-5 CONTRACT CONSIDERATIONS

## **OPTIONAL**

| QUOTATION REQUEST                           |  |  |  |  |  |  |  |  |
|---|--|--|--|--|--|--|--|--|
| QUOTATION<br>DATE:<br>PROJECT:<br>CONTRACTO | REQUEST NO:  Kona Community Hospital  HVAC Reheat System Improvements  PR:   | PROJECT NO:  |  |  |  |  |  |  |
| the contract.                               | y itemized quotation for the inclusion of t<br>This is not a Change Order, a Construction<br>o proceed with the work herein. | he following changes into<br>on Change Directive, nor an |  |  |  |  |  |  |
| DATE QUOTA                                  |  |  |  |  |  |  |  |  |

## **CHANGE ORDER**

| DATE:        | CH  | CHANGE ORDER NO: |             |                |            |
|--------------|---|------------------|-------------|----------------|------------|
| PROJECT:     | Kona Community Ho<br>HVAC Reheat Syste          |                  | ments       | PROJECT NO     |            |
| CONTRACTO    | OR:   |                  |             |                |            |
|              |   |                  |             |                |            |
|              |   |                  |             |                |            |
|              |   |                  |             |                |            |
|              |   |                  |             |                |            |
|              |   |                  |             |                |            |
|              |   |                  |             |                |            |
|              |   |                  |             |                |            |
|              |   |                  |             |                |            |
|              |   |                  |             |                |            |
|              |   |                  |             |                |            |
|              |   |                  |             |                |            |
|              |   |                  |             |                |            |
|              |   |                  |             |                |            |
|              |   |                  |             |                |            |
|              |   |                  |             |                |            |
| Original Con | tract Sum was:                                  |                  |             |                |            |
|              | by previously authors by prior to this Chang    |                  |             |                | \$<br>\$   |
| Contract sur | n will be (increased)                           | (decrease        | d) (unchang | ed) by this Ch | т          |
|              | ct Sum including this<br>t Time will be (increa |                  |             |                | \$<br>days |
|              | Substantial Completi                            |                  |             |                |            |
| PRIME CONS   | SULTANT:<br>TRACTOR:                            | WHFD             | AND/OR      | PROJECT        | MANAGER:   |
| Ву:          |   |                  |             | Date:          |            |
| Approved by  | /:<br>:   |                  |             | Date:          |            |
| Accepted by  | •   |                  |             | Date:          |            |

Attachment 3

Kona Community Hospital HVAC Reheat System Improvements 01260-7 CONTRACT CONSIDERATIONS

#### SECTION 01290 - PAYMENT PROCEDURES

#### **PART 1 - Products**

#### 1.01 GENERAL CONDITIONS

A. As specified in Division 1.

#### 1.02 RELATED SELECTIONS

A. Section 01260- CONTRACT CONSIDERATIONS for administrative procedures for handling changes to the Contract.

#### 1.03 DEFINITIONS

A. Schedule of Values: A statement furnished by Contractor allocating portions of the Contract Sum to various portions of the Work and used as the basis for reviewing Contractor's Application for Payment.

## 1.04 SCHEDULE OF VALUES

- A. Coordination: Coordinate preparation of the schedule of values with preparation of Contractor's construction schedule.
  - 1. Coordinate line items in the schedule of values with other required administrative forms and schedules, including the following:
    - a. Application for Payment forms with continuation sheets.
    - b. Submittal schedule.
    - c. Items required to be indicated as separate activities in Contractor's construction schedule.
  - 2. Submit the schedule of values to the Prime Consultant through the Hospital's Construction Management Representative at earliest possible date, but no later than seven days before the date scheduled for submittal of initial Applications for Payment.
- B. Format and Content: Use Project Manual table of contents as a guide to establish line items for the schedule of values. Provide at least one line item for each Specification Section.
  - 1. Identification: include the following Project identification on the schedule of values:
    - a. Project name and location.
    - b. Name of Prime Consultant.
    - c. Prime Consultant's project number.
    - d. Contractor's name and address.

- e. Date if submittal.
- 2. Arrange schedule of values consistent with format of AIA Document G703.
- 3. Arrange the schedule of values in tabular form with separate columns to indicate the following for each items listed:
  - a. Related Specification Section or Division.
  - b. Description of the Work
  - c. Name of subcontractor
  - d. Name of manufacturer or fabricator.
  - e. Name of supplier.
  - f. Change Orders (numbers) that affected value.
  - g. Dollar value of the following, as percentage of the Contract Sum to nearest on-hundredth percent, adjusted to total 100 percent.
    - 1) Labor
    - 2) Materials
    - 3) Equipment
- 4. Provide a breakdown of the Contract Sum in enough detail to facilitate continued evaluation of Applications for Payment and progress reports. Coordinate with Project Manual table of contents. Provide multiple line items for principal subcontract amounts in excess of two percent of the Contract Sum.
  - a. Include separate line items under Contractor and principal subcontracts for Project closeout requirements in an amount totaling two percent of the Contract Sum and subcontract amount.
- 5. Round amounts to nearest whole dollar; total shall equal the Contract Sum.
- 6. Provide separate line item in the schedule of values for each part of the Work where Applications for Payment may include materials or equipment purchased or fabricated and stored, but not yet installed.
  - a. Differentiate between items stored on-site and items stored off-site. If required, include evidence of insurance.
- 7. Provide separate line items in the schedule of values for initial cost of materials, for each subsequent stage of completion, and for total installed value of that part of the Work.

- 8. Each item in the schedule of values and Application for Payments shall be complete. Include total cost and proportionate share of general overhead and profit for each item.
  - a. Temporary facilities and other major cost items that are not direct cost of actual work-in-place may be shown either as separate line items in the schedule of values or distributed as general overhead expense, at Contractor's option.
- 9. Schedule Updating: Update and resubmit the schedule of values before the next Applications for Payment when Change Orders or Construction Change Directives result in a change in the Contract Sum.

#### 1.05 APPLICATIONS FOR PAYMENT

- A. Each Application for Payment following the initial Application for Payment shall be consistent with previous applications and payments as approved by the Hospital Construction Project Manager.
  - 1. Initial Application for Payment, Application for Payment at time of Substantial Completion, and final Application for Payment involve additional requirements.
- B. Payment Application Times: Each progress payment shall be submitted monthly.
- C. Payment Application Times: Submit Application for Payment to the Prime Consultant by the 5<sup>th</sup> day of the month. The period covered by each Application for Payment is one month, ending on the last day of the month.
- D. Application for Payment Forms: Use AIA G702 and Document AIA G703 or Contractor's own form as a form for Application for Payment.
- E. Application Preparation: Complete every entry on form. Contract number must be on every application for payment. The Prime Consultant will return incomplete applications, including those without the contract number, without action.
  - 1. Entries shall match data on the schedule of values and Contractor's construction schedule. Use updated schedules if revisions were made.
  - 2. Include amounts for work completed following previous Application for Payment, whether or not payment has been received. Include only amounts for work completed at time of Application for Payment.
  - 3. Include amounts of Change Orders and Construction Change Directives issued before last day of construction period covered by application.
  - 4. Indicate separate amounts for work being carried out under Owner-requested project acceleration.
- F. Stored Materials: Include in Application for Payment amounts applied for materials or equipment purchased or fabricated and stored, but not yet installed. Differentiate between items stored on-site and items stored off-site.

- 1. Provide supporting documentation that verifies amount requested, such as paid invoices. Match amount requested with amounts indicated on documentation; do not include overhead and profit on stored materials.
- G. Transmittal: submit signed Application for Payment to Hospital Construction Project Manager (electronically or by hand delivery). Include waivers of lien and similar attachments of required.
- H. Waivers of Mechanic's Lien: With each Application for Payment, submit waivers of mechanic's lien from entities lawfully entitled to file a mechanic's lien arising out of the contract and related to the Work covered by the payment.
  - 1. Submit partial waivers on each item for amount requested in previous application, after deduction for retainage, on each item.
  - 2. When application shows completion of an item, submit conditional final or full waivers.
  - 3. WHFD AND/OR PROJECT MANAGER reserves the right to designate which entities involved in the Work must submit waivers.
  - 4. Waiver forms: Submit executed waivers of lien on forms acceptable to Owner.
- I. Waiver of Mechanic's Lien: With each Application for Payment, submit waivers of mechanic's lien from subcontractors, sub-contractors, and suppliers for construction period covered by the previous application.
  - 1. Submit partial waivers on each item for amount requested in previous application, after deduction for retainage, on each item.
  - 2. When an application shows completion of an item, submit conditional final or full waivers.
  - 3. WHFD AND/OR PROJECT MANAGER reserves the right to designate which entities involved in the Work must submit waivers.
  - 4. Submit final Application for Payment with or proceeded by conditional final waivers from every entity involved with performance of the work covered by the application who is lawfully entitled to a lien.
  - 5. Waiver forms: Submit executed waivers of lien forms, acceptable to Owner.
- J. Initial Application for Payment: Administrative actions and submittals that must precede or coincide with submittal of first Application for Payment include the following:
  - 1. List of subcontractors.
  - 2. Schedule of values.
  - 3. Contractor's construction schedule (preliminary if not final).

- 4. Products list (preliminary if not final).
- 5. Schedule of unit prices.
- 6. Submittal schedule (preliminary of not final).
- 7. List of Contractor's staff assignments.
- 8. List of Contractor's principal's consultants.
- 9. Copies of building permits.
- 10. Copies of authorizations and licenses from authorities having jurisdiction for performance of the Work.
- 11. Initial progress report.
- 12. Report of preconstruction conference.
- 13. Certificates of insurance and insurance policies.
- 14. Performance and payment bonds.
- 15. Data needed to acquire Owner's insurance.
- K. Application for Payment at Substantial Completion: After Prime Consultant issues the Certificate of Substantial Completion, submit an Application for Payment showing 100 percent completion for potion of the Work claimed as substantially complete.
  - 1. Include documentation supporting claim that the Work is substantially complete and a statement showing an accounting of changes to the Contract sum.
  - 2. This application shall reflect Certificate(s) of Substantial Completion issued previously for Owner occupancy of designated portions of the Work.
- L. Final Payment Application: After completing Project closeout requirements, submit final Application for Payment with releases and supporting documentation not previously submitted and accepted, including, but not limited, to the following:
  - 1. Evidence of completion of Project closeout requirements.
  - 2. Insurance certificates for products and completed operations where required and proof that taxes, fees, and similar obligations were paid.
  - 3. Updated final statement, accounting for final changes to the Contract Sum.
  - 4. AIA Document G706, "Contractor's Affidavit of Payment of Debts and Claims".
  - 5. AIA Document G706A, "Contractor's Affidavit of Releases of Liens".

- 6. AIA Document G707, "Consent of Surety to Final Payment".
- 7. Evidence that claims have been settled.
- 8. Final liquidated damages settlement statement.
- 9. Alternate forms may be utilized with approval from the WHFD AND/OR PROJECT MANAGER & Contracts Manager

PART 2 - Products (Not Used)

PART 3 - Execution (Not Used)

#### SECTION 01310 - PROJECT MANAGEMENT AND COORDINATION

#### PART 1 - General

#### 1.01 SECTION INCLUDES

- A. General Coordination procedures
- B. Coordination drawings.
- C. Requests for information (RFI's)
- D. Project Web site.
- E. Project Meetings.

#### 1.02 RELATED SECTIONS

A. Section 01770 "CLOSEOUT PROCEDURES" for coordinating closeout of the Contract.

#### 1.03 DEFINITIONS

A. RFI: (Request for Information), the Prime Consultant for seeking information required by or clarifications of the Contract Documents.

#### 1.04 INFORMATION SUBMITTALS

- A. Subcontract List: Prepare a written summary (provided herein as Attachment 4) identifying individuals or firms proposed for each portion of the Work, including those who are to furnish products or equipment fabricated to a special design. Included the following information in tabular form:
  - 1. Name, address and telephone number of company performing subcontract or supplying products.
  - 2. The particular work to be performed by subcontractor.
- B. Key personnel Names: Within 7 days of starting construction operations, submit a list of key personnel assignments, including superintendent and other personnel in attendance at Project site. Identify individuals and their duties and responsibilities; list addresses and telephone numbers, including home, office and cellular telephone numbers and e-mail addresses. Provide names, addresses and telephone numbers of individuals assigned as alternates in the absence of individuals assigned to Project.
  - 1. Post copies of list in project meeting room, in temporary field office and by each temporary telephone. Keep list current at all times.

#### 1.05 GENERAL COORDINATION PROCEDURES

A. Coordination: Coordinate construction operations included in different Sections of the Specifications to ensure efficient and orderly installation of each part of the

Work. Coordinate construction operations, included in different Sections that depend on each other for proper installation, connection, and operation.

- 1. Schedule construction operations in sequence required to obtain the best results where installation of one part of the Work depends on installation of other components, before or after its own installation.
- 2. Coordinate installation of different components to ensure maximum performance and accessibility for required maintenance, service, and repair.
- 3. Make adequate provisions to accommodate items scheduled for later installation.
- B. Coordination: Each contractor shall coordinate its construction operations with those of other contractors and entities to ensure efficient and orderly installation of each part of the Work. Each contractor shall coordinate its operations with operations, included in different Sections that depend on each other for proper installation, connection, and operations.
  - 1. Schedule construction operations in sequence required to obtain the best results where installation of one part of the Work depends on installation of other components, before or after its own installation.
  - 2. Coordinate installation of different components with other contractors to ensure maximum performance and accessibility for required maintenance, service, and repair.
  - 3. Make adequate provisions to accommodate items scheduled for later installation.
- C. Prepare memoranda for distribution to each party involved, outlining special procedures required for coordination. Include such items as required notices, reports and list of attendees at meetings.
  - 1. Prepare similar memoranda for Owner and separate contractors of coordination of their Work is required.
- D. Administrative Procedures: Coordinate scheduling and timing of required administrative procedures with other construction activities and (activities of other contractors) to avoid conflicts and to ensure orderly progress of the Work. Such administrative activities include, but are not limited to, the following:
  - 1. Preparation of Contractor's construction schedule.
  - 2. Preparation of the schedule of values.
  - 3. Installation and removal of temporary facilities and controls.
  - 4. Delivery and processing of submittals.
  - 5. Progress meetings.
  - 6. Pre-installation of conferences.

- 7. Project closeout activities.
- 8. Startup and adjustment of systems.
- E. Conservation: Coordinate construction activities to ensure that operations are carried out with consideration given to conservation of energy, water, and materials. Coordinate use of temporary utilities to minimize waste.
  - 1. Salvage materials and equipment involved in performance of but not actually incorporated into, the Work. See other Sections for disposition of salvaged materials that are designed as Owner's property.

#### 1.06 COORDINATION DRAWINGS

- A. Coordination Drawings, General: Prepare coordination drawings according to requirements in individual Sections, and additionally where installation is not completely shown on Shop Drawings, where limited space availability necessitates coordination, or if coordination is required to facilitate integration of products and materials fabricated or installed by more than one entity.
  - 1. Content: Project-specific information, drawn accurately to a scale large enough to indicate and resolve conflicts. Do not base coordination drawings on standard printed data. Include the following information, as applicable:
    - a. Use applicable Drawings as a basis for preparation of coordination drawings. Prepare sections, elevations, and details as needed to describe relationship of various systems and components.
    - b. Coordinate the addition of trade-specific information to the coordination drawings by multiple contracts in a sequence that best provides for coordination of the information and resolution of conflicts between installed components before submitting for review.
    - c. Indicate functional and spatial relationships of components of architectural, structural, civil, mechanical, and electrical systems.
    - d. Indicate space requirements for routine maintenance and for anticipated replacement of components during the life of the installation.
    - e. Show location and size of access doors required for access to concealed dampers, valves, and other controls.
    - f. Indicate required installation sequences.
    - g. Indicate dimensions show in the Drawings. Specifically note dimensions that appear to be in conflict with submitted equipment and minimum clearance requirements. Provide alternate sketches to Prime Consultant indicating proposed resolution of such conflicts. Minor dimensions changes and difficulty installations will not be considered changes to the Contract.
- B. Coordinating Drawing Organization: Organize coordination drawings as follows:

- Floor Plans and Reflected Ceiling Plans: Show architectural and structural elements and mechanical, plumbing, fire-protection, fire-alarm and electrical work. Show locations of visible ceiling-mounted devices relative to acoustical ceiling grid. Supplement plan drawings with section drawings where required to adequately represent the Work.
- 2. Plenum Space: indicate subframing for support of ceiling and wall systems, mechanical and electrical equipment, and related work. Locate components within ceiling plenum to accommodate layout of light fixtures indicated on Drawings. Indicate areas conflict between light fixtures and other components. All work to be seismically anchored utilizing TOLCO system.
- 3. Mechanical rooms: Provide coordination drawings for mechanical rooms showing plans and elevations of mechanical, plumbing, fire-protection, fire-alarm, and electrical equipment.
- 4. Structural Penetrations: Indicate penetrations and openings required for all disciplines.
- 5. Slab Edge and Embedded items: Indicate slab edge locations and sizes and locations of embedded items for metal fabrications, sleeves, anchor bolts, bearing plates, angles, door floor closers, slab depressions for floor finishes, curbs and housekeeping pads, and similar items.
- 6. Mechanical and Plumbing Work: Show the following:
  - a. Sizes and bottom elevations of ductwork, piping, and conduit runs, including insulation, bracing, flanges and support systems. All work to be seismically anchored using TOLCO system.
  - b. Dimensions of major components, such as dampers, valves, diffusers, access doors, cleanouts and electrical distribution equipment.
  - c. Fire -rated enclosures around ductwork.
- 7. Electrical Work: Show the following:
  - a. Runs of vertical and horizontal conduit 1-1/4 inches (32 mm) in diameter and larger.
  - b. Light fixture, exit light, emergency battery pack, smoke detector, and other fire-alarm locations.
  - c. Panel board, switch board, switchgear, transformer, busway, generator, and motor control center locations.
  - d. Location of pull boxes and junction boxes, dimensioned from column center lines.
- 8. Fire-Protection System: Show the following:

- a. Locations of standpipes, main piping, branch lines, pipe drops and sprinkler heads.
- 9. Review: Prime Consultant will review coordination drawings to confirm that the Work is being coordinated, but not for the details of the coordination, which are Contractor's responsibility. If Prime Consultant determines that coordination drawings are not being prepared in sufficient scope or details, or are otherwise deficient, Prime Consultant will so inform Contractor, who shall make changes as direct and resubmit.
- 10. Coordination Drawing Prints: Prepare coordination drawing prints according to requirements on Section 013300 "Submittal Procedures".
- C. Coordination Digital Data Files: Prepare coordination digital data files according to the following requirements:
  - 1. File Preparation Format: Same digital data software program, version, and operating system as original Drawings.
  - 2. File Submittal Format: Submit or post coordination drawing files using Portable Data File (PDF) format.
  - 3. Prime Consultant will furnish Contractor one set of digital data files of Drawings for use in preparing coordinated digital data files.
    - a. Digital Data Software Program: Drawings are available in AutoCAD 2010.
    - b. Contractor shall execute a data licensing agreement in the form of Agreement form acceptable to WHFD AND/OR PROJECT MANAGER and Prime Consultant, if required by either party.

#### REQUESTS FOR INFORMATION (RFI'S) 1.07

- A. General: Immediately of discovery of the need for additional information or interpretation of the Contract Documents, Contractor shall prepare and submit an RFI in the form specified to WHFD AND/OR PROJECT MANAGER.
  - 1. All RFIs must be submitted directly by the Contractor of record. Prime Consultant will return RFI submitted to Prime Consultant by other entities controlled by Contractor with no response.
  - 2. Coordinate and submit RFIs in a prompt manner so as to avoid delays in Contractor's work or work of subcontractors.
- B. Content of the RFI: Include a detailed, legible description of item needing information or interpretation and the following:
  - 1. Project name.
  - 2. Project number.
  - 3. Date.

- 4. Name of Contractor.
- 5. Name of Project Engineer.
- 6. RFI number, number sequentially.
- 7. RFI subject.
- 8. Specification Section number and title and related paragraphs, as appropriate.
- 9. Drawing number and detail references, as appropriate.
- 10. Field dimensions and conditions, as appropriate.
- 11. Contractor's suggested resolution. If Contractor's suggested resolution impacts the Contract Time or the Contract Sum, Contractor shall state impact in the RFI.
- 12. Contractor's signature.
- 13. Attachments: Include sketches, description, measures, photos, Product Data, Shop Drawings, coordination drawings, and other information necessary to fully describe items needing interpretation.
  - a. Include dimensions, thickness, structural grid references, and details of affected materials, assemblies, and attachments on attached sketches.
- 14. Response turnaround time needed.
- C. RFI Forms: Contractor's form
  - 1. Attachment shall be electronic files preferably in Adobe Acrobat PDF format.
- D. Project Prime Consultant's Action: Project Prime Consultant will review each RFI, determine action required and respond within requested response time, typically 3 working days unless quicker response is needed as to not delay the project.
  - 1. The following Contract-generated RFIs will be returned without action:
    - a. Requests for approval of submittals.
    - b. Requests for approval of substitutions.
    - c. Requests for approval of Contractor's mean and methods.
    - d. Requests for coordination information already indicated in the Contract Documents.
    - e. Requests for adjustment in the Contract Time or Contract Sum.
    - f. Requests for interpretation of Prime Consultant's actions on submittals.

- g. Incomplete RFIs or inaccurately prepared RFIs.
- 2. The Prime Consultant's action may include a request for additional information, in which case the time for response will date from time of receipt of additional information.
- 3. The Project Prime Consultant's action on RFIs that may result in a change to the Contract Time or the Contract sum may be eligible for Contractor to submit Change Proposal according to Section 012600 "Contract Modification Procedures".
  - a. If Contractor believes the RFI response warrants change in the Contract Time or the Contract Sum, notify the WHFD AND/OR PROJECT MANAGER in writing within 3 days of receipt of the RFI response.
- E. RFI Log: Prepare, maintain, and submit a tabular log of RFIs organized by the RFI number. Submit log weekly to Prime Consultant.
  - 1. Project name.
  - 2. Name and address of Contractor.
  - 3. Name and address of Project Prime Consultant.
  - 4. RFI numbering including RFIs that were returned without action or withdrawn.
  - 5. RFI description.
  - 6. Date when the RFI was submitted.
  - 7. Date when the Prime Consultant's response was received.

#### 1.08 PROJECT MEETINGS

- A. General: Schedule and conduct meetings and conferences ar Project site unless otherwise indicated
  - 1. Attendees: Inform participants and others involved, and individuals whose presence is required, of date and time of each meeting. Notify WHFD AND/OR PROJECT MANAGER and Prime Consultant of scheduled meeting dates and times. It is preferred that a standing meeting day/time is planned at the commencement of the project.
  - 2. Agenda: Contractor shall prepare the meeting agenda. Distribute the agenda to all invited attendees.
  - 3. Sign in Sheet: Furnish and supply a copy of completed sheet to KCH.
  - 4. Minutes: Entity responsible for conducting meeting will record significant discussions and agreements achieved. Distribute the meeting minutes to all meeting attendees within three business days of the meeting.

- B. Preconstruction Conference: the WHFD AND/OR PROJECT MANAGER will schedule and conduct a preconstruction conference before starting construction, at a time convenient to the Hospital, Contractor, and Project Prime Consultant, but no later than 15 days after execution of the Agreement.
  - 1. Conduct the conference to review responsibilities and personnel assignments.
  - Attendees: Authorized representatives of WHFD AND/OR PROJECT MANAFER, the Prime Consultant and their consultants; Contractor and its superintendent; major subcontractors; suppliers and other concerned parties. Participants at the conference shall be familiar with Project and authorized to conclude matters relating to the Work.
  - 3. Agenda: Discuss items if significance that could affect progress, including the following:
    - a. Tentative construction schedule.
    - b. Critical work sequencing and long-lead items.
    - c. Designation of key personnel and their duties.
    - d. Lines if communications.
    - e. Procedures for processing field decisions and Change Orders.
    - f. Procedures for RFIs
    - g. Procedures for testing and inspecting.
    - h. Procedures for processing Application for Payment.
    - i. Distribution of the Contract Documents.
    - j. Submittal procedures.
    - k. Use of the premises.
    - I. Work restrictions.
    - m. Working hours.
    - n. Owner's occupancy requirements.
    - o. Responsibility for temporary facilities and controls.
    - p. Procedures for moisture and mold
    - g. Procedures for disruption and shutdowns.
    - r. Parking availability.

- s. Office, work, and storage areas.
- Equipment deliveries and properties.
- u. Security.
- 4. Minutes: The Contractor will be responsible for conduction meeting, will record and distribute meeting minutes.
- C. Preinstall Conferences: Conduct a preinstallation conference at Project Site before each construction activity that requires coordination with other construction.
  - 1. Attendees: Installer and representatives of manufacturers and fabricators involved in or affected by the installation and its coordination or integration with other materials and installation that have preceded or will follow, shall attend the meeting. Advise the WHFD AND/OR PROJECT MANAGER, Project Prime Consultant of scheduled meeting dates.
  - 2. Agenda: Review progress of other construction activities and preparations for the particular activity under consideration, including requirements to the following:
    - a. Contract Documents.
    - b. Options.
    - c. Related RFIs.
    - d. Related Change Orders.
    - e. Purchases.
    - f. Deliveries.
    - g. Submittals.
    - h. Possible conflicts.
    - Compatibility requirements.
    - Time schedules.
    - k. Weather limitations.
    - Manufacturer's written instructions.
    - m. Warranty requirements.
    - n. Compatibility of materials.
    - Acceptability of substrates.

- p. Temporary facilities and controls.
- q. Space and access limitations.
- r. Regulations of authorities having jurisdiction.
- s. Testing and inspecting requirements.
- t. Installation procedures.
- u. Coordination with other work.
- v. Required performance results.
- w. Protection of adjacent work.
- x. Protection of construction and personnel.
- 3. Record significant conference discussions, agreement, and disagreements, including required corrective measures and actions.
- 4. Reporting: Distribute minutes of the meeting to each party present and to other parties requiring information.
- 5. Do not proceed with installation if the conference cannot be successfully concluded. Initiate whatever actions are necessary to resolve impediments to performance of the Work and reconvene the conference at earliest feasible date
- D. Progress Meetings: Conduct progress meetings at weekly intervals.
  - 1. Coordinate dates of meetings with preparation of payment requests.
  - 2. Attendees: Representatives of the WHFD AND/OR PROJECT MANAGER, and the Contractor. The Project Prime Consultant may call in by telephone, but once a month, attend the meeting site. The Prime Consultantural consultants and Contractor's subcontractors may attend upon request.
  - 3. Agenda: Review and correct or approve minutes of previous progress meeting. Review other items of significance that could affect progress. Include topics for discussion as appropriate to status of Project.
    - a. Contractor's Construction Schedule: Review progress since the last meeting. Determine whether each activity is on time, ahead of schedule or behind schedule, in relation to Contractor's construction schedule. Determine how construction behind schedule will be expedited; secure commitments from parties involved to do so. Discuss whether schedule revisions are required to ensure that current and subsequent activities will be completed within the Contract Time.
      - 1) Review schedule for next period

- b. Review present and future needs of each entity present, including the following:
  - 1) Interface requirements.
  - 2) Sequence of operations.
  - 3) Owner operation issues/security.
  - 4) Status of submittals.
  - 5) Deliveries.
  - 6) Off-site fabrication.
  - 7) Access
  - 8) Temporary facilities and controls.
  - 9) Status of RFIs.
  - 10) Status of proposed requests.
  - 11) Pending changes.
  - 12) Status of change Orders.
  - 13) Pending claims and disputes.
- 4. Minutes: The Contractor that is responsible for conducting the meeting will record and distribute the meeting minutes to each party present and to parties requiring information.
  - a. Schedule Updating: Revise Contractor's construction schedule after each progress meeting where revisions to the schedule have been made recognized. Issue revised schedule concurrently with the report of each meeting.

PART 2 - Products (Not Used)

PART 3 - Execution (Not Used)

#### SECTION 01330 – SUBMITTAL PROCEDURES

#### PART 1 - General

#### 1.01 <u>SECTION INCLUDES</u>

- A. Submittal procedures.
- B. Construction progress schedules.
- C. Proposed Products list.
- D. Shop Drawings.
- E. Product Data.
- F. Samples.
- G. Manufacturer's installation instructions.
- H. Manufacturer's certificates.

#### 1.02 RELATED SECTIONS

A. Section 01400- QUALITY REQUIREMENTS: Manufacturer's field services and reports.

#### 1.03 <u>DEFINITIONS</u>

- A. Action Submittals: Written and graphic information that requires Prime Consultant's responsive action.
- B. Informational Submittals: Written information that does not require Prime Consultant's approval. Submittals may be rejected for not complying with requirements.

#### 1.04 <u>SUBMITTAL PROCEDURES</u>

- A. Transmit each submittal with AIA Form G810 or project Prime Consultant's accepted transmittal form.
  - 1. Identify whether submittal is an action submittal or informational submittal.
  - 2. Submit the number of duplicate documents and samples schedule in Part 3 below.
- B. Sequentially number the transmittal form. Reverse submittals with original number and a sequential alphabetical suffix.
- C. Identify Project Contractor, Subcontractor or supplier, pertinent drawing and detail number, and specification section number, as appropriate.

- D. Apply Contractor's wax seal, signed or initialed certifying that review, verification of Products required, field dimensions, adjacent construction Work, and coordination of information, is in accordance with the requirements of the Work and Contract Documents.
- E. Schedule submittals to expedite the Project, and deliver to Prime Consultant at business address. Coordinate submission of related items.
- F. For each submittal for review, allow 5 days excluding delivery time and from the contractor.
- G. Identify variations from Contract Documents and Product of system limitations which may be detrimental o successful performance of the completed Work.
- H. Submit all items relating to color selection at one time. Color selections will not be made until all color related submittals have been received.
- I. Provide space for Contractor, Project Prime Consultant, and Consultants review stamps or initials.
- J. Review and Resubmission of Submittals
  - 1. The Project Prime Consultant will review the submittal and stamp or initial it with indication of action as appropriate. Project Prime Consultant will retain one copy or and furnish one copy to Contractor. Consultants will retain one copy.
  - 2. Submittals returned marked "resubmit" or "rejected". Make corrections and resubmit.
    - a. Direct specific attention on resubmittals to revision other than those requested by the Project Prime Consultant on previous submittals.
    - b. Make shop drawing corrections on the original drawing and print.
  - 3. Submittals returned with markings or comments and marked "confirm". Submit a letter indicating acceptance of comments and stating that Contractor will comply with marks and comments.
  - 4. Submittals returned marked "No Exceptions Taken". Submit number of copies mechanical and electrical items with Contractor.
- K. Distribute copies of reviewed submittals as appropriate. Instruct parties to promptly report any inability to comply with provisions.
- L. Submittal is not requested will not be recognized or processed.

#### 1.05 CONSTRUCTION PROGRESS SCHEDULES

A. Submit as part of the Monthly Report required by the Owner-Contractor Agreement.

#### 1.06 PROPOSED PRODUCTS LIST

- A. Submit list of major products proposed for use, with name of manufacturer, trade name, and model number of each product.
- B. For products specified only by reference standards, give manufacturer, trade name, model or catalog designation, and reference standards.

#### 1.07 SHOP DRAWINGS

- A. Present in a clear and thorough manner, accurately and at a scale sufficient to show pertinent aspects. Indicate fabrication, layout, anchorage and installation details.
- B. Title each drawing. Identify details by reference to Contract Drawing and detail numbers.
- C. Indicate special utility and electrical characteristics, utility connection requirements, and location of utility outlets for service for functional equipment and appliances.
- D. Drawing Size: Minimum 8-1/2 inches by 11 inches and maximum 30 inches by 42 inches.
- E. Shop Drawings: Submit review. After review, produce copies and distribute in accordance with the SUBMITTAL PROCEDURES article above.

#### 1.08 PRODUCT DATA

- A. Clearly mark each copy to identify each applicable product, model, option, and pertinent data for the products or systems to be provided. Supplement manufacturers' standard data to provide information unique to this Project. Highlighting will not be acceptable.
- B. Indicate Product utility and electrical characteristics, utility connection requirements, and location of utility outlets for service for functional equipment and appliances.
- C. After review distribute in accordance with the Submittal Procedures article above.

#### 1.09 SAMPLES

- A. Submit samples to illustrate functional and aesthetic characteristics of the Product, with integral parts and attachment devices. Coordinate sample submittals for interfacing work.
- B. Submit samples of finishes from the full range of manufacturers' standard colors, textures, and patterns for Prime Consultant selection.
  - 1. Provide custom color samples where requested.
- C. Reviewed samples which may be used in the Work are indicated in individual specification sections.

#### PART 2 - Products (Not Used)

#### PART 3 - Execution

## 3.01 SCHEDULE OF SUBMITTALS

- A. Product Data, Schedules, Shop Drawings and Other Printed Materials: Submit the number of copies which the Contractor requires, plus copies for the following:
  - 1. One copy: Project Prime Consultant.
  - 2. One copy: WHFD AND/OR PROJECT MANAGER.
  - 3. One copy: Hospital Construction Project Manager.
  - 4. Copies as required from consultants.
- B. Samples: Submit the number of samples which the Contractor requires plus one for WHFD AND/OR PRJECT MANAGER and Contracts Manager.

#### **SECTION 01400 - QUALITY REQUIREMENTS**

#### PART 1 - General

#### 1.01 <u>SECTION INCLUDES</u>

- A. Quality assurance and control of installation.
- B. Reference.
- C. Inspection and testing laboratory services.
- D. Special inspections.
- E. Manufacturers' field services and reports.

## 1.02 RELATED SECTIONS

- A. Section 01300 SUBMITTAL PROCEDURES: Submissions of Manufacturers" Instruction and Certificates.
- B. Section01600 PRODUCT REQUIREMENTS: Requirements for material and product quality.

#### 1.03 QUALITY ASSURANCE/CONTROL OF INSTALLATION

- A. Monitor quality control over suppliers, manufacturers, Products, services, site conditions, and workmanship, to produce Work of specified quality.
- B. Comply fully with manufacturers" instructions, including each step-in sequence.
- C. Should manufacturers' instructions conflict with Contract Documents, request clarification from Prime Consultant before proceeding.
- D. Comply with specified standards as a minimum quality for the Work except when more stringent tolerances, codes, or specified requirements indicate higher standards or more precise workmanship.
- E. Perform work by persons qualified to produce workmanship of specified quality.
- F. Secure Products in place with positive anchorage devices designed and sized to withstand stresses, vibration, physical distortion or disfigurement.

#### 1.04 REFERENCES

- A. Conform to reference standard by date of issue current on date for receiving bids.
- B. Obtain copies of standards when required by Contract Documents.
- C. Should specified reference standards conflict with Contract Documents, request clarification from Prime Consultant before proceeding.

D. The contractual relationship of the parties to the Contract shall not be altered from the Contract Documents by mention or inference otherwise in any reference document.

#### 1.05 INSPECTION AND TESTING LABORATORY SERVICES

- A. When the individual specifications sections require it, the Contractor shall appoint, employ, and pay for services of an independent firm to perform inspection and testing. Seismic testing will need to be performed by a special inspector. Contractor to coordinate inspection, but KCH will pay for said inspection directly. TAB to be arranged and paid for by the contractor at substantial completion or other date agreed upon by all parties.
- B. Services will be performed in accordance with requirements of governing authorities and with specified standards.
- C. Reports will be submitted by the independent firm to the Prime Consultant, in duplicate, indicating observations and results of tests and indicating compliance or non-compliance with Contract Documents.
- D. Cooperate with independent firm; furnish samples of materials, design mix, equipment, tools, storage and assistance as requested.
  - 1. Notify WHFD AND/OR PROJECT MANAGER and independent firm 24 hours prior to expected time for operations required services.
  - 2. Make arrangements with independent firm and pay for additional samples and tests required for Contractor's use.
- E. Retesting required because of non-conformance to specified requirements shall be performed by the same independent firm on instructions by WHFD AND/OR PROJECT MANAGER and shall be paid by the Contractor.

## 1.06 SPECIAL INSPECTIONS

A. Owner will employ Special Inspectors acceptable to Hawaii County to perform inspection on various elements of the work as required by Building Code as locally adopted. During the course of the work under inspection, each Special Inspector will submit detailed reports relative to progress and conditions of the work including deviations from specified requirements and stipulating dates, times, and locations. Special inspector will submit a final report to the County. Contractor must cooperate fully with Special Inspectors.

## 1.07 MANUFACTURER'S FIELD SERVICES AND REPORTS

- A. Submit qualification of observer to the WHFD AND/OR PROJECT MANAGER 30 days in advance of required observations. Observer subject to approval of the Prime Consultant and the WHFD AND/OR PROJECT MAANGER.
- B. When specified in individual specification Sections, require material or Product suppliers or manufacturers to provide qualified staff personnel to observe site

- conditions, conditions of surfaces and installation, quality of workmanship, start-up of equipment or to test, adjust, and balance of equipment as applicable, and to initiate instruction when necessary.
- C. Individuals to report observations and site decisions or instructions given to applicators or installers that are supplemental or contrary to manufacturer's written constructions.
- D. Submit two (2) copies of report written by representative, both to the Owner and to the Project Engineer listing observations and recommendations, within five (5) days of observation.

PART 2 - Products (Not Used)

PART 3 - Execution (Not Used)

#### SECTION 01500 - TEMPORARY FACILITIES AND CONTROLS

#### PART 1 - General

## 1.01 <u>SECTION INCLUDES</u>

- A. Requirements for temporary facilities and controls, including temporary utilities, support facilities, and security and protection facilities.
- B. Temporary utilities may include, but not limited to, the following:
  - 1. Sewers and drainage
  - 2. Water service and distribution
  - 3. Sanitary facilities, including toilets, wash facilities and drinking water facilities.
  - 4. Electric power service
  - 5. Lighting
  - 6. Telephone service.
- C. Support facilities include, but are not limited to, the following:
  - 1. Project identification and temporary signs.
  - 2. Construction aids and miscellaneous services and facilities.
- D. Security and protection facilities may include, but are not limited to, the following:
  - 1. Environmental protection.
  - 2. Stormwater control.
  - 3. Tree and plant protection.
  - 4. Pest control
  - 5. Site enclosure fence.
  - 6. Security enclosure and lockup.
  - 7. Barricade, warning signs, and lights.
  - 8. Fire protection.

### 1.02 RELATED DOCUMENTS

A. Refer to Drawings for additional requirements for temporary protection.

### 1.03 RELATED SECTIONS

A. Section 01330 SUBMITTAL PROCEDURES for procedures for submitting copies of implementation and termination schedule and utility reports.

### 1.04 USE CHARGES

- A. General: Cost or use charges for temporary facilities will be paid by the Contractor. Employ means and methods for conservation.
  - 1. Temporary electricity.
  - 2. Temporary water.

### 1.05 PROJECT CONDITIONS

- A. Temporary Utilities: At earliest feasible time, when acceptable to WHFD AND/OR PROJECT MANAGER Manager change over from use of temporary service to use of permanent service.
  - 1. Temporary Use of Permanent Facilities: Installer of each permanent service shall assume responsibility for operation, maintenance, and protection of each permanent service during its use as a construction facility before Owner's acceptance, regardless of previously assigned responsibilities.
- B. Conditions of Use: The following conditions apply to use of temporary services and facilities by all parties engaged in the Work:
  - 1. Keep temporary services and facilities clean and neat.
  - 2. Relocate temporary services and facilities as required by progress of the Work.

#### **PART 2 - Products**

### 2.01 MATERIALS

- A. Tarpaulins: Fire-resistive labeled with flame-spread rating of 15 or less.
- B. Water: Potable

### 2.02 EQUIPMENT

- A. Fire Extinguishers: Hospital will provide fire extinguishers. Hand carried, portable, UL rated. Provide class and extinguishing agents as indicated or a combination of extinguishers of NFPA-recommended classes for exposures.
  - 1. Comply with NFPA 10 and NFPA 241 for classification, extinguishing agent, and size required by location and class of fire exposure.
- B. Self-Contained Toilet units, if necessary Single occupant units of chemical, aerated recirculation or combustion type; vented; fully enclosed with a glass-fiber-reinforced polyester shell or similar non-absorbent material.

- C. Electrical Outlets: Properly configured, NEMA-polarized outlets to prevent insertion of 110 to 120V plugs into higher-voltage outlets; equipped with ground-fault circuit interrupters, reset button, and pilot light.
- D. Power Distribution System Circuits: Where permitted and overhead and exposed for surveillance, wiring circuits, not exceeding 125-V AC, 20-A rating, and lighting circuits may be nonmetallic sheathed cable.

#### PART 3 - Execution

### 3.01 INSTALLATION, GENERAL

- A. Locate facilities where they will serve Project adequately and result in minimum interference with performance of the Work. Relocate and modify facilities as required.
- B. Provide each facility ready for use when needed to avoid delay. Maintain and modify as required. Do not remove until facilities are no longer needed or are replaced by authorized use of completed permanent facilities.

### 3.02 TEMPORARY UTILITY INSTALLATION

- A. General: Engage appropriate local utility company to install temporary service or connect to serve connections provided under the Work of the Project. Where utility company provides only part of the service, provide the remainder with matching, compatible materials and equipment. Comply with utility company recommendations.
  - 1. Provide adequate capacity at each stage of construction. Before temporary utility is available, provide trucked0in services.
  - 2. Obtain easements to bring temporary utilities to Project site where Owner's easements cannot be used for that purpose.
  - 3. Install 50 amp 125/250v job box, if necessary.
  - 4. Sewers and Drainage: If sewers are available, provide temporary connections to remove effluent that can be discharged lawfully.
- B. Water Service: Connect to existing water source for construction operations.
- C. Sanitary Facilities: Existing designated facilities may be used during construction operations. Maintain daily in clean and sanitary condition,
- D. Electric Power Service: Connect to existing power service. Power consumption shall not disrupt hospital's need for continuous service.
- E. Lighting: Provide temporary lighting with local switching that provides adequate illumination for construction operations and traffic conditions.

### 3.03 SUPPORT FACILITIES INSTALLATION

- A. Environmental Protection: Provide protection, operate temporary facilities, and conduct construction in ways and by methods that comply with environmental regulation and that minimize possible air, waterway, and subsoil contamination or pollution or other undesirable effects.
  - 1. Cooperate and comply with hospital's Environmental Management Plan.

#### B. Noise Control:

- 1. Obtain noise permit or permit as required by Chapter 43 State of Hawaii Department of Health regulations.
- 2. muffle internal combustion engine powered equipment to minimize noise and properly maintain to reduce noise to acceptable levels.
- 3. Blasting and use of explosives will be not permitted.
- 4. Activities of severe and prolonged noise and vibration must be approved in advance by WHFD AND/OR PROJECT MANAGER. Submit written notice not less than seven days in advance of intended noise producing activity.

#### C. Dust Control:

- 1. Keep dust within acceptable levels at all times, including non-working hours, weekends and holidays, in conformance with Chapter 31 Air Pollution of State Departments of Health, Public Health Regulations, latest editions.
- 2. Only wet grinding or cutting of concrete will be allowed on exterior surfaces.
- 3. Mechanical dry sweeping not permitted. Vacuuming, wet mopping, approved limited dry hand, wet or damp sweeping is acceptable utilizing the hospital's EPA approved disinfectant.
- 4. During loading operations, water down debris and waste materials to allay
- 5. Air scrubbers utilized for dust control costs incurred are the responsibility of the Contractor.
- 6. Use wet/sticky mats at all entrances to work area to control dust. Replace daily at a minimum.
- 7. The Contractor is responsible for damage claims.
- 8. ICRA during construction/renovation KCH Policy 125.54 must be adhered to.

### D. Hazardous materials:

1. Asbestos, urea formaldehyde and other hazardous materials are not expected but may be present in the existing structures subject to alteration.

- Observe the applicable requirements of Hawaii Occupational Safety and health Standards and the Environmental Protection Agency.
- 2. If the presence of toxic substances is determined, notify the WHFD AND/OR PROJECT MANAGER immediately to determine the next course of action.
- 3. Do not begin demolition when toxic substances are present until occupants of the building are moved to other facilities or are separated from the exposure by assured means.
- 4. In removing and disposing of toxic substances, observe the following requirements:
  - a. Provide air-tight compartments within which the toxic substances may be removed.
  - b. In lieu of air0tight compartments, provide competent controlled misting or dust settling agent.
  - c. Place toxic substances in properly labeled sacks of at least 8 mil polypropylene.
- Must adhere to KCH Hazmat Material and Waste Management Program
   Policy 122-6 and Clean up of Spills, Hazardous and Infectious Policy 122-6-2.
   (If any differences are discovered between RFP and KCH policies, KCH
   policies shall prevail.)
- E. Temporary Fire Protection: Until fire-protection needs are supplied by permanent facilities, install and maintain temporary fire-protection facilities of types needed to protect against reasonably predictable and controllable fire losses. Comply with NFPA 241.
  - 1. Hospital will provide fire extinguishers.
    - a. Field Offices: Class A stored-pressure water-type extinguishers.
    - b. Locate fire extinguishers where convenient and effective for their intended purpose; provide not less than one extinguisher on each floor at or near each usable stairwell.
  - 2. Store combustible materials in containers in fire-safe locations.
  - 3. Maintain unobstructed access to fire extinguishers, fire hydrants, temporary fire-protection facilities, stairways, and other access routes for firefighting. Prohibit smoking in hazardous fire-exposed areas.
  - 4. Supervise welding operations, and similar sources of fire ignition.
  - 5. Permanent Fire Protection: At earliest feasible date in each area of Project, complete installation of permanent fire-protection facility, including connected services, and place into operation and use. Instruct key personnel on use of facilities.

6. Develop and supervise an overall fire-prevention and first-aid fire-protection program for personnel at Project site. Review needs with local fire department and establish procedure to be followed. Instruct personnel in methods and procedures. Post warnings and information.

#### F. BARRIERS

- 1. Follow ICRA. Provide barriers to prevent unauthorized entry to construction areas, to allow for hospital's use of premises, and to protect existing facilities and adjacent properties from damage from construction operations.
- 2. Provide barricades and covered walkways required by governing authorities.
- 3. Protect non-owned vehicular traffic, store materials, site and structures from damage.
- 4. Barriers that will be used on project are to be approved by the project manager before starting work.

#### G. INTERIOR ENCLOSURES

- 1. Provide temporary partitions as required to separate work areas from hospital occupied areas, to prevent penetration of dust and moisture into hospital occupied areas, and to prevent damage to existing materials and equipment.
- 2. Construction: Framing and sheet materials must be noncombustible, with closed joints and sealed edges at intersections with existing surfaces and all other areas to provide a smoke tight area; STC rating of 35 in accordance with ASTM E90 and maximum Flame Spread Rating of 75 in accordance with ASTM E84. This information must be posted on the containment.
- 3. Pain surfaces exposed to view from hospital occupied areas.
- 4. Enclosures that will be used on the project are to be approved by the WHFD AND/OR PROJECT MANAGER before starting work.

### H. INFECTION CONTROL

- 1. Provide protection, operate temporary facilities, and conduct construction in ways and by methods that comply with hospital's infection control regulation and minimize undesirable effects.
  - a. For ICRA. Cooperate and comply with Owner's Infection Control Plan (KCH Infection Control, Policy 125-54, to be adhered to during construction and renovation.).

### 3.04 OPERATION, TERMINATION, AND REMOVAL

A. Supervision: Enforce strict discipline in use of temporary facilities. To minimize waste and abuse, limit availability of temporary facilities to essential and intended use.

- B. Maintenance: Maintain facilities in good operating condition until removal.
  - 1. Maintain operation of temporary enclosures, cooling, humidity control, ventilation, and similar facilities on a 24-hour basis where required to achieve indicated results and to avoid possibility of damage.

#### **SECTION 01600 - PROJECT REQUIREMENTS**

#### PART 1 - General

### 1.01 <u>SECTION INCLUDES</u>

- A. Selection of products for use in project
- B. Product delivery, storage, and handling
- C. Manufacturers standard warranties on products; special warranties
- D. Product substitutions
- E. Comparable products

### 1.02 DEFINITIONS

- A. Products: Items purchased for incorporating into the Work, whether purchased for Project or taken from previously purchased stock. The term "product" includes the terms "material," "equipment," system," and terms of similar intent.
  - Named Products: Items identified by manufacturer's product name, including make or model number or other designation, shown or listed in manufacturer's published product literature that is current as of date of the Contract Documents.
  - New Products: Items that have not previously been incorporated into another
    project or facility, except that products consisting of recycled- content
    materials are allowed, unless explicitly stated otherwise. Products salvaged
    or recycled from other projects are not considered new products.
  - 3. Comparable Product: Product that is demonstrated and approved through submittal process, or where indicated as a product substitution, to have the indicated qualities related to type, function, dimension, in-service performance, physical properties, appearance, and other characteristics that equal or exceed those of specified product.
- B. Substitutions: Changes in products, materials, equipment, and methods of construction from those required by the Contract Documents and proposed by Contractor.
- C. Basis-of-Design Product Specification: Where a specific manufacturer's product is named and accompanied by the words "basis of design." including make or model number or other designation, to establish the significant qualities related to type, function, dimension, in-service performance, physical properties, appearance, and other characteristics for purposes of evaluating comparable products of other named manufacturers.
- D. Manufacturer's Warranty: Preprinted written warranty published by individual manufacturer for a particular product and specifically endorsed by manufacturer to Hospital.

E. Special Warranty: Written warranty required by or incorporated into the Contract Documents, either to extend time limit provided by manufacturer's warranty or to provide more rights for Hospital.

### 1.03 <u>SUBMITTALS</u>

- A. Product List: Submit a list, in tabular from (preferably in Microsoft Excel), showing specified products. Include generic names of products required. Include manufacturer's name and proprietary product names for each product.
  - 1. Coordinate product list with Contractor's Construction Schedule and the Submittals Schedule.
  - 2. Form: Tabulate information for each product under the following column headings:
    - a. Specification Section number and title.
    - b. Generic name used in the Contract Documents.
    - c. Proprietary name, model number, and similar designations.
    - d. Manufacturer's name and address.
    - e. Supplier's name and address.
    - f. Installer's name and address.
    - g. Projected delivery date or time span of delivery period.
    - h. Identification of items that require early submittal approval for scheduled delivery date.
  - 3. Initial Submittal: Within 20 days after date of commencement of the Work, submit electronically the initial product list. Include a written explanation for omissions of data and for variations from Contract requirements.
    - a. At Contractor's option, initial submittal may be limited to product selections and designations that must be established early in Contract period.
  - 4. Completed List: Within 30 days after date of commencement of the Work, submit electronically the completed product list. Include a written explanation for omissions of data and for variations from Contract requirements.
  - 5. Project Prime Consultant's or WHFD AND/OR PROJECT MANAGER's Action: The Project Prime Consultant or WHFD AND/OR PROJECT MANAGER will respond in writing to Contractor within 15 days of receipt of completed product list. The Project Prime Consultant's or WHFD AND/OR PROJECT MANAGER's response will include a list of unacceptable product selections and a brief explanation of reasons for this action. Project Prime Consultants or WHFD AND/OR PROJECT MANAGERs response, or lack of

response, does not constitute a waiver of requirement that products comply with the Contract Documents.

B. Basis-of-Design Product Specification Submittal: Comply with requirements in Division 1 Section "Submittal Procedures." Show compliance with requirements.

### 1.04 QUALITY ASSURANCE

- A. Compatibility of Options: If Contractor is given option of selecting between two or more products for use on Project, product selected shall be compatible with products previously selected.
  - Each contractor is responsible for providing products and construction methods compatible with products and construction methods of other contractors.
  - If a dispute arises between contractors over concurrently selectable but incompatible products, the WHFD AND/OR PROJECT MANAGER will determine which products shall be used.

# 1.05 PRODUCT DELIVERY, STORAGE, AND HANDLING

- A. Deliver, store, and handle products using means and methods that will prevent damage, deterioration, and loss, including theft. Comply with manufacturers written instructions.
  - Schedule delivery to minimize storage at Project site and to prevent overcrowding of construction spaces. Long term storage onsite is not permitted unless approved by WHFD AND/OR PROJECT MANAGER.
  - 2. Coordinate delivery with installation time to ensure minimum holding time for items that are flammable, hazardous, easily damaged, or sensitive to deterioration, theft, and other losses.
  - 3. Deliver products to Project site in an undamaged condition in manufacturer's original sealed container or other packaging system, complete with labels and instructions for handling, storing, unpacking, protecting, and installing.
  - 4. Inspect products on delivery to ensure compliance with the Contract Documents and to ensure that products are undamaged and properly protected.
  - 5. Store products to allow for inspection and measurement of quantity or counting of units.
  - 6. Store materials in a manner that will not endanger Project structure.
  - 7. Store products that are subject to damage by the elements, under cover in a weathertight enclosure above ground, with ventilation adequate to prevent condensation.
  - 8. Comply with product manufacturer's written instructions for temperature, humidity, ventilation, and weather-protection requirements for storage.

- 9. Protect stored products from damage
- B. Storage: Provide a secure location and enclosure at Project site for temporary storage of materials and equipment. Coordinate location with WHFD AND/OR PROJECT MANAGER. Long term storage onsite is not permitted unless approved by WHFD AND/OR PROJECT MANAGER.

### 1.06 PRODUCT WARRANTIES

- A. Warranties specified in other Sections shall be in addition to, and run concurrent with, other warranties required by the Contract Documents. Manufacturer's disclaimers and limitations on product warranties do not relieve Contractor of obligations under requirements of the Contract Documents.
- B. Special Warranties: Prepare a written document that contains appropriate terms and identification, ready for execution. Submit a draft for approval before final execution.
  - 1. Manufacturer's Standard Form: Modified to include Project-specific information and properly executed.
  - 2. Specified Form: Forms are included with the Specifications. Prepare a written document using appropriate form properly executed.
  - 3. Refer to Divisions 2 through 16 Sections for specific content requirements and particular requirements for submitting special warranties.
- C. Submittal Time: Comply with requirements in Division 1 Section "Closeout Procedures."

#### PART 2 - Products

### 2.01 PRODUCT OPTIONS

- A. General Product Requirements: Provide products that comply with the Contract Documents that are undamaged, and unless otherwise indicated, that are new at time of installation.
  - 1. Provide products complete with accessories, trim, finish, fasteners, and other items needed for a complete installation and indicated use and effect.
  - 2. Standard Products: If available, and unless custom products or nonstandard options are specified, provide standard products of types that have been produced and used successfully in similar situations on other projects.
  - 3. Hospital reserves the right to limit selection to products with warranties not in conflict with requirements of the Contract Documents.
  - 4. Where products are accompanied by the term "match sample," sample to be matched is Prime Consultant's.

- 5. Descriptive, performance, and reference standard requirements in the Specifications establish salient characteristics" of products.
- 6. Or Equal: Where products are specified by name and accompanied by the term "or equal" or "or approved equal" or "or approved," comply with provisions in "Comparable Products" Article to obtain approval for use of an unnamed product.
- B. Product Selection Procedures: Procedures for product selection include the following:
  - 1. Product: Where Specification paragraphs or subparagraphs titled "Product" name a single product and manufacturer, provide the product named.
    - a. Substitutions may be considered, unless otherwise indicated.
  - 2. Manufacturer/Source: Where Specification paragraphs or subparagraphs titled "Manufacturer" or "Source" name single manufacturers or sources, provide a product by the manufacturer or from the source named that complies with requirements.
    - a. Substitutions may be considered, unless otherwise indicated.
  - 3. Products: Where Specification paragraphs or subparagraphs titled "Products" introduce a list of names of both products and manufacturers, provide one of the products listed that complies with requirements.
    - a. Substitutions may be considered, unless otherwise indicated.
  - 4. Manufacturers: Where Specification paragraphs or subparagraphs titled "Manufacturers" introduce a list of manufacturers' names, provide a product by one of the manufacturers listed that complies with requirements.
    - a. Substitutions may be considered, unless otherwise indicated.
  - 5. Available Products: Where Specification paragraphs or subparagraphs titled "Available Products" introduce a list of names of both products and manufacturers, provide one of the products listed or another product that complies with requirements. Comply with provisions in "Comparable Products" Article to obtain approval for use of an unnamed product.
  - 6. Available Manufacturers: Where Specification paragraphs or subparagraphs titled "Available Manufacturers" introduce a list of manufacturer names, provide a product by one of the manufacturers listed or another manufacturer that complies with requirements. Comply with provisions in "Comparable Products" Article to obtain approval for use of an unnamed product.
  - 7. Product Options: Where Specification paragraphs titled "Product Options" indicate that size, profiles, and dimensional requirements on Drawings are based on a specific product or system, provide either the specific product or system indicated or a comparable product or system by another manufacturer. Comply with provisions in "Product Substitutions" Article.

- 8. Basis-of-Design Products: Where Specification paragraphs or subparagraphs titled "Basis-of-Design Product[s] are included and also introduce or refer to a list of manufacturers' names, provide either the specified product or a comparable product by one of the other named manufacturers. Drawings and Specifications indicate sizes, profiles, dimensions, and other characteristics that are based on the product named. Comply with provisions in "Comparable Products" Article to obtain approval for use of an unnamed product.
  - a. Substitutions may be considered, unless otherwise indicated.
- 9. Visual Matching Specification: Where Specifications require matching an established Sample, select a product (and manufacturer) that complies with requirements and matches Prime Consultant's sample. WHFD AND/OR PROJECT MANAGER's or Contract Manager's decision will be final on whether a proposed product matches satisfactorily.
  - a. If no product available within specified category matches satisfactorily and complies with other specified requirements, comply with provisions of the Contract Documents on "substitutions" for selection of a matching product.
- 10. Visual Selection Specification: Where Specifications include the phrase "as selected from manufacturer's colors, patterns, textures" or a similar phrase, select a product (and manufacturer) that complies with other specified requirements.
  - a. Standard Range: Where Specifications include the phrase "standard range of colors, patterns, textures" or similar phrase, WHFD AND/OR PROJECT MANAGER and Contracts Manager will select color, pattern, or texture from manufacturer's product line that does not include premium items.
  - b. Full Range: Where Specifications include the phrase "full range of colors, patterns, textures or similar phrase. WHFD AND/OR PROJECT MANAGER and Contracts Manager will select color, pattern, or texture from manufacturer's product line that includes both standard and premium items.
- 11. Allowances: Refer to individual Specification Sections and "Allowance" provisions in Division I for allowances that control product selection and for procedures required for processing such selections.

### 2.02 PRODUCT SUBSTITUTIONS

A. Follow the procedures as described in Hawaii Health Systems Corporation General Conditions for Construction.

### 2.03 COMPARABLE PRODUCTS

A. Where products or manufacturers are specified by name, submit the following, in addition to other required submittals, to obtain approval of an unnamed product:

- Evidence that the proposed product does not require extensive revisions to the Contract Documents, that it is consistent with the Contract Documents and will produce the indicated results, and that it is compatible with other portions of the Work.
- 2. Detailed comparison of significant qualities of proposed product with those named in the Specifications. Significant qualities include attributes such as performance, weight, size, durability, visual effect, and specific features and requirements indicated.
- 3. Evidence that proposed product provides specified warranty.
- List of similar installations for completed projects with project names and addresses and names and addresses of Prime Consultants and owners, if requested.
- 5. Samples, if requested.

PART 3 - Execution (Not Used)

#### **SECTION 01730 - EXECUTION**

#### PART 1 - General

## 1.01 <u>SECTION INCLUDES</u>

- A. Construction layout.
- B. Field engineering and surveying.
- C. Progress cleaning.

### 1.02 RELATED SECTIONS

A. Section 01330 "SUBMITTAL PROCEDURES" for submitting surveys.

### PART 2 - Products (Not Used)

#### **PART 3 - Execution**

## 3.01 **EXAMINATION**

- A. Acceptance of Conditions: Examine substrates, areas, and conditions, with General Contractor and Subcontractor present where indicated, for compliance with requirements for installation tolerances and other conditions affecting performance. Record observations.
  - 1. Written Report: Where a written report listing conditions detrimental to performance of the Work is required by other Sections, include the following:
    - a. Description of the Work.
    - b. List of detrimental conditions, including substrates.
    - c. List of unacceptable installation tolerances.
    - d. Recommended corrections.
  - 2. Verify compatibility with and suitability of substrates, including compatibility with existing finishes or primers.
  - 3. Examine roughing-in for mechanical and electrical systems to verify actual locations of connections before equipment and fixture installation.
  - 4. Examine walls, floors, and roofs for suitable conditions where products and systems are to be installed.
  - 5. Proceed with installation only after unsatisfactory conditions have been corrected. Proceeding with the Work indicates acceptance of surfaces and conditions.

### 3.02 PREPARATION

- A. Existing Utility Information: Furnish information to local utility that is necessary to adjust, move, or relocate existing utility structures, utility poles, lines, services, or other utility appurtenances located in or affected by construction. Coordinate with authorities having jurisdiction.
- B. Field Measurements: Take field measurements as required to fit the Work properly. Recheck measurements before installing each product. Where portions of the Work are indicated to fit to other construction, verify dimensions of other construction by field measurements before fabrication. Coordinate fabrication schedule with construction progress to avoid delaying the Work.
- C. Space Requirements: Verify space requirements and dimensions of Items shown diagrammatically on Drawings.
- D. Review of Contract Documents and Field Conditions: Immediately on discovery of the need for clarification of the Contract Documents, submit a request for information to Prime Consultant. Include a detailed description of problem encountered, together with recommendations for changing the Contract Documents.

### 3.03 PROGRESS CLEANING

- A. General: Clean Project site and work areas daily, including common areas. Coordinate progress cleaning for joint-use areas where more than one installer has worked. Enforce requirements strictly. Dispose of materials lawfully.
  - 1. Comply with requirements in NFPA 241 for removal of combustible waste materials and debris.
  - 2. Do not hold materials more than 7 days during normal weather or 3 days if the temperature is expected to rise above 80 deg F.
- B. Site: Maintain Project site free of waste materials and debris.
- C. Work Areas: Clean areas where work is in progress to the level of cleanliness necessary for proper execution of the Work.
  - 1. Remove liquid spills promptly.
  - 2. Where dust would impair proper execution of the Work, wet mop or vacuum the entire work area, as appropriate, utilizing the hospital's EPA approved disinfectant.
- D. Waste Disposal: Burying or burning waste materials on-site will not be permitted. Washing waste materials down sewers or into waterways will not be permitted.
- E. Limiting Exposures: Supervise construction operations to assure that no part of the construction, completed or in progress, is subject to harmful, dangerous, damaging, or otherwise deleterious exposure during the construction period.

### **SECTION 01732 - CUTTING AND PATCHING**

#### PART 1 - General

### 1.01 <u>SECTION INCLUDES</u>

A. Requirements and limitations for cutting and patching of Work.

### 1.02 RELATED SECTIONS

- A. Section 01100 SUMMARY: Work by Owner or by separate contractors.
- B. Section 01120 ALTERATION PROJECT PROCEDURES: Cutting and patching for alterations work.
- C. Section 01330— SUBMITTAL PROCEDURES.
- D. Section 01600— MATERIAL REQUIREMENTS: Product Options and Substitutions.
- E. Individual Product Specification Sections:
  - 1. Cutting and patching incidental to work of the Section.
  - 2. Advance notification to other Sections of openings required in work of those Sections.
  - 3. Limitations on cutting structural members.

### 1.03 SUBMITTALS

- A. Submit written request in advance of cutting or alteration which affects:
  - 1. Structural integrity of any element of Project.
  - 2. Efficiency, maintenance, or safety of any operational element.
- B. Include in request:
  - 1. Identification of Project.
  - 2. Location and description of affected work.
  - 3. Necessity for cutting or alteration.
  - 4. Description of proposed work, and products to be used.
  - 5. Alternatives to cutting and patching.
  - 6. Effect on work of Hospital or separate contractor.
  - 7. Written permission of affected separate contractor.

8. Date and time work will be executed.

#### **PART 2 - Products**

### 2.01 MATERIALS

A. Primary Products: Those required for original installation.

#### PART 3 - Execution

## 3.01 **EXAMINATION**

- A. Inspect existing conditions prior to commencing Work, including elements subject to damage or movement during cutting and patching.
- B. After uncovering existing work, inspect conditions affecting performance of work.
- C. Beginning of cutting or patching means acceptance of existing conditions.

#### 3.02 PREPARATION

- A. Provide temporary supports to ensure structural integrity of the Work. Provide devices and methods to protect other portions of Project from damage.
- B. Provide protection from elements for areas that may be exposed by uncovering work.
- C. Maintain excavations free of water.

#### 3.03 CUTTING AND PATCHING

- A. Execute cutting, fitting, and patching to complete work.
- B. Fit products together, to integrate with other work.
- C. Uncover work to install ill-timed work.
- D. Remove and replace defective or non-conforming work.
- E. Remove samples of installed work for testing when requested.
- F. Provide openings in the work for penetration of mechanical and electrical work.

### 3.04 PERFORMANCE

- A. Execute work by methods to avoid damage to other Work, and which will provide appropriate surfaces to receive patching and finishing.
- B. Cut rigid materials using masonry saw or core drill. Pneumatic tools are allowed with WHFD's prior approval.
- C. Restore work with new products in accordance with requirements of Contract Documents.

- D. Fit work air tight to pipes, sleeves, ducts, conduit, and other penetrations through surfaces.
- E. At penetrations of fire rated walls, partitions, ceiling, or floor construction, completely seal voids, fire stopping, to full thickness of the penetrated element. Use red 3M fire caulk only.
- F. Refinish surfaces to match adjacent finish. For continuous surfaces, refinish to nearest intersection or natural break. For an assembly, refinish entire unit.

### **SECTION 01770 - CLOSEOUT PROCEDURES**

#### PART 1 - General

### 1.01 <u>SECTION INCLUDES</u>

- A. Administrative and procedural requirements for contract closeout, including, but not limited to, the following:
  - 1. Inspection procedures.
  - 2. Warranties.
  - 3. Final cleaning.

### 1.02 RELATED SECTIONS

- A. Section 01260 CONTRACT CONSIDERATIONS for requirements for Applications for Payment for Substantial and Final Completion.
- B. Section 01730 EXECUTION for progress cleaning of Project site.
- C. Sections for specific closeout and special cleaning requirements for the Work in those Sections.

### 1.03 SUBSTANTIAL COMPLETION

- A. Preliminary Procedures: Before requesting inspection for determining date of Substantial Completion, complete the following. List items below that are incomplete in request.
  - 1. Prepare a list of items to be completed and corrected (punch list), the value of items on the list, and reasons why the Work is not complete.
  - 2. Advise Hospital Risk Manager of pending insurance changeover requirements, if necessary.
  - 3. Obtain and submit releases permitting Hospital unrestricted use of the Work and access to services and utilities. Include occupancy permits, operating certificates, and similar releases.
  - 4. Prepare and submit Project Record Documents, operation and maintenance manuals, Final Completion construction photographs, damage or settlement surveys, property surveys, and similar final record information.
  - 5. Complete startup testing of systems.
  - 6. Submit test/adjust/balance, including TAB, records.
  - 7. Terminate and remove temporary facilities from Project site, along with mockups, construction tools, and similar elements.

- 8. Advise WHFD of changeover in heat and other utilities.
- 9. Submit changeover information related to Hospital's occupancy, use, operation, and maintenance.
- 10. Complete final cleaning requirements, including touchup painting.
- 11. Touch up and otherwise repair and restore marred exposed finishes to eliminate visual defects.
- B. Inspection: Submit a written request for inspection for Substantial Completion. On receipt of request, the WHFD will either proceed with inspection or notify Contractor of unfulfilled requirements. The will prepare the Certificate of Substantial Completion after inspection or will notify Contractor of Items, either on Contractor's list or additional items identified by the Prime Consultant that must be completed or corrected before certificate will be issued.
  - 1. Re-inspection: Request re-inspection when the Work identified in previous inspections as incomplete is completed or corrected.
  - 2. Results of completed inspection will form the basis of requirements for Final Completion.

# 1.04 FINAL COMPLETION

- A. Preliminary Procedures: Before requesting final inspection for determining date of Final Completion, complete the following:
  - 1. Submit a final Application for Payment according to Division 1 Section Payment Procedures.
  - 2. Submit specific warranties, workmanship bonds, maintenance service agreements, final certifications, and similar documents. To be submitted in 3 ring binder.
  - 3. Deliver tools, spare parts, extra materials, and similar items to location designated by WHFD. Label with manufacturer's name and model number where applicable.
  - 4. Make final changeover of permanent locks and deliver keys to WHFD. Advise Hospital's personnel of changeover n security provisions.
  - 5. Submit copy of WHFD's Substantial Completion inspection list of items to be completed or corrected. The copy of the list shall state that each item has been completed or otherwise resolved for acceptance.
  - 6. Submit evidence of final, continuing insurance coverage complying with insurance requirements.
  - 7. Submit pest-control final inspection report and warranty.

- 8. Instruct Hospital's personnel in operation, adjustment, and maintenance of products, equipment, and systems. Document attendance and discussion topics presented to WHFD's personnel.
- B. Inspection: Submit a written request for final inspection for acceptance. On receipt of request, the Prime Consultant and WHFD will either proceed with inspection or notify Contractor of unfulfilled requirements.
  - 1. Reinspection: Request reinspection when the Work identified in previous inspections as incomplete is completed or corrected.

## 1.05 <u>LIST OF INCOMPLETE ITEMS (PUNCH LIST)</u>

- A. Preparation: Submit electronic copy of punch list. Include name and identification of each space and area affected by construction operations for incomplete items and items needing correction including, if necessary, areas disturbed by Contractor that are outside the limits of construction. Use Contractor's form.
  - 1. Organize list of spaces in sequential order, starting with exterior areas first and proceeding from lowest floor to highest floor.
  - 2. Organize items applying to each space by major element, including categories for ceiling, individual walls, floors, equipment, and building systems.
  - 3. Include the following information at the top of each page:
    - a. Project name.
    - b. Date.
    - c. Name of Contractor.
    - d. Page number.

### 1.06 WARRANTIES

- A. Submittal Time: Submit written warranties on request of WHFD for designated portions of the Work where commencement of warranties other than date of Substantial Completion is indicated.
- B. Partial Occupancy: Submit properly executed warranties within 10 days of completion of designated portions of the Work that are completed and occupied or used by Owner during construction period by separate agreement with Contractor.
- C. Organize warranty documents into an orderly sequence based on the table of contents of the Project Manual.
  - 1. Bind warranties and bonds in heavy-duty, 3-ring, vinyl-covered, loose-leaf binders, thickness as necessary to accommodate contents, and sized to receive 8-1/2-by-I 1-inch paper.

- 2. Provide heavy paper dividers with plastic-covered tabs for each separate warranty. Mark tab to identify the product or installation. Provide a typed description of the product or installation, including the name of the product and the name, address, and telephone number of Installer.
- D. Provide additional copies of each warranty to include in operation and maintenance manuals.

#### **PART 2 - Products**

### 2.01 MATERIALS

A. Cleaning Agents: Use cleaning materials and agents recommended by manufacturer or fabricator of the surface to be cleaned. Cleaning agents must be approved WHFD. Do not use cleaning agents that are potentially hazardous to health or property or that might damage finished surfaces.

### PART 3 - Execution

#### 3.01 FINAL CLEANING

- A. General: Provide final cleaning. Conduct cleaning and waste-removal operations to comply with local laws and ordinances and Federal and local environmental and antipollution regulations.
- B. Cleaning: Employ experienced workers or professional cleaners for final cleaning. Clean each surface or unit to condition expected in an average commercial building cleaning and maintenance program. Comply with manufacturer's written instructions as well as utilize hospital approved disinfectants.
  - Complete the following cleaning operations before requesting inspection for certification of Substantial Completion for entire Project or for a portion of Project:
    - a. Clean Project site, yard and grounds, in areas disturbed by construction activities, including landscape development areas, of rubbish, waste material, litter, and other foreign substances.
    - b. Sweep paved areas broom clean. Remove petrochemical spills, stains, and other foreign deposits.
    - c. Rake grounds that are neither planted nor paved to a smooth, eventextured surface.
    - d. Remove tools, construction equipment, machinery, and surplus material from Project site.
    - e. Clean exposed exterior and interior hard-surfaced finishes to a dirt-free condition, free of stains, films, and similar foreign substances. Avoid

- disturbing natural weathering of exterior surfaces. Restore reflective surfaces to their original condition.
- f. Remove debris and surface dust from limited access spaces, including roofs, plenums, shafts, trenches, equipment vaults, manholes, attics, and similar spaces.
- g. Sweep concrete floors broom clean in unoccupied spaces. Mop using guaternary ammonium disinfectants.
- h. Vacuum carpet and similar soft surfaces, removing debris and excess nap; shampoo if visible soil or stains remain.
- Clean transparent materials, including mirrors and glass in doors and windows, Remove glazing compounds and other noticeable, visionobscuring materials. Replace chipped or broken glass and other damaged transparent materials. Polish mirrors and glass, taking care not to scratch surfaces.
- i. Remove labels that are not permanent.
- k. Touch up and otherwise repair and restore marred, exposed finishes and surfaces. Replace finishes and surfaces that cannot be satisfactorily repaired or restored or that already show evidence of repair or restoration.
  - 1) Do not paint over "UL" and similar labels on door and window frames, including mechanical and electrical nameplates.
- I. Wipe surfaces of mechanical and electrical equipment, elevator equipment, and similar equipment. Remove excess lubrication, paint and mortar droppings, and other foreign substances.
- m. Replace parts subject to unusual operating conditions.
- n. Clean plumbing fixtures to a sanitary condition, free of stains, including stains resulting from water exposure.
- o. Replace disposable air filters and clean permanent air filters. Clean exposed surfaces of diffusers, registers, and grills.
- p. Clean ducts, blowers, and coils if units were operated without filters during construction.
- q. Clean light fixtures, lamps, globes, and reflectors to function with full efficiency. Replace burned-out bulbs, and those noticeably dimmed by hours of use, and defective and noisy starters in fluorescent and mercury vapor fixtures to comply with requirements for new fixtures.
- r. Leave Project clean and ready for occupancy.
- C. Pest Control: To be determined by WHFD.

D. Comply with safety standards for cleaning. Do not burn waste materials. Do not bury debris or excess materials on Hospital's property. Do not discharge volatile, harmful or dangerous materials into drainage systems. Remove waste materials from Project site and dispose of lawfully. Follow County of Hawaii waste guidelines.

#### **SECTION 01783 - PROJECT RECORD DOCUMENTS**

#### PART 1 - General

## 1.01 <u>SECTION INCLUDES</u>

- A. Administrative and procedural requirements for Project Record Documents, including the following:
  - 1. Record Drawings.
  - 2. Record Specifications.
  - 3. Record Product Data.

### 1.02 RELATED SECTIONS

- A. Section 01770 CLOSEOUT PROCEDURES for general closeout procedures.
- B. Related sections of the work in this Specification for Project Record Documents.

### 1.03 SUBMITTALS

- A. Record Drawings: Comply with the following:
  - 1. Number of Copies: Submit copies of Record Drawings as follows:
    - a. Initial Submittal: Submit one set of plots from corrected Record CAD Drawings and one set of marked-up Record Prints. Prime Consultant will initial and date each plot and mark whether general scope of changes, additional information recorded, and quality of drafting are acceptable. Prime Consultant will return plots and prints for organizing into sets, printing, binding, and final submittal.
    - b. Final Submittal: Submit one set of marked-up Record Prints, two sets of Record CAD Drawing files, two copies of Record CAD Drawing plots. Plot and print each Drawing, whether or not changes and additional information were recorded.
      - 1) E-mail: ACAD and PDF formats
    - c. Record Specifications: Submit one electronic copy of Project's Specifications, including addenda and contract modifications.

### **PART 2 - Products**

### 2.01 RECORD DRAWINGS

- A. Record Prints: Maintain one set of black-line prints of the Contract Drawings and Shop Drawings.
  - 1. Preparation: Mark Record Prints to show the actual installation where installation varies from that shown originally. Require individual or entity who

obtained record data, whether individual or entity is Installer, subcontractor, or similar entity, to prepare the marked-up Record Prints.

- a. Give particular attention to information on concealed elements that would be difficult to identify or measure and record later. Accurately record information in an understandable drawing technique.
- b. Record data as soon as possible after obtaining it. Record and check the markup before enclosing concealed installations.
- 2. Content: Types of items requiring marking include, but are not limited to, the following:
  - a. Dimensional changes to Drawings.
  - b. Revisions to details shown on Drawings.
  - c. Depths of foundations below first floor.
  - d. Locations and depths of underground utilities.
  - e. Revisions to routing of piping and conduits.
  - f. Revisions to electrical circuitry.
  - g. Actual equipment locations.
  - h. Duct size and routing.
  - i. Locations of concealed internal utilities.
  - j. Changes made by Change Order or Construction Change Directive.
  - k. Changes made following Prime Consultant's written orders.
  - I. Details not on the original Contract Drawings.
  - m. Field records for variable and concealed conditions.
  - n. Record information on the Work that is shown only schematically.
- 3. Mark the Contract Drawings or Shop Drawings, whichever is most capable of showing actual physical conditions, completely and accurately. If Shop Drawings are marked, show cross-reference on the Contract Drawings.
- 4. Mark record sets with erasable, red-colored pencil. Use other colors to distinguish between changes for different categories of the Work at same location.
- 5. Mark important additional information that was either shown schematically or omitted from original Drawings.

- 6. Note Construction Change Directive numbers, alternate numbers, Change Order numbers, and similar identification, where applicable.
- B. Record CAD Drawings: Prepare a full set of corrected CAD Drawings of the Contract Drawings, as follows:
  - 1. Format: Same CAD program, version, and operating system as the original Contract Drawings. PDF format also.
  - 2. Incorporate changes and additional information previously marked on Record Prints. Delete, redraw, and add details and notations where applicable.
  - 3. Refer instances of uncertainty to Prime Consultant through Owners Project Manager for resolution.
  - 4. The Contractor is free to negotiate a fee with the Prime Consultant, for the CAD Drawings of the Contract Drawings for use in recording Information.
- C. Format: Identify and date each Record Drawing; include the designation "PROJECT RECORD DRAWING" in a prominent location.
  - 1. Record Prints: Organize Record Prints into manageable sets. Bind each set with durable paper cover sheets. Include identification on cover sheets.
  - 2. Record CAD Drawings: Organize CAD information into separate electronic files that correspond to each sheet of the Contract Drawings. Name each file with the sheet identification. Include identification in each CAD file. PDF format also.
  - 3. Identification: As follows:
    - a. Project name.
    - b. Date.
    - c. Designation "PROJECT RECORD DRAWINGS."
    - d. Name of Contractor.

### 2.02 RECORD SPECIFICATIONS

- A. Preparation: Mark Specifications to indicate the actual product installation where installation varies from that indicated in Specifications, addenda, and contract modifications.
  - 1. Give particular attention to information on concealed products and installations that cannot be readily identified and recorded later.
  - 2. Mark copy with the proprietary name and model number of products, materials, and equipment furnished, including substitutions and product options selected.

- 3. Record the name of manufacturer, supplier, Installer, and other information necessary to provide a record of selections made.
- 4. For each principal product, indicate whether Record Product Data has been submitted in operation and maintenance manuals instead of submitted as Record Product Data.
- 5. Note related Change Orders, Record Product Data, and Record Drawings where applicable.

### 2.03 RECORD PRODUCT DATA

- A. Preparation: Mark Product Data to indicate the actual product installation where installation varies substantially from that indicated in Product Data submittal.
  - 1. Give particular attention to information on concealed products and installations that cannot be readily identified and recorded later.
  - 2. Include significant changes in the product delivered to Project site and changes in manufacturer's written instructions for installation.
  - 3. Note related Change Orders. Record Specifications, arid Record Drawings where applicable.

### 2.04 MISCELLANEOUS RECORD SUBMITTALS

A. Assemble miscellaneous records required by other Specification Sections for miscellaneous record keeping and submittal in connection with actual performance of the Work. Bind or file miscellaneous records and identify each, ready for continued use and reference.

#### PART 3 - Execution

### 3.01 RECORDING AND MAINTENANCE

- A. Recording: Maintain one copy of each submittal during the construction period for Project Record Document purposes. Post changes and modifications to Project Record Documents as they occur; do not wait until the end of Project.
- B. Maintenance of Record Documents and Samples: Store Record Documents and Samples in the field office apart from the Contract Documents used for construction. Do not use Project Record Documents for construction purposes. Maintain Record Documents in good order and in a clean, dry, legible condition, protected from deterioration and loss. Provide access to Project Record Documents for Prime Consultant's and Owner's reference during normal working hours.

#### **DIVISION 15 - MECHANICAL**

## **SECTION 15000 - GENERAL MECHANICAL REQUIREMENTS**

#### PART 1 - GENERAL

### 1.01 GENERAL CONDITIONS

A. As specified in Section 00700.

## 1.02 GENERAL REQUIREMENTS

- A. These general mechanical requirements govern work specified under all sections of Division 15 MECHANICAL.
- B. The Contractor shall furnish all labor, materials, tools and equipment and perform all work and services necessary for a complete and properly operating mechanical equipment and systems, as shown on drawings and as specified, in accordance with provisions of the Contract Documents and completely coordinated with work of all other trades.
- C. The Contractor shall completely examine the Contract Documents and shall report to the WHFD AND/OR PROJECT MANAGER any error, inconsistency or omission he discovers.
- D. Furnish and install all supplementary or miscellaneous items, details, appurtenances and devices incidental to or necessary for a sound, secure and complete mechanical system where work required is not specifically indicated.
- E. Drawings and specifications shall be taken together. Provide work specified and not indicated or work indicated and not specified as though mentioned in both.
- F. The Contractor shall warrant that all materials and equipment furnished under this Contract will be new and that all work will be of good quality, free from faults and defects and in conformance with Contract Documents for a guaranteed period of one year after the date of acceptance as specified.
- G. The Contractor shall maintain at the site one (1) copy of all Drawings, Specifications, Addenda, approved Shop Drawings, Change Orders and other modifications, in good order and marked (in red) to record all changes made during construction. These shall be made available to the WHFD AND/OR PROJECT MANAGER.
- H. The Contractor at all times shall keep the premises free from accumulation of waste materials or rubbish caused by its operations. At the completion of the work, he shall remove all its waste materials and rubbish from and about the project as well as all its tools, construction equipment, machinery and surplus materials and shall clean all new equipment and accessories.
- I. The Contractor shall give the WHFD AND/OR PROJECT MANAGER timely notice of its readiness for testing any work including the data arranged so the

WHFD AND/OR PROJECT MANAGER may observe such testing. The Contractor shall bear all cost of such tests.

J. The WHFD AND/OR PROJECT MANAGER shall have the right to accept or reject material, equipment, and/or workmanship and determine when the Contractor has complied with the contract documents.

### 1.03 INSPECTION OF SITE

A. The Contractor shall visit the site and examine the conditions affecting its work before submitting its proposal. The submission of the proposal shall be considered evidence that the Contractor has visited the site and no extra payments will be allowed to the Contractor on account of extra work made necessary by its failure to visit the site. If there are any questions or discrepancies in the design, the Contractor shall bring it to the attention of the WHFD AND/OR PROJECT MANAGER before submitting its proposal.

# 1.04 SUBMITTALS

- A. Submit 6 copies of shop drawings, manufacturer's data and certificates for equipment, materials and finish and pertinent details for each system and have them approved before procurement, fabrication or delivery of the items to the job site. Partial submittals will not be acceptable and will be returned without review. Submittals shall include the manufacturer's name, trade name, catalog model or number, nameplate data, size, layout dimensions, capacity, project specification and paragraph reference, applicable industry and technical society publication references and other information necessary to establish contract compliance of each item the Contractor proposed to furnish.
  - 1. Shop Drawings: Drawings shall be a minimum of 24 inches by 36 inches in size, except as specified otherwise. Drawings shall include floor plans, sectional views, wiring diagrams and installation details of equipment; and equipment spaces identifying and indicating proposed location, layout and arrangement of items of equipment, control panels, accessories, piping and other items that must be shown to assure a coordinated installation. Wiring diagrams shall identify circuit terminals and indicate the internal wiring for each item of equipment and interconnection between each type of equipment. Drawings shall indicate adequate clearance for operation, maintenance and replacement of operating equipment devices. If equipment is disapproved, drawings shall be revised to show acceptable equipment and be resubmitted.
    - a. The Contractor shall review, stamp with its approval and submit, all Shop Drawings required by the Contract Documents or subsequently by the WHFD AND/OR PROJECT MANAGER as covered by modifications. At the time of submission, the Contractor shall inform the WHFD AND/OR PROJECT MANAGER in writing of any deviation in the Shop Drawings from the requirements of the Contract Documents. By approving and submitting Shop Drawings, the Contractor certifies that he has determined and verified all field measurements and obstructions, field construction criteria, materials, catalog numbers and similar data, that he has checked and coordinated each Shop Drawing with the requirements

- of the work and of the Contract Documents and that all equipment fits within designated spaces.
- 2. Manufacturer's Data: Submittals for each manufactured item shall be manufacturer's descriptive literature of cataloged products, equipment drawings, diagrams, performance and characteristic curves and catalog cuts.
- 3. Standards Compliance: When materials or equipment must conform to the standards of organizations such as the American National Standards Institute (ANSI), American Society for Testing and Materials (ASTM), National Electrical Manufacturers Association (NEMA) and Underwriters Laboratories (UL), proof of such conformance shall be submitted to the WHFD AND/OR PROJECT MANAGER for approval. If an organization uses a label or listing to indicate compliance with a particular standard, the label or listing will be acceptable evidence, unless otherwise specified in the individual sections. In lieu of the label or listing, the Contractor shall submit a certificate from an independent testing organization, which is competent to perform acceptable test and is approved by the WHFD AND/OR PROJECT MANAGER. The certificate shall state that the item has been tested in accordance with the specified organization's test methods and that the item conforms to the specified organization's standard. For materials and equipment whose compliance with organizational standards or specifications is not regulated by an organization using its own listing or label as proof of compliance, a certificate of compliance from the manufacturer shall be submitted for approval. The certificate shall identify the manufacturer, the product and the referenced standard and shall simply state that the manufacturer certifies that the product conforms to all requirements of the project specification and of the referenced standards listed.
- Certified Test Reports: Before delivery of materials and equipment, certified copies of all test reports specified in the individual section shall be submitted for approval.
- 5. Certificates of Conformance or Compliance: Submit certification from the manufacturer attesting that materials and equipment to be furnished for this project comply with the requirements of this specification and of the reference publications. Pre-printed certifications will not be acceptable; certifications shall be in the original. The certification shall not contain statements that could be interpreted to imply that the product does not meet all requirements specified, such as "as good as"; "achieve the same end use and result as materials formulated in accordance with the referenced publication", "equal or exceed the service and performance of the specified material". The certification shall simply state that the product conforms to the requirements specified.
- 6. "Field Posted As-Built" Drawings: Keep at the job site a complete, accurate record of all approved deviations from the contract drawings, shop drawings and specifications. Keep these changes on prints of the drawings affected and turn over one (1) set to the WHFD AND/OR PROJECT MANAGER at the completion of the project.

7. Balancing Report and Maintenance Manuals: After installation, the new system shall be tested, balanced and adjusted by an NEBB Certified Testing and Balancing Company. Contractor to submit 4 sets of certification, certification shall be current at time of testing and balancing. Submit 4 copies of the balancing report, and operating and maintenance manuals for approval before final inspection.

### 8. Operation and Maintenance Manual

- a. Submit (5) hard bound copies and (2) compact discs of the Operating and Maintenance Manual on all equipment and the system as a whole. The manual shall identify project name and number, contractor, consultant, date and all equipment provided, It shall include the equipment manufacturer's name, model and serial number, tag no., capacity, quantity of units, their location and area (room) served and shall include the manufacturer's operation and maintenance manuals including control and wiring diagrams and source of service and replacement parts. When standard manufactures' brochures are used, adequately indicate (highlight, arrow, etc.) the project related information and delete (X or cross-out) the non applicable information.
- b. Distribution of submittal:
- c. (5) hard bound copies: WHFD AND/OR PROJECT MANAGER
- d. (2) Compact Discs: WHFD AND/OR PROJECT MANAGER
- 9. Maintenance Service Contract
  - a. The Maintenance Service Contract shall be submitted along with the Operations and Maintenance Manual on/or before the Project Acceptance Date. Refer to Part 3 Paragraph titled "One Year Guarantee and Maintenance Service Contract" for additional information.
  - b. Note to Contractor: Equipment specified shall have either replacement parts which are locally stocked and an in-state service organization able to provide the necessary repair and maintenance service.
  - c. Distribution of Submittal:
    - 1) (7) Copies: WHFD AND/OR PROJECT MANAGER

### 1.05 LAWS, REGULATIONS AND CODES

- A. All work shall be in accordance with government laws, ordinances, rules and regulations and orders.
- B. The following shall govern where applicable; the Plumbing Code of the County of Hawaii, the Building Code of the County of Hawaii, State of Hawaii Department of Health Regulations, U.S. Department of H.E.W., Applicable National Fire Protection Association Standards, OSHA, Rules and Regulations, County of Hawaii Energy Code and all other codes and standards referenced in these

specifications. Where requirements differ in these code and standards, the more stringent shall apply.

### 1.06 TRADE NAME

A. Mentioning of a trade name in the plans and specifications indicates that the Manufacturer is acceptable to the WHFD AND/OR PROJECT MANAGER. However, certain specified construction and details may not be regularly included in the manufacturer's catalogued product. The Mechanical Contractor shall provide the material or equipment complete as specified.

### 1.07 PERMITS AND INSPECTIONS

- A. Applications for permits will be done by the contractor; the Contractor shall pay for all necessary licenses, permits and fees.
- B. The Mechanical Contractor shall apply and pay for all necessary inspections required by any public authority having jurisdiction.

### 1.08 <u>DISCREPANCIES</u>

- A. The Drawings and Specifications are intended to be cooperative. Any materials, equipment or system related to this section and exhibited on the Architectural, Structural, Electrical or Mechanical Drawings but not mentioned in the Specifications are to be executed to the intent and meaning thereof, as if it were both mentioned in the Specifications and set forth on the Drawings.
- B. In case of differences between the Drawings and Specifications, the Specifications shall govern first, and then the Drawings. Large scale details shall take precedence over small scale Drawings as to the shape and details of construction. Specifications shall govern as to materials.
- C. Drawings and Specifications are intended to be fully cooperative and to agree, but should any discrepancy or apparent difference occur between Drawings and Specifications or should error occur in the work of others affecting the work, the Contractors shall notify the WHFD AND/OR PROJECT MANAGER at once. If the Contractor proceeds with the work affected without instructions from the WHFD AND/OR PROJECT MANAGER, he shall make good any resultant damage or defect. All interpretations of Drawings and specifications shall be clarified by the WHFD AND/OR PROJECT MANAGER.

#### 1.09 WORKMANSHIP AND MATERIALS

- A. Workmanship shall be of the best quality and none but competent mechanics skilled in their trades shall be employed. The Contractor shall furnish the services of an experienced superintendent, who will be constantly in charge of the erection of the work, until completed and accepted.
- B. Unless otherwise hereinafter specified, each article of its kind shall be the standard product of a single manufacturer.

- C. Whenever the words "or approved equal" or other words of similar intent or meaning are used, implying that judgment is to be exercised, it is understood that it is the judgment of the WHFD AND/OR PROJECT MANAGER that is referred to.
- D. The WHFD AND/OR PROJECT MANAGER shall have the right to accept or reject material, equipment and/or workmanship and determine when the Contractor has complied with the requirements herein specified.
- E. All manufactured materials shall be delivered and stored in their original containers. Equipment shall be clearly marked or stamped with the manufacturer's name and rating. Equipment and materials shall be carefully handled, properly stored and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the WHFD AND/OR PROJECT MANAGER. Damaged or defective items, in the opinion of the WHFD AND/OR PROJECT MANAGER, shall be replaced.
- F. Reference to standards is intended to be the latest revision of the standard specified.

### 1.10 MANUFACTURER'S RECOMMENDATIONS

A. Equipment installed under this Division of the Specifications shall be installed according to manufacturer's recommendations, unless otherwise shown on the drawings or herein specified. Where installation procedures or any part thereof are required to be in accordance with the recommendations of the manufacturer of the material being installed, printed copies of these recommendations shall be furnished to the WHFD AND/OR PROJECT MANAGER, prior to installation. Installation of the item will not be allowed to proceed until the recommendations are received. Failure to furnish these recommendations can be cause of rejection of the material.

### 1.11 OPENINGS, CUTTING AND REPAIRING

- A. The Mechanical Contractor shall cooperate with the work to be done under other sections in providing information as to openings required in walls and slabs for all piping including sleeves where required.
- B. Any drilling or cutting required for the performance of work under this Section shall be the responsibility of this Contractor and the cost shall be borne by him.
- C. Holes in Concrete: The Mechanical Contractor shall pay all costs for cutting holes. All holes through existing concrete shall be either core drilled or saw cut. All holes required shall have the approval of the WHFD AND/OR PROJECT MANAGER prior to cutting and drilling.
- D. It shall be the responsibility of this Contractor to ascertain that all openings are properly located.

## 1.12 ELECTRICAL WORK

- A. All power wiring, including final hook-up to all mechanical equipment will be provided. Control devices required on the power wiring shall be provided by the Mechanical Contractor, to be wired by the Electrical Contractor.
- B. The Mechanical Contractor shall furnish all starters for installation by the Electrical Contractor. The Mechanical Contractor shall turn over these items to the Electrical Contractor at the site after receipt of notice from the Electrical Contractor that he is ready to install said items.

## **PART 2 - PRODUCTS**

# 2.01 MATERIALS

- A. As specified in all sections of Division 15 Mechanical.
- B. Provide components and equipment that are "standard products" of a manufacturer regularly engaged in the manufacturing of products that are of a similar material, design and workmanship. "Standard products" is defined as being in satisfactory commercial or industrial use for 2 years before bid opening, including applications of components and equipment under similar circumstances and of similar size, satisfactorily completed by a product that is sold on the commercial market through advertisements, manufacturers' catalogs, or brochures. Where two or more items of the same class of equipment are required, these items shall be products of a single manufacturer, however, the component parts of the items need not be the products of the same manufacturer. Each item of equipment shall have the manufacturer's name, address, model number and serial number on the nameplate.

# 2.02 SALT CORROSION PROTECTION

A. Provide salt corrosion protection for all air cooled condensing units, fan coil units, supply and exhaust fans and housings. All coils shall be coated with Blygold PoluAl XT or approved equal and all housings and fans of exterior mounted equipment shall be coated with PSX 700, or approved equal.

## 2.03 SUBSTITUTIONS

- A. The material, products and equipment described in these specifications establish a standard of required function, quality, dimension, capacity, and appearance to be met by any proposed substitution.
- B. Specific product listings in these specifications shall not preclude alternate product selections of comparable or superior quality. The Contractor may make reasonable substitutions, provided that these are submitted to the WHFD AND/OR PROJECT MANAGER for acceptance prior to bid in accordance with Division 1 Specifications. The Contractor shall be responsible for design changes to accommodate the substituted product, at no additional costs to the Hospital.

### **PART 3 - EXECUTION**

## 3.01 EQUIPMENT

## A. MECHANICAL EQUIPMENT, FIXTURES AND ACCESSORIES

- 1. All mechanical equipment, accessories, plumbing fixtures and plumbing accessories shall be purchased by a Hawaii based manufacturer's representative who is factory authorized to furnish these items in the State of Hawaii. The manufacturer's representative shall be knowledgeable in the operation and functioning of the items furnished by him and must meet the following conditions:
  - a. The manufacturer's representative shall furnish recommendations on the installation and operation of the items furnished in a capacity conforming to that of the actual manufacturer.
  - b. The manufacturer's representative shall stock a reasonable amount of replacement parts locally.
  - c. The manufacturer's representative shall have the ability to provide warranty replacement parts for equipment in a timely fashion to reduce the down time of equipment.

## B. MAINTENANCE SERVICE CONTRACTOR

- 1. The maintenance service contractor shall have a local office, staffed with competent and qualified field service personnel. The personnel shall be certified by the manufacturer to perform service and maintenance tasks on all equipment in accordance with the one year maintenance service contract and the terms and conditions of all equipment manufacturers' warranties and recommendations. Field service personnel shall be fully capable of providing technical assistance instruction, routine maintenance and emergency maintenance service on all system equipment components.
- C. TROUBLE CALLS: Emergency service and repairs required between regular service calls shall be rendered within 24 hours after the Contractor is notified, non-work days excluded.
  - 1. The Contractor shall call the Hospital, the next working day after being notified of the problem and report the status of repairs.

#### D. MANUFACTURERS REPRESENTATIVE

1. Air conditioning equipment to be considered for bid purposes shall be purchased from a manufacturer's sales and service representative located in the State of Hawaii that has locally stocked spare parts and support of a service organization within the State of Hawaii which has serviced manufacturer's unit of comparable type, size and capacity as those specified. The manufacturer must have other units of comparable type, size and capacity installed and operating satisfactorily in the State of Hawaii for a minimum of two years prior to bid opening. The Contractor shall provide a list

of locations in Hawaii with addresses and telephone numbers when requested by the WHFD AND/OR PROJECT MANAGER.

## E. MECHANICAL EQUIPMENT

- The mechanical equipment supplier shall maintain a local support office within the State of Hawaii, staffed with factory trained representatives or staff, capable of providing instruction on operation and installation of all system components.
- 2. The control system supplier shall maintain a local support office within the State of Hawaii, staffed with factory trained representatives or staff, capable of providing instruction on operation, installation and trouble shooting of all system components.
- 3. Provide competent and qualified manufacturer's factory-trained and certified field service personnel on-site to be responsible for execution of all diagnostic testing in accordance with equipment manufacturer's installation and start-up certification requirements and warranty terms and conditions.
- 4. The Contractor shall provide manufacturer's representative and/or service technicians for any field modifications to equipment. The Contractor shall ensure that any modifications to equipment will not invalidate the manufacturer's warranties.

## 3.02 PIPING IDENTIFICATION

- A. Identification of all pipe lines shall be by means of colored, waterproof, all temperature, self-adhering labels and directional arrow.
- B. At Contractor's option, each and every system may be identified by painting with contrasting colors, using 3/4" high minimum stencil letters. Painting shall be done by the Mechanical Contractor.
- C. All exposed pipes, whether insulated or not shall be identified. Labels may be omitted from piping where the use is obvious, due to its connection to equipment and where the appearance would be objectionable in finished rooms, as approved by the WHFD AND/OR PROJECT MANAGER.
- D. Identification labels shall be placed as follows:
  - 1. Near each valve and branch connection.
  - 2. Wherever piping merges or disappears from view from the floor of the room in which it is installed.
  - 3. Labels shall not be more than 50 feet apart.

# 3.03 VALVE INDEX

A. The Mechanical Contractor shall provide brass or plastic tags on all valves with letters stamped or engraved thereon designating service of each valve.

# 3.04 FIELD TEST

A. The Mechanical Contractor shall perform all tests of the installed work and shall provide all services, labor, equipment, materials and instruments needed for the tests. During pressure tests, all items in the system to be tested, not designed for test pressures shall be removed or isolated from the system and shall be reconnected or unblocked after tests are completed. Should operating tests require the presence of manufacturers' representatives, the Mechanical Contractor shall cooperate with them and shall place at their disposal all assistance, materials and services required to perform such test. The Mechanical Contractor shall certify in writing that all work has passed all required tests.

# 3.05 POSTED OPERATING INSTRUCTION

A. Furnish approved operating instructions for each principal item of equipment for the use of the operation and maintenance personnel. The operating instructions shall include wiring diagrams, control diagrams and control sequence for each principal item of equipment. Operating instruction shall be printed or engraved and shall be framed under glass or in approved laminated plastic and posted where directed by the WHFD AND/OR PROJECT MANAGER. Operating instructions shall be attached to or posted adjacent to each principal item of equipment including start up, procedure in the event of equipment failure and other items of instruction as recommended by the manufacturer of each item of equipment. Operating instructions exposed to the weather shall be made of weather-resistant materials or shall be suitably enclosed to be weather protected. Operating instructions shall not fade when exposed to sunlight and shall be secured to prevent easy removal or peeling.

## 3.06 INSTRUCTION TO MAINTENANCE PERSONNEL

A. The Contractor shall furnish the services of competent instructors who will give full instruction to the designated personnel in the adjustment, operation and maintenance, including pertinent safety requirements, of the equipment or system specified. Each instructor shall be thoroughly familiar with all parts of the installation and shall be trained in operating theory as well as practical operation and maintenance work. Instruction shall be given during the first regular work week after the equipment or system has been accepted and turned over to the County for regular operation. When significant changes or modifications in the equipment or systems are made under the term of the contract, additional instruction shall be provided to acquaint the operating personnel with the changes or modifications.

## 3.07 SAFETY REQUIREMENTS

A. Belts, pulleys, chains, gears, couplings, projecting setscrews, keys and other rotating parts located so that any person can come in close proximity thereto shall be fully enclosed or properly guarded. High temperature equipment and piping so located as to endanger personnel or create a fire hazard shall be properly guarded or covered with insulation of a type as specified herein. Items such as catwalks, ladders and guardrails shall be provided where required for safe operation and maintenance of equipment.

# 3.08 INSPECTIONS

- A. All work and materials are subject to field observation at any and all times by the WHFD AND/OR PROJECT MANAGER.
- B. Contractor shall notify the WHFD AND/OR PROJECT MANAGER a minimum of two days prior to testing any piping or ducting systems which must be witnessed and approved before they are covered up or enclosed. Should the Contractor fail to notify the WHFD AND/OR PROJECT MANAGER at the times prescribed, it shall then be the Contractor's responsibility to make duct work accessible, expose any concealed lines, or demonstrate the acceptability of any part of the system. Any extra cost caused by the removal of such work shall be borne by the Contractor.
- C. If the WHFD AND/OR PROJECT MANAGER finds any material or work not conforming to these Specifications, Contractor within three days of being notified shall remove said materials from the premises and replace with approved material, at no cost to the Hospital.

# 3.09 FINAL INSPECTION

A. Final inspection shall be requested by the Contractor only after submittal of all required certificates. No final inspection will be made until all moving parts of equipment are properly guarded, all controls and safety devices tested and operative, all painting required done and the site cleaned up.

## 3.10 ONE YEAR GUARANTEE AND MAINTENANCE SERVICE CONTRACT

- A. In addition to the Guaranty on material and workmanship, the installer shall submit the Maintenance Service Contract, countersigned by the Contractor, that will validate said Guaranty.
- B. The Guarantee and maintenance services shall extend for a period of one year commencing after 30 consecutive days of trouble-free operation after the Project Acceptance Date, and shall include all labor, materials, equipment and parts necessary to service the complete system, in accordance with the attached Schedule of Maintenance Service, so as to assure proper operation and function of the system. All costs for the periodic maintenance, including emergency calls, shall be borne by the Contractor. This maintenance period and the Guaranty period shall run concurrently (same start and end dates).
  - 1. Trouble-free operation is defined as a non-disabling condition or a non recurring failure or disruption and the following:
    - a. The system shall be free of all discrepancies, contamination and debris which require correction in excess of those described for the monthly service which is included in the Schedule of Maintenance.
    - b. The system is maintaining operational conditions and other parameters measured during acceptance tests.

- C. The Installer shall include a listing of the following items along with the Maintenance Service Contract:
  - 1. Name of the servicing contractor.
  - 2. Mechanical system acceptance date.
  - 3. Service contract expiration date.
  - 4. Monthly inspection schedule for the maintenance period.
  - 5. Itemized listing of the equipment covered under the service contract, including a description of the equipment identified, its serial number(s) and manufacturer's name(s).

# 3.11 SCHEDULE OF MAINTENANCE SERVICE

A. All services performed by the Contractor shall include applicable items listed but shall not be limited to the following maintenance tasks:

## B. Pumps

- 1. Quarterly Service
  - a. Lubricate and check pump and motor bearings for abnormal temperature and unusual noise or vibration and repair as needed.
  - b. Check packing glands and seals for excessive leakage. Adjust, tighten or replace as required.
  - c. Certify performance of quarterly service and correct and report all discrepancies.

## 2. Semi-Annual Service

- a. Remove and clean strainer for all condenser water pumps after tower cleaning.
- b. Check and blow down strainer for all chilled water pumps after tower cleaning. Remove and clean strainer if excessive debris is noted.
- c. Check condition of insulation, reinsulated as necessary.
- d. Log suction and discharge pressures.
- e. Clean and remove all dust and foreign matter. Clean all rust spots and scratches and touch up paint with matching color.
  - 1) Check motor coupling for alignment; mounting bolts are secure.
  - 2) Certify performance of semi-annual service and correct and report all discrepancies.
  - 3) Certify performance of annual service and correct and report all discrepancies.

## C. Temperature Controls

# 1. Quarterly Service

- a. Check control devices for proper operation, sticking stems, and calibration; repair/replace weak or broken springs and all other parts.
- b. Check automatic dampers for tightness in closing, bent blades and defective linkage; lubricate connections for free movement and repair as required.
- c. Adjust thermostat to maintain 72 degrees F(adj.) room temperature.
- d. Certify performance of quarterly maintenance service and that all discrepancies are reported and corrected.

- e. Notify WHFD AND/OR PROJECT MANAGER of any dangerous conditions, improper storage of furniture, material and supplies which impacts your work within rooms and enclosures, including vandalism.
- D. WORK SCHEDULE: All maintenance work shall be performed between the hours of 7:30 a.m. and 4:00 p.m. on normal working days, Monday through Friday, excluding Holidays.
- E. TROUBLE CALLS: Emergency service and repairs required between regular service calls shall be rendered within 24 hours after the Contractor is notified, non-work days excluded.

### F. MAINTENANCE REPORT

- 1. Maintenance Report
  - a. Submit to the WHFD AND/OR PROJECT MANAGER a Service Maintenance Report using the form found at the end of this section. This form shall include the following:
    - 1) Date maintenance service was performed.
    - 2) The name of the mechanic who performed said maintenance.
    - 3) The type and cost (labor, materials, parts and equipment) of repair work performed on the unit, if any.
    - 4) Documents and other data pertaining to the maintenance performed.
    - 5) It will be the responsibility of the Contractor to maintain the report/ checklist by recording the above noted data after each scheduled maintenance and emergency repairs, and have the checklist available for inspection at the building site.
    - 6) The report shall be sufficiently detailed to properly reflect the past maintenance history of the equipment. Reports shall be certified by a representative of the facility being served and shall be submitted to the WHFD AND/OR PROJECT MANAGER at the completion of the service contract.

# 3.12 CLEANUP AND WORK PRACTICES

- A. The Contractor shall keep the job site free of debris, litter, discarded parts, etc. and shall clean all oil drippings during the daily progress of work. The Contractor shall remove all tools, parts and equipment from the service areas upon completion of the work.
- B. The Contractor shall exercise caution during the progress of its maintenance and repair work to prevent damage to the ceilings, roofing and other building structure. The Contractor shall restore all damages, caused by its negligence, to its original condition at its own expense.

# SERVICE MAINTENANCE REPORT

| TE:       | SHEET NO:   |           |
|-----------|---|-----------|
| Name of   | Facility and Location:  |           |
| Submitte  | d By:   |           |
| Date of S | Service Call:   |           |
| Name of   | Person(s) Making Call:  |           |
| Time In_  | : Time Out  | : At Site |
| Person(s  | ) Contacted:  |           |
| Nature of | f Service Call: (Routine Maintenance or Emergency, Expla                              | ain)      |
|           |   |           |
|           | nt Readings and Maintenance Performed:<br>ems serviced: Identify – 8a, 8b, 8c,, etc.) |           |
|           |   |           |
|           |   |           |
|           |   |           |
|           |   |           |

**END OF SECTION 15000** 

## SECTION 15250 - INSULATION OF MECHANICAL SYSTEMS

### PART 1 - GENERAL

#### 1.01 **RELATED DOCUMENTS**

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.02 GENERAL REQUIREMENTS

- A. Section 15000, "General Mechanical Requirements", with the additions and modifications specified herein, applies to this section.
  - 1. Manufacturer's Stamp or Label: Every package or standard container of insulation, jackets, cements, adhesives and coatings delivered to the project site for use must have the manufacturer's stamp or label attached giving name of manufacturer, brand and description of material. Insulation packages and containers shall be marked "asbestos-free".
  - 2. Fire Resistance: Insulation, adhesives, vapor-barrier materials and other accessories, except as specified herein, shall be noncombustible. The materials shall have a flame-spread rating not more than 25 and a smokedeveloped rating not more than 50 in accordance with NFPA 255, ASTM E 84-80 or UL 723.
    - a. Materials Tests: Test factory-applied materials assembled. Field-applied materials may be tested individually. Use no fugitive or corrosive treatments to impart flame resistance. UL label or satisfactory certified test report from an approved testing laboratory will be required to indicate that fire hazard ratings for materials proposed for use do not exceed those specified. Flame-proofing treatments subject to deterioration due to effects of moisture or high humidity are not acceptable.
    - b. Materials Exempt from Fire-Resistant Rating:
      - 1) Nylon anchors
      - 2) Treated wood inserts

#### 1.03 SUBMITTALS

- A. The items for which the submittal requirements of Section 15000, "General Mechanical Requirements", apply are as follows:
  - 1. Manufacturer's Data:
    - a. Insulation
    - b. Jackets
    - c. Vapor-barrier materials
    - d. Accessory-materials
  - 2. Standards Compliance: Standards compliance labels are required on each container or package:

- a. Insulation
- b. Jackets
- c. Vapor-barrier materials
- d. Accessory materials

#### 1.04 **DEFINITIONS**

- A. Finished Spaces: Habitation or occupancy spaces where rough surfaces are plastered, paneled or otherwise treated to provide a pleasing appearance.
- B. Unfinished Spaces: Storage or work areas where appearance is not a factor, unexcavated spaces, crawl spaces, etc.
- C. Concealed Spaces: Spaces between a ceiling and floor construction above or between double walls or furred-in areas; pipe and duct shafts, etc.
- D. Exposed: Open to view inside the building. For example, pipe run through a room and not covered by other construction, is exposed.
- E. Fugitive Treatments: Treatment of materials subject to deterioration due to aging. moisture, high humidity, oxygen, ozone and heat. Fugitive means entrapped materials that can cause deterioration e.g., solvents, water vapor, etc.
- F. Outside: Open to view beyond the exterior side of walls, above the roof and unexcavated or crawl spaces, above or beneath pier floors, in tunnels or exposed on all sides in trenches connected or not connected to an exterior portion of a building.

#### 1.05 PIPING REQUIRING INSULATION

- A. Cold Water Piping
- B. Hot Water Piping

## **PART 2 - Products**

#### 2.01 **MATERIALS**

A. Asbestos Prohibition: No asbestos containing materials or equipment shall be used under this section. The Contractor shall ensure that all materials and equipment incorporated in this project are asbestos free.

#### 2.02 PIPING INSULATION

A. Insulation exterior shall be cleanable, grease resistant, non-flaking and nonpeeling. Pipe insulation shall conform to the referenced publications and the specified temperature ranges and densities in pounds per cubic foot (pcf). Insulation for fittings and flanges shall be pre-molded, pre-cut or job-fabricated insulation of the same thickness and conductivity as used on adjacent piping. See Table 1 for insulation thickness requirements.

- 1. Interior Cold Water Piping: All interior cold water piping shall be insulated with Rubatex or equal.
- 2. Interior Hot Water Piping: hot water piping shall be insulated with fiberglass insulation with insulation jacket.
- 3. Exterior Hot Water Piping: hot water piping shall be insulated with Pittsburgh Corning Foamglass insulation and finish with Johns Manville, Zeston 2000 PVC Jacket, 0.2 mils thick, or approved equal.

### 2.03 INSULATION JACKETS

A. Vapor-Barrier Material: Material shall be resistant to flame and moisture penetration and not support mold growth. Provide vapor-barrier material on insulation in exposed locations with a white surface suitable for painting without sizing. Perm rating of .01.

# 2.04 ADHESIVES, SEALANTS AND COMPOUNDS

- A. Shall be compatible with materials to which applied and suitable for the service.
  - 1. Vapor-Barrier and Jacket Adhesive: Fire resistant type. Foster Products or approved equal.
  - 2. Lagging Adhesive: Fire resistant type. Foster Products or approved equal.
  - 3. Mineral Fiber Insulation Cement: ASTM C 195, thermal conductivity 0.85 max. at 200 degrees F mean when tested per ASTM C 177.
  - 4. Bedding Compound and Joint Sealer: Fire resistant type. Foster Products or approved equal.
  - 5. Vapor-Barrier Coating: Fire resistant type. Perm rating of .05. Foster Products or approved equal.

# 2.05 ACCESSORIES

- A. Staples: Corrosion-resistant outside-clinch type.
- B. Anchor Pins: Provide anchor pins and speed washers recommended by the insulation manufacturer.
- C. Glass Cloth and Tape: Textile Glass.
- D. Vapor-Barrier Material Tape: Pressure-Sensitive adhesive backed. Arno or approved equal.

### **PART 3 - EXECUTION**

# 3.01 <u>INSTALLATION</u>

A. Install insulation system in accordance with manufacturer's recommendations using tradesman skilled in this trade and approved by the insulation

manufacturer. Provide insulation products with a composite (insulation, jacket and adhesive) fire and smoke hazard rating as tested under ASTM E84, NFPA 255 and UL 723, not exceeding a flame spread of 25 and smoke developed of 50.

B. Pipe Insulation Thickness: Insulation thickness shall conform to Table 1 and per IECC 2015.

| FLUID OPERATING                     | INSULATION CONDUCTIVITY                           |                             | NOMINAL PIPE OR TUBE SIZE (inches) |                                      |             |          |     |
|-------------------------------------|---|-----------------------------|------------------------------------|--------------------------------------|-------------|----------|-----|
| TEMPERATURE RANGE<br>AND USAGE (°F) | Conductivity<br>Btu ain./(h aft²a°F) <sup>b</sup> | Mean Rating Temperature, °F | < 1                                | 1 to < 1 <sup>1</sup> / <sub>2</sub> | 11/2 to < 4 | 4 to < 8 | ≤ 8 |
| > 350                               | 0.32 - 0.34                                       | 250                         | 4.5                                | 5.0                                  | 5.0         | 5.0      | 5.0 |
| 251 – 350                           | 0.29 - 0.32                                       | 200                         | 3.0                                | 4.0                                  | 4.5         | 4.5      | 4.5 |
| 201 – 250                           | 0.27 - 0.30                                       | 150                         | 2.5                                | 2.5                                  | 2.5         | 3.0      | 3.0 |
| 141 – 200                           | 0.25 - 0.29                                       | 125                         | 1.5                                | 1.5                                  | 2.0         | 2.0      | 2.0 |
| 105 – 140                           | 0.21 - 0.28                                       | 100                         | 1.0                                | 1.0                                  | 1.5         | 1.5      | 1.5 |
| 40 - 60                             | 0.21 - 0.27                                       | 75                          | 0.5                                | 0.5                                  | 1.0         | 1.0      | 1.0 |
| < 40                                | 0.20 - 0.26                                       | 50                          | 0.5                                | 1.0                                  | 1.0         | 1.0      | 1.5 |

Table 1.

C. Expansion Clearances: At points where pipe will move during expansion and contraction (expansion joints, Z-bends, expansion loops and ells), clearances between the pipe and encased insulation shall be sized to permit full pipe movement without cracking or damaging insulation and jacket.

## 3.02 FIELD INSPECTION

A. Visually inspect to ensure that materials used conform with specifications. Inspect installation progressively for compliance with requirements.

### 3.03 ONE YEAR GUARANTEE

A. The Contractor shall warrant that all materials and equipment furnished under this section will be new and that all work will be of good quality, free from faults and defects and in conformance with Contract Documents for a guaranteed period of one year after the date of acceptance as specified.

**END OF SECTION 15250** 

## SECTION 15400 - PLUMBING SYSTEM: BASIC MATERIALS AND METHODS

### PART 1 - GENERAL

# 1.01 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.
- B. SECTION 15000 GENERAL MECHANICAL REQUIREMENTS, applies to this section with the additions and modifications specified herein.

## 1.02 WORK SPECIFIED IN THIS SECTION

A. All materials, labor and equipment necessary for complete and operating interior plumbing system within 5 feet of the building line, including complete sanitary and potable water piping.

# 1.03 STANDARDS AND CODES

- A. Installation shall conform to all applicable provisions of the latest editions of the following, as well as to specific standards listed elsewhere in these Specifications:
  - 1. Uniform Plumbing, 1991 Code with The County of Hawaii Amendments.
  - 2. State of Hawaii, Title 11 Administrative Rules, Department of Health.
  - 3. American Society for Testing and Materials (ASTM):
    - a. A74 92 Cast Iron Soil Pipe and Fittings
    - b. A53-90 (Rev. B) pipe, Steel, Black and Hot-Dipped, Zinc-Coated Welded and Seamless
    - c. B88 92 Seamless Copper Water Tube
  - 4. American National Standards Institute (ANSI):
    - a. B16.18 84 Cast Bronze Solder Joint Pressure Fittings
    - b. B16.23 92 Cast Copper Alloy Solder Joint Drainage Fittings -DWV
    - c. Z21.22-86 (Addendum 1990) Relief Valves and Automatic Gas
      - Shutoff Devises for Hot Water Supply Systems

## 1.04 REQUIRED SUBMITTALS

- A. As indicated in SECTION 15000 GENERAL MECHANICAL REQUIREMENTS.
- B. Certificate of compliance by the test laboratory analyzing the water samples following the pipeline disinfection and flushing.
- C. Guarantee: Provide written guarantee for all plumbing work as described in SECTION 15000 GENERAL MECHANICAL REQUIREMENTS.

D. Record Drawings: Provide "as built" record drawings for all plumbing work as described in SECTION 15000 - GENERAL MECHANICAL REQUIREMENTS.

## PART 2 - PRODUCTS

## 2.01 <u>SUBSTITUTIONS</u>

A. Substitutions for products specified with equivalent models shall be submitted for approval in accordance with SECTION 15000 - GENERAL MECHANICAL REQUIREMENTS of these Specifications.

## 2.02 PIPING MATERIALS

- Water Lines Above Grade: Copper Type L, hard temper, with wrought copper or cast bronze fittings made up with 95 5 solder. All copper piping in walls and thru floors shall be provided with IPS Weld-On Pipe Insulators at all wood contact with the copper piping.
- 2. Water Lines Below Grade: Copper Type K, soft temper, with silver solder brazed joints.

### C. GAS PIPING

- Gas Piping: Schedule 40 galvanized steel with galvanized malleable iron screwed fittings. Joints made up with approved lubricant for LPG Service or teflon tape. Gas connector, refrigerant quality soft temper copper tubing, 3/8 inch O.D. underground gas piping shall be black iron with X-tru coat corrosion protection.
- 2. Gas Shut-Off Valves: FNW Fig. 420 bronze ball valve, AGA approved or approved equal.

### 2.03 VALVES

- A. General: Model and number listed in these specifications are the basis for type and quality. Pressure ratings indicated are "working steam pressure" (WSP).
- B. Gate Valves:
  - 1. 2-1/2 inches and smaller: bronze body, 125 psig, non-rising stem Nibco 113 or approved equal. Valves shall be suited for installation in a concrete valve box.
- C. Ball Valves/Balancing Valves: Nibco S-FP-600 brass ball valves, provide with locking lever for balancing valves or approved equal.

## 2.04 UNIONS

- A. Copper: bronze body, 200 psig.
  - 1. For pipes 2 inches and smaller use ground joint

- 2. For pipes 2-1/2 inches and larger use flanged face.
- B. Dielectric Unions shall separate all ferrous and nonferrous metals in all piping systems. Unions shall match those above, except that of metal-to-metal contact shall be avoided. Where flanges are used, the bolts shall be electrically insulated from the body of the flange.

## 2.05 PIPE SLEEVES

A. Schedule 40 galvanized steel pipe sleeves in concrete, 18 gauge galvanized sheet metal sleeves in other construction. Sleeves shall be sized to provide a minimum of 1/4 inch clearance around bare or insulated piping or as otherwise required by Code.

## 2.06 PIPE HANGERS AND SUPPORTS

- A. General: All hangers and supports shall be of the resilient type as indicated below.
- B. For Uninsulated Copper Tubing: Acousto-Plumb Systems.
- C. For Insulated Copper Tubing: Acousto-Plumb Systems.
- D. Riser Clamps: Black steel, Fee and Mason No. 241. PVC coated, Erico, Acousto-Plumb Systems for Copper Piping.
- E. Hanger Spacing:

| <u>Pipe</u>                           | Maximum Spacing                                     |  |
|---------------------------------------|---|--|
| Copper Tubing, 1-1/2 inch and smaller | 6 feet  |  |
| Copper Tubing, 2 inch and larger      | 10 feet   |  |
| Cast Iron Soil Pipe                   | At each joint and at intervals not to exceed 8 feet |  |

F. Hanger Rods: Continuous threaded rod conforming to ASTM A-107. Eye rods shall be Fee and Mason Figure No. 228 and 228 WL. Sizes shall be as follows:

| Pipe Size                | Rod Size   |
|--------------------------|------------|
| 1/2 inches to 2 inches   | 3/8 inches |
| 2-1/2 inches to 3 inches | 1/2 inches |
| 4 inches to 6 inches     | 5/8 inches |

### **PART 3 - EXECUTION**

## 3.01 WORKMANSHIP AND COORDINATION

- A. All work shall be of the highest standard. Poor workmanship will be rejected by the WHFD and/or Project Manager and shall be replaced at no additional cost to the Hospital.
- B. Coordinate this work with schedules of other trades, specifically sanitary and water lines below concrete slabs or concealed in walls. Set all required inserts and sleeves.
- C. Lay out piping to insure a neat and orderly arrangement, with vertical lines plumb.
- D. Carefully handle all exposed piping to avoid tool marking. Handle polished fittings with extra care so tool marks do not show.

# 3.02 PIPING INSTALLATION

# A. Roughing In:

- 1. Proceed with the rough in work as rapidly as general construction will permit and have all of the roughing in stubbed out and tested before any finished work is in place.
- 2. Fit all piping to follow the building structural elements as closely as possible.
- B. General Installation Guidelines: Inspect all pipes fully inside and out for defects. Ream out ends of pipe and remove all burrs. Water lines shall be protected during construction to prevent contamination of interior surfaces.
- C. Do not close up before pipe inspection and approval by the WHFD and/or Project Manager.
- D. Provide pipe sleeves where pipes pass through concrete masonry below grade. Fill annular space within sleeves with 3-hour rated, UL approved fire proof caulking. Flash around base of pipes penetrating the roof. Penetrations shall not leak even under the heaviest rainfall conditions.
- E. Protect copper tubing from coming in contact with dissimilar metal with dielectric union. Wrap underground copper lines with three layers of plastic tape.
- F. Underground water lines below pavement shall have sand cushion and minimum 12-inch cover.
- G. All piping shall be properly and safely supported. Support soil stacks at their bases and at each floor with metal clamps.
  - 1. Horizontal pipes above grade shall be supported with hangers not more than 18 inches from every joint.
- H. Install unions at all equipment and system specialties, whether specifically shown on the drawings or not.

I. Apply pipe insulation in accordance with of the National Insulation Contractors Association (NICA). Insulate all fittings and valve bodies, and cover to match straight pipe sections, or use pre-formed PVC insulation covers. All hot water lines shall be insulated with 1 inch thick fiberglass insulation.

# 3.03 EQUIPMENT SUBSTITUTIONS APPROVAL

A. Do not commence with installation until proposed equipment substitution submittals are approved.

### 3.04 FIXTURE INSTALLATION

- A. Set all plumbing fixtures in an approved workmanlike manner. Point up edges against wall with approved caulking.
- B. Flanges at wall penetrations shall be flush against wall and shall not spin when rotated by hand.
- C. Adjust equipment and plumbing fixtures and trim to operate properly and clean all fixtures just prior to final inspection.

# 3.05 DISINFECTION OF WATER LINES

- A. Flush out water lines to remove foreign matter. After flush water runs clear, disinfect the lines with chlorine in accordance with AWWA Standard C601, pertaining to methods, concentrations, and contact times. Flush out until residual is reduced to 0.3 ppm. Submit a certificate of completion for this work from a contractor experienced and licensed to do disinfecting work.
- B. Obtain two water samples from selected points and submit them to a licensed laboratory for bacteriological testing. Water shall meet Federal water purity standards. Submit the laboratory report or a certification of satisfactory completion of disinfection. All costs of testing shall be borne by the Contractor.

# 3.06 TEST AND ACCEPTANCE INSPECTIONS

- A. Test all new plumbing lines in accordance with methods described in Section 318 of the Plumbing Code. Repair all leaks and repeat the test until all lines are leak free.
- B. Contractor shall arrange for inspections by the County and conduct required tests in the presence of the WHFD and/or Project Manager and inspectors for the County.
- C. Tests shall be repeated as necessary to satisfy the WHFD and/or Project Manager, or such tests shall be made by the County and charged to the Contractor.

**END OF SECTION 15400** 

# SECTION 15700 - HYDRONIC PIPING, EQUIPMENT, AND ACCESSORIES

### **PART 1 - GENERAL**

# 1.01 GENERAL CONDITIONS

A. SECTION 15000 - GENERAL MECHANICAL REQUIREMENTS, applies to this section with additions and modifications specified herein. The piping systems as specified in this section include chilled water; tubing flanges; bolting; gaskets; valves; fittings; pressure containing assemblies; flow measuring equipment and flow control equipment.

# 1.02 <u>SUBMITTALS</u>

- A. Manufacturer's Literature and Data:
  - 1. Piping and Fittings, Gaskets, Valves and Piping Accessories
  - 2. Hangers and Supports
- B. Operation and Maintenance Manuals:
  - 1. Piping Diagrams and Codes
- C. Certified Laboratory Test Reports:
  - 1. Valves
- D. Shop Drawings:
  - 1. Piping Installation
- E. Welding:
  - Welding Procedure: Before any welding is performed, submit three copies of this welding procedure specification for all metals included in the work, together with proof of its qualifications as outlined in ANSI B31.1.
  - 2. Performance Qualification Record: Before any welder or operator performs any welding the Contractor shall submit to the Owners Representative three copies of the Welder's Performance Qualification Record in conformance with ANSI B31.1 showing that the welder was tested under the approved procedure specification submitted by the Contractor. In addition the Contractor shall submit each welder's assigned number, letter or symbol which shall be used to identify the work of the welder which shall be affixed immediately upon completion of the weld. Welders making defective welds after passing a qualification test shall be required to take a re-qualification test. Welders failing the re qualification tests will not be permitted to work under this contract.
  - 3. Previous Qualifications: Welding procedures, welders and welding operators previously qualified by test may be accepted for this contract without re

qualification subject to approval provided that all the conditions specified in ANSI B31.1 are met before a procedure can be used.

F. Brazing: Brazing Procedure: Before any brazing is performed, submit three copies of this brazing procedure specification for all metals included in the work, together with proof of its qualifications as outlined in ANSI/AWS B2.2.

#### 1.03 CORROSION PREVENTION OF FERROUS METALS

A. Expose for 125 hours in a salt spray fog test, indoor equipment shall withstand 500 hours. Equipment located outdoors shall withstand a minimum of 5500 hours. The salt spray fog test shall be in accordance with ASTM B117 using a 5 parts by weight (plus or minus 1) of sodium chloride in 95 parts of distilled water or water containing not more than 200 parts per million of total solid sodium chloride solution. Immediately after completion of the test the coating shall show no signs of blistering, wrinkling or cracking, no loss of adhesion and the specimen shall show no signs of rust creepage beyond 1/8 inch on either side of the scratch mark. The film thickness of the factory coating or paint system applied on the equipment shall not be less than the film thickness used as the test specimen.

#### 1.04 ROTATING EQUIPMENT SAFETY

A. Couplings, Motor Shafts, Gears and other exposed rotating or rapidly moving parts shall be fully guarded in accordance with OSHA 1910.219. The guards shall be cast iron or expanded metal. Guard parts shall be rigid and suitably secured and shall be readily removable without disassembling the guarded unit.

#### 1.05 WELDING AND CUTTING

A. ANSI Z49.1.

#### PART 2 - Products

#### 2.01 WATER PIPING, FITTINGS AND ACCESSORIES

A. Materials and dimensions in accordance with ANSI B31.1 Water Piping Systems as used in this paragraph include chilled water piping systems. Piping systems shall be compatible with system fluids and capable of withstanding the operating pressures and temperatures.

# 1. Chilled Water Piping:

- a. Provide seamless Schedule 40 black steel pipe conforming to ASTM A53. Fittings shall be butt-weld wrought carbon steel conforming to ASRM A234 and ASME B16.9, or flanged type conforming to ANSI B16.5. Convoluted steel flanges conforming to ASME Code Section 8 may be used in lieu of ANSI B16.5 flanges.
- b. At Contractor's option, provide Type "K" hard-drawn copper tube, ASTM B-88, with brazed joints for the pipe size 3 inches and smaller. Copper fittings shall be wrot copper solder-type conforming to ANSI B16.22.

Joints for solder-type fittings shall be brazed using Canfield Sil-Can 15 silver brazing alloy conforming to AWS CcuP-2 and Sil-Can "White Cream" brazing flux. Install copper tube and fittings in accordance with CDA (Copper Development Association) 404/O-RR guidelines.

- 2. Flanges: The raised faces shall be removed when used with flanges having a flat face.
  - Steel Flanges: ANSI B16.5 forged steel, welding type conforming to ASME Code Section 8. Do not use convoluted flanges. Stockham, Walworth or approved equal.
- 3. End Connections: Steel Piping: Steel piping 2 1/2 inches and larger shall be flanged or butt welded.
  - a. Bolting of Flanges: Material used for bolts and studs shall conform to ASTM A307, Grade B and material for nuts shall conform to ASTM A194, Grade 2. Dimensions of bolts, studs and nuts shall conform to ANSI B18.2.1 and ANSI B18.3.2 with threads conforming to ANSI B1.1 coarse type with Class 2A fit for bolts and studs and Class 2B for nuts. Bolts or studs shall extend completely through the nuts and may have reduced shanks of a diameter not less than the diameter at root of threads. Carbon steel bolts shall have American Standard regular square or heavy hexagon heads and shall have American Standard heavy semi-finished hexagonal nuts.
  - b. Gaskets: ASTM D 2000, fluorinated elastomers, suitable for the pressure and temperature ranges encountered and compatible with grooves in flange faces.
  - c. Butt Weld Joints: Shall conform to ANSI B31.1. The use of backing rings shall conform to ANSI B31.1. Ferrous rings shall be of good welding quality and shall not exceed 0.05 percent sulfur; for alloy pipe, backing rings shall be of material compatible with the chemical composition of the parts to be welded and preferably of the same composition. Backing rings shall be of the continuous machined or split band type.
  - d. Socket Weld Joints: Shall conform to ANSI B31.1.
  - e. All connections to mechanical equipment shall be flanged connections.
- 4. Valves: Gate, Special and Related Equipment shall conform to the following paragraphs. End connections shall conform to paragraph "End Connections". Valves shall have rising stems and shall open when turned counterclockwise.
  - a. Ball Valves: Use full port ball valves with threaded/flanged ends for isolation/shutoff. Provide stem extensions, as necessary, to accommodate piping insulation. Operating pressure shall not exceed 80% of the valve pressure class. Use 600 WOG 150 SWP class, forged brass, ball valves with threaded ends.

- b. Drain Valves: Shall be gate valves, bronze, 150 pound class. Shall not be smaller than 3/4 inch nominal pipe size, shall have threaded ends and shall be provided with hose nipple adapters for connecting a hose to lead to a convenient floor drain. The valves shall be manually operated. Stockham, Nibco, or approved equal. Provide at low points on system whether shown on drawings or not.
- c. Air Vent Valves: Shall be Manually Operated General Service Type and Automatic Type. The automatic type air vent valves shall be of the ball float type. The valves shall be provided with cast iron bodies, 300 series corrosion resistant steel float, linkage and removable seat of hardened corrosion resistant steel. Manual vent valves shall be gate valves, bronze, 150 pound class. Valves shall be suitable for hot or cold water service and 125 psi working pressure. The valves shall be 3/4 inch pipe size for water mains and 1/2 inch pipe size, minimum, for all other applications. Air vent valves shall be provided at all high points in the water piping system or as indicated.

#### d. Check Valve:

- Cast Iron Check Valves 2-1/2 Inches and Larger: Valves shall be Class 150 with bronze trim. Provide non slam, eccentric disc type for centrifugal pump discharge service.
- Check valve 2-inches and smaller: Valves shall be of Class 125, thread or solder ends, body and caps shall be of ASTM B-62 cast iron bronze composition swing type disc.

## 5. Miscellaneous Components for Piping System:

- a. Flexible Connector: Shall be for water service and shall be flanged neoprene type with braided stainless steel outer casing and bolted steel control rods. Materials shall be of the type recommended by the manufacturer for use with chilled water. Mason or approved equal.
- b. Y-Type Strainer: Bronze body, 20 mesh stainless steel screen, 125 psi working pressure. Provide with blow-off valve. Mueller Steam Specialty Co. or approved equal.

### Dielectric Insulating Fittings.

- a. Insulating unions or flanges shall be provided at locations described herein unless noted otherwise.
- b. A shutoff valve shall be provided locally, upstream of dielectric insulating fittings, so that repairs can be made easily on these fittings.
- c. Locations requiring insulating couplings or flanges are as follows:
  - 1) At connection points where copper water lines connect to steel domestic water heater tanks.

- 2) At points in water lines where ferrous and other dissimilar metallic pipes are connected together.
- 3) In metallic water and gas service connections into each building within 5 feet of the building wall. Install adjacent to the shutoff valve or cock. and aboveground where possible.
- 4) Where steel or cast iron pipe in the ground connects to copper or brass piping above the ground, the transition from steel or cast iron pipe to the copper or brass pipe shall be made aboveground in an accessible location.
- 5) Where copper or brass piping is connected to steel or cast iron piping and the connection is buried in the ground, the connection shall be covered with a protective coal tar tape wrap extending outward at least 5 feet on pipes, from the point of connection. The tape shall be Protecto Wrap No. 200, or equal. A primer, specifically designed for use with the tape, shall be used. The piping shall be thoroughly cleaned before tape or primer is applied.
- B. Materials and dimensions in accordance with ANSI B31.1 Water Piping Systems as used in this paragraph include salt water piping systems. Piping systems shall be compatible with system fluids and capable of withstanding the operating pressures and temperatures.
  - 1. All PVC Schedule 80 pipe and fittings shall be produced by Spears® Manufacturing Company from PVC Type I cell classification 12454, conforming to ASTM Standard D 1784, or approved equal. All PVC injection molded Schedule 80 fittings and extruded pipe shall be Certified for potable water service by NSF International. All Schedule 80 fittings shall be manufactured in strict compliance to ASTM D 2467 and Schedule 80 pipe shall be manufactured in strict compliance to ASTM D 1785. All fabricated fittings shall be produced in accordance with Spears® General Specifications for Fabricated Fittings. All PVC flanges shall be designed and manufactured to meet CL150 bolt pattern per ANSI Standard B16.5 and rated for a maximum internal pressure of 150 psi, non-shock at 73° F.
  - 2. Ball Valves: Utility sealed unit type constructed from PVC Type I, ASTM D 1784 Cell Classification 12454 or CPVC Type IV, ASTM D 1784 Cell Classification 23447. All O-rings shall be EPDM. All valves shall have Safe-T-Shear® stem and removable Polypropylene handle. All valves shall be certified by NSF International for use in potable water service. All valves shall be pressure rated at 150 psi for water at 73° F, as manufactured by Spears® Manufacturing Company, or approved equal.

# 2.02 THERMOMETERS

A. Seven inch aluminum case, Well Threaded and Seal Welded or Seal Brazed, Range 0 degrees to 100 degrees F., Standard Stem, Adjustable angle. Scale and temperature ranges shall be suitable for the intended service. Thermometers shall be of the organic liquid type as approved. Trerice, Marshalltown or approved equal. Where installed on salt water piping, provide corrosion resistant

thermometers constructed of 316 Stainless Steel, Weiss Instruments or approved equal.

# 2.03 PRESSURE GAUGES

A. Aluminum case, 4 1/2 inch dial size for water. The scale ranges, graduations, figure intervals and type of mounting shall be selected specifically for the intended service. The gauge shall be of a design that is readable from the floor. For pumps, provide compound type gauges as indicated on the drawings. Trerice, Marshalltown or approved equal. Where installed on salt water piping, provide corrosion resistant pressure gauges constructed of 316 Stainless Steel, Weiss Instruments or approved equal.

# 2.04 <u>AUTOMATIC FLOW CONTROL VALVES</u>

A. Bell and Gossett Circuit setter valve with flow rate as indicated or approved equal.

# 2.05 <u>AIR SEPARATOR</u>

A. Furnish and install as shown on plans an external air separator consisting of a steel tank 12" diameter X 22-1/8" long.

The unit shall have 2" flanged inlet and outlet connections and strainer removal connection. The removable strainer shall be of 304 stainless steel with 3/16" diameter perforations and a free area of not less than five times the cross-sectional area of the connecting pipe. Installer shall remove and clean strainer after 24 hours operation and after 30 days operation. There shall be a bottom connection for blowdown cleaning. Unit must be designed, constructed and tested in accordance with the ASME Boiler and Pressure Vessel Code and stamped 125 psig design pressure. Air separation unit shall be Taco, Inc. Model No. AC02F-125 or equal.

# 2.06 <u>COMPRESSION TANK</u>

A. Furnish and install as shown on plans a plain steel compression tank consisting of a steel tank 14" diameter X 46-1/2" long, 30 gallons capacity. Manufactured in Accordance with ASME Section VIII. Maximum working pressure - 125 PSIG. Maximum Operating Temperature - 375\*F. Taco Plain Steel Expansion Tanks are fabricated in accordance with ASME Section VIII Div. 1 to assure quality and performance. Galvanized steel construction. Compression tank shall be Taco, Inc. Model No. PS030-125 PS Expansion Tank or equal.

# 2.07 MOTORIZED SHUT OFF VALVES

- A. Belimo two-way ball valve with valve actuator or approved equal.
  - 1. Non fail-safe actuator type.
  - 2. On/off control type.
  - 3. Ball, and stem: Stainless steel

# 2.08 BUFFER TANK

- A. Furnish and install buffer tank as shown on plans in accordance with all codes and authorities having jurisdiction. Storage tank shall be constructed in accordance with ASME Section VIII for a working pressure not less than 125 psig @ 450°F.
- B. The buffer tank shall be 2-port buffer tank.
- C. The storage tank shall be 210 gallons/30" diameter.
- D. The water connections shall be 3" NPT with a maximum flow rate of 125 gpm.
- E. The buffer tank shall carry a 1-year limited warranty that covers defects in materials and/or workmanship. This limited warranty runs from date of shipment.

#### 2.09 **BOILER**

- A. Basis-of-Design Product: Subject to compliance with requirements, provide AERCO International, Benchmark Boiler Model
  - 1. Approved Equals:
    - a. AERCO Benchmark Platinum boilers BMK
    - b. Viessmann Vitocrossal
    - c. Superior Boiler Creek Series
    - d. Simons Boilers FTC Titan

### B. Construction

- 1. Boiler shall be propane fired, fully condensing, fire tube design. Power burner shall have full modulation, discharge into a positive or negative pressure vent and the minimum firing rate shall not exceed 75,000 BTU/hr input.
- 2. Boilers that have an input greater than what is specified above at minimum fire will not be considered. Boiler efficiency shall increase with decreasing load (output), while maintaining setpoint. Boiler shall be factory-fabricated, factory-assembled and factory-tested, fire-tube condensing boiler with heat exchanger sealed pressure-tight, built on a steel base, including insulated jacket, flue-gas vent, combustion-air intake connections, water supply, return and condensate drain connections, and controls.
- 3. Heat Exchanger: The heat exchanger shall be constructed of 439 stainless steel fire tubes and tubesheets, with a one-pass combustion gas flow design. The fire tubes shall be 1/2" or 5/8" OD, with no less than 0.049" wall thickness. The upper and lower stainless steel tubesheet shall be no less than 0.25" thick. The pressure vessel/heat exchanger shall be welded construction. The heat exchanger shall be ASME stamped for a working

- pressure not less than 150 psig. Access to the tubesheets and heat exchanger shall be available by burner and exhaust manifold removal. Minimum access opening shall be no less than 8-inch diameter.
- 4. Pressure Vessel: The pressure vessel shall have a maximum water volume of 44 gallons.
  - a. The boiler water pressure drop shall not exceed 3 psig @ 170 gpm.
  - b. The boiler water connections shall be 4" flanged 150 pound, ANSI rated.
  - c. The pressure vessel shall be constructed of ASME SA53 carbon steel, with a 0.25 inch thick wall and 0.50-inch thick upper head. Inspection openings in the pressure vessel shall be in accordance with ASME Section IV pressure vessel code. The boiler shall be designed so that the thermal efficiency increases as the boiler firing rate decreases.
- 5. Modulating Air/Fuel Valve and Burner: The boiler burner shall be capable of the following firing turndown ratios without loss of combustion efficiency or staging of gas valves. The turndown ratios shall be 20:1.
  - a. The burner shall not operate above 7.5% oxygen level or 55% excess air. The burner shall produce less than 20 ppm of NOx, under standard calibration, corrected to 3% excess oxygen when firing on natural gas. The burner shall be metal fiber mesh covering a stainless steel body with spark or proven pilot ignition and flame rectification. All burner material exposed to the combustion zone shall be of stainless steel construction. There shall be no moving parts within the burner itself. A modulating air/fuel valve shall meter the air and fuel input. The modulating motor must be linked to both the gas valve body and air valve body with a single linkage. The linkage shall not require any field adjustment. A variable speed cast aluminum pre-mix blower shall be used to ensure the optimum mixing of air and fuel between the air/fuel valve and the burner.
  - b. Fuel: The boiler shall use one of the following gas train options:
    - 1) Propane: The unit gas train shall be specifically designed and calibrated for a single predetermined fuel. The gas train shall be a ventless gas train.
- 6. Minimum boiler efficiencies shall be as follows at a 20 degree delta-T:

| a. | EWT    | 100% Fire | 50% Fire | 7% Fire |
|----|--------|-----------|----------|---------|
|    | 160 °F | 86.5%     | 87%      | 87%     |
|    | 140 °F | 87%       | 87.5%    | 87.5%   |
|    | 120 °F | 88.5%     | 89%      | 90%     |
|    | 100 °F | 93.2%     | 94.5%    | 95.2%   |
|    | 80 °F  | 95.6%     | 96.8%    | 98.2%   |

7. Exhaust Manifold: The exhaust manifold shall be of corrosion resistant cast aluminum or 316 stainless steel with 6-inch diameter flue connection.

- a. The exhaust manifold shall have a collecting reservoir and a gravity drain for the elimination of condensation.
- 8. Blower: The boiler shall include a variable-speed, DC centrifugal fan to operate during the burner firing sequence and pre-purge the combustion chamber.
- Motor Sizes: Minimum size as indicated. If not indicated, large enough so driven load will not require a motor to operate in the service factor range above 1.0.
- 10. Ignition: Ignition shall be via spark or proven pilot ignition with 100 percent main-valve shutoff and electronic flame supervision.
- 11. Combustion Air: The boiler shall be designed such that the combustion air is drawn from the inside of the boiler enclosure, decoupling it from the combustion air supply and preheating the air to increase efficiency.
- 12. Combustion Air Filter: The boiler shall be equipped with an automotive high flow air filter to ensure efficient combustion and unhindered burner components operation.
- 13. Enclosure: The plastic and sheet metal enclosure shall be fully removable, allowing for easy access during servicing.
- 14. O2 sensor located in the Combustion Chamber: The boiler shall be equipped with an Oxygen sensor. The sensor shall be located in the boiler combustion chamber. Boilers without Oxygen sensor or boilers with an Oxygen sensor in the exhaust shall not be acceptable due to measurement estimation and performance accuracy.

### C. Controls

- The boiler shall have an integrated boiler control that provides contact closure for its associated accessories including but not limited to pump, valve and air inlet damper.
- 2. The control shall have a 5-inch color touch screen display as well as six function buttons that are separate from the display. User shall have the ability to navigate the menus via touch screen or navigation buttons. Controls not equipped with navigation button options shall not be permitted.
- 3. The control shall be equipped with a multi-color linear LED light to indicate the level of firing and/or air/fuel valve position.
- 4. The control shall display two temperatures using two dedicated three-digit seven-segment displays.
- 5. The control shall offer an Enable/Disable toggle switch as well as two buttons for Testing and Resetting the Low Water Cutoff.
- 6. The Manager designated boiler control shall be capable of the following functions without the need for additional external controls:

- a. Sequence up to 16 boilers,
- b. Control boiler pumps and/or modulating motorized valves,
- c. Building Automation: The control shall be able to communicate to Building Management Systems using RS485 and communicate using Bacnet.
- 7. The control system shall be segregated into three components: Control Panel, Power Panel and Input/Output Connection Box. The entire system shall be Underwriters Laboratories recognized
- 8. The control panel shall consist of seven individual circuit boards using surface-mount technology in a single enclosure. Each board shall be individually field replaceable. These circuit boards shall include:
- 9. A microcontroller board with integrated 5-inch touchscreen color display providing the user interface.
- 10. A 7-segment display board. This board includes two 3-digit 7-segment displays. These displays shall be used to view a variety of temperature sensor values and operating and startup function status.
- 11. An Interface board connects the microcontroller board to internal components using ribbon cables.
- 12. An electric low-water cutoff board connects to the test and manual reset functions on the microcontroller board.
- 13. A power supply board is designed to provide the different DC voltages to the rest of the boards. It also acts as voltage regulator and reduce power noise.
- 14. An ignition and combustion board. This board controls the air/fuel valve and Safety Shutoff Valve, flame status and ignition transformer
- 15. A connector board used to connect all external electrical connection.
- 16. Control settings transfer using USB: The control shall simplify and significantly lessen startup and boiler setting time by being able to use a USB flash drive to copy settings from one boiler to another boiler. Installers shall use successfully preconfigured boiler settings in their portfolio to newly installed boilers.
- 17. Combustion calibration: The control shall offer at least 5 calibration points. The use of less than 5 calibration points is not permitted to improve overall system efficiency under all firing rates. Each combustion calibration point shall operate with 5 to 7% O2 levels to improve operating efficiency. Deviating away from these values shall not be acceptable.
- 18. Unit and Plant Status: The control shall provide a quick view of the unit status and plant status.
- 19. The unit status screen shall provide temperature setpoint, all water inlet and outlet and supply air and exhaust temperature sensors' values. It shall also

- provide unit current and target firing rates. Additional screens shall display unit run hours, cycle count and average cycles per hour.
- 20. The plant status screens shall provide plant temperature setpoint, plant water supply and return temperatures, outdoor temperature. Additionally, a status screen shall show the boiler status of each plant unit, plant firing rate.
- 21. Unit and Plant event history: The manager control shall display the last 500 historical events per plant or 200 historical events for single unit installations.
- 22. Software update: The control shall be capable of field software updates without a need for hardware component(s) replacement. This shall be performed either using software on a USB flash drive or via Internet connection. The software update mechanism shall be performed by a trained technician. The software update menus shall be secured using a password level. After the software update, the control shall retain all of its prior field settings.
- 23. Copy settings from one boiler to the other: To significantly reduce installation time by reducing long repetitive work, the control shall have the capability of saving its settings to a USB flash drive. In addition, the control shall have the ability of copying new settings from a flash drive.
- 24. The controls shall annunciate boiler and sensor status and include extensive self-diagnostic capabilities.
- 25. The control panel shall incorporate three self-governing features designed to enhance operation in external control modes. When operating by an external control signal, the control panel can work to eliminate nuisance faults, such as over-temperature, resulting from improper external signal or loss of external signal. These features include:
  - a. Setpoint High Limit: Setpoint high limit allows for a selectable maximum boiler outlet temperature and acts as temperature limiting governor. Setpoint limit is based on a PID function that automatically limits firing rate to maintain outlet temperature within a 0 to 10 degree selectable band from the desired maximum boiler outlet temperature.
  - b. Setpoint Low Limit: Allow for a selectable minimum operating temperature.
  - c. Failsafe Mode: Failsafe mode allows the boiler to switch its mode to operate from an internal setpoint if its external control signal is lost, rather than shut off. This is a selectable mode, enabling the control can to shut off the unit upon loss of external signal, if so desired.
- 26. The boiler control system shall incorporate the following additional features for enhanced external system interface:
  - a. System start temperature feature
  - b. Pump delay timer

- c. Remote interlock circuit
- d. Delayed interlock circuit
- e. Delta-T Limiter
- f. Freeze protection
- g. Fault relay for remote fault alarm
- h. Warm-weather shutdown
- 27. The control shall offer multi-level user security access using different passwords. For additional security, the passwords shall expire if control display was not touched for an extended period 30 minutes.
- 28. Each boiler shall include an electric, single-seated combination safety shutoff valve/regulator with proof of closure switch in its gas train. Each boiler shall incorporate dual over-temperature protection with manual reset, in accordance with ASME Section IV and CSD 1.
- 29. Each boiler shall utilize a low cost reliable automotive O<sub>2</sub> sensor that measures and monitors the oxygen content of the exhaust gases. The system shall adjust the blower speed to maintain optimal air-fuel ratios in the event of air inlet temperature changes. The system shall have the following capabilities:
- 30. The system shall provide warnings or alerts in the following cases:
  - a. O<sub>2</sub> percentage out of range
  - b. When O<sub>2</sub> sensor has fallen out of calibration
- 31. Output of O2 information shall be displayed on the control panel.
- 32. The O<sub>2</sub> sensor shall be installed through the unit's burner plate and measure the oxygen content directly within the unit's combustion chamber.
- 33. Boilers without an equivalent O<sub>2</sub> sensing system will be deemed unacceptable. Due to the moisture content of flue gases from condensing boilers, placing the O<sub>2</sub> sensor in the exhaust manifold or stack will be deemed unacceptable.
- 34. Each boiler shall be remote monitoring ready with a standard Ethernet port and include a 5-year subscription at no additional charge. Remote monitoring service grants the user online access to real time operation and status of their system plant from any computer, tablet or mobile device along with the following capabilities:
  - a. Efficiency status and trends
  - b. O2 levels

- c. Efficiency and performance optimization tips
- d. Preventative Maintenance alerts and scheduling
- e. Predictive Maintenance algorithms.
- f. Warning and error messages
- g. Weekly or monthly performance and status reports
- h. Manage multiple boiler plants or buildings
- i. Customizable dashboard
- j. Add email contacts for alerts and reports, including local AERCO trained technicians
- k. Manage and store startup, maintenance and service documentation
- 35. The boiler manufacturer shall be able to provide a network hub or a network switch to connect up 16 boilers to an online network.
- 36. Each boiler shall have integrated boiler sequencing, capable of multi-unit sequencing with lead-lag functionality and parallel operation. The system will incorporate the following capabilities:
- 37. Efficiently sequence 2 to 16 units on the same system to meet load requirement.
- 38. Integrated control and wiring for seamless installation of optional isolation valve. When valves are utilized, the system shall operate one motorized valve per unit as an element of load sequencing. Valves shall close with decreased load as units turn off, with all opening under no-load conditions.
- 39. Automatically rotate lead/lag amongst the units on the chain and monitor run hours per unit and balance load in an effort to equalize run hours among active units.
- 40. Option to manually designate lead and last boiler
- 41. Designated manager control, used to display and adjust key system parameters.
- 42. Automatic bump-less transfer of manager function to next unit on the chain in case of designated manager unit failure; manager/client status should be shown on the individual unit displays.
- 43. The controller shall have the ability to vary the firing rate and energy input of each individual boiler throughout its full modulating range to maximize the condensing capability and thermal efficiency output of the entire heating plant. The control system shall control the boiler outlet header temperature within +2°F. The controller shall be a PID type controller and uses Ramp Up/Ramp Down control algorithm for accurate temperature control with

excellent variable load response. The control system controller shall provide contact closure for auxiliary equipment such as system pumps and combustion air inlet dampers based upon outdoor air temperature.

- 44. The control system shall have the following anti-cycling features:
  - a. Manual designation of lead boiler and last boiler.
  - b. Lead boiler rotation at user-specified time interval.
  - c. Delay the firing/shutting down of boilers when header temperature within a predefined deadband.
- 45. When set on Internal Setpoint Mode, temperature control setpoint on the control system shall be fully field adjustable from 50°F to 190°F in operation. When set on Indoor/Outdoor Reset Mode, the control system will operate on an adjustable inverse ratio in response to outdoor temperature to control the main header temperature. Reset ratio shall be fully field adjustable from 0.3 to 3.0 in operation. When set on 4ma to 20ma Temperature Control Mode, the control system will operate the plant to vary header temperature setpoint linearly as an externally applied 4-20 ma signal is supplied.
- 46. When set on temperature control mode, the control system will operate the plant to vary header temperature setpoint as an external communication utilizing the Bacnet protocol is supplied via the RS-232 port. The control system controller shall have a vacuum fluorescent display for monitoring of all sensors and interlocks. Non-volatile memory backup of all control parameters shall be internally provided as standard. The controller will automatically balance the sequence of operating time on each boiler by a first-on first-off mode and provide for setback and remote alarm contacts. Connection between central control system and individual boilers shall be twisted pair low voltage wiring, with the boilers 'daisy-chained' for ease of installation.

### D. Venting

- 1. The exhaust vent must be UL Listed for use with Category II, III and IV appliances and compatible with operating temperatures up to 230°F, condensing flue gas service. UL listed vents of Polypropylene and Al 29-4C stainless steel must be used with boilers.
- 2. The minimum exhaust vent duct size for each boiler is six-inch diameter.
- 3. Combustion-Air Intake: Boilers shall be capable of drawing combustion air from the outdoors via a metal or PVC duct connected between the boiler and the outdoors.
- 4. The minimum ducted combustion air duct size for each boiler is six-inch diameter.
- 5. Common vent and common combustion air must be an available option for boiler installation. Consult manufacturer for common vent and combustion air sizing.

6. Follow guidelines specified in manufacturer's venting guide.

# E. Source Quality Control

- 1. Burner and Hydrostatic Test: Factory adjust burner to eliminate excess oxygen, carbon dioxide, oxides of nitrogen emissions and carbon monoxide in flue gas, and to achieve combustion efficiency. Perform hydrostatic testing.
- 2. Test and inspect factory-assembled boilers, before shipping, according to ASME Boiler and Pressure Vessel Code.
- 3. If boilers are not factory assembled and fire-tested, the local vendor is responsible for all field assembly and testing.
- Allow WHFD and/or Project Manager access to source quality-control testing of boilers. Notify WHFD and/or Project Manager fourteen days in advance of testing.

# 2.10 REHEAT HOT WATER PUMPS

- A. The contractor shall furnish (and install as shown on the plans) Aurora Model vertical close coupled inline back pull-out centrifugal pumps or approved equal.
- B. Pump impeller of all bronze construction. The suction and discharge flanges shall be located on a common CL 180° apart for mounting in-line. Pump performance as shown on plan. Each pump is to be furnished with a mechanical seal with all metal parts to be 303 stainless steel with Buna-N elastomers, Ni-Resist seat and carbon washer. A bypass line must be provided between the seal faces and the discharge flange to assure adequate venting of the seal chamber and to provide lubrication. Impellers are to be dynamically balanced and keylocked to the shaft. Model 382A pumps to include a volute type casing suction branch to minimize pumping noise.
- C. The unit must be equipped with bronze shaft sleeve, keylocked, that extends the length of the seal box. Pump shaft extension shall be o-ring sealed from the pumped liquid. Pump casing shall have a case wearing ring (impeller wearing rings). Each pump is to be close coupled to a standard NEMA-JM total enclosure motor.

# 2.11 <u>VARIABLE FREQUENCY DRIVE</u>

- A. Variable Frequency Drives Acceptable Manufacturers
  - 1. Franklin Control Systems P-Series
  - 2. Eaton
  - 3. Or approved equal.

## B. General Design

a. All VFD's must be solid state, utilizing PWM control with energy optimizing control algorithms for lower operating temperature.

- b. VFD's shall be current rated, with each model capable of operating on voltages of 200~480 VAC +/- 10%, 3 Phase.
- c. VFD's shall be suitable for use on a circuit capable of delivering not more than 100,000 rms symmetrical amperes, 480 V per UL 61800-5-2 guidelines, without the use of external fused protection. Manufacturer's short circuit testing shall be performed at full rated capacity of 100,000 Amps.
- d. The VFD must be minimum UL Type 1 for indoor applications, and UL Type 4X for outdoor applications.
- e. VFD must utilize R3Filtering or equivalent to reduce harmonics on the line side of the VFD. Harmonic mitigation shall reduce THDi to 35% or less without the use of external reactors or filters.
- f. With cover removed, VFD shall have a minimum IP20 (finger safe) rating, with high voltage terminals protected from contact with the installer/operator.
- g. Circuit boards shall be conformal coated to protect against dust and corrosion.
- h. VFD cooling fans shall be easily replaceable without the use of special tools, or removal of the VFD from the wall. Cooling fans shall also be replaceable without removal of circuit boards, field wiring, and factory wiring. Cooling fans shall only run when needed based on the internal temperature of the VFD.
- i. Programming of the VFD shall be HVAC specific, with guides that walk the operator through the start-up procedure with access to troubleshooting info through the display.
- j. All VFD shall include two independent analog inputs as standard, programmable for 0 –10VDC or 4-20mA. Both analog inputs shall be utilized as speed references, or as PID inputs. The analog inputs shall be programmed as an individual reference at a time, or as a combined reference together.
- k. There shall be a minimum of (2) configurable digital inputs, and (2) configurable voltage inputs. Digital inputs shall be configurable as normally open or normally closed, and be rated up to 8mA at 24 VDC. Voltage inputs shall be capable of interfacing with 12-240V, 8mA max.
- I. There shall be a minimum of (1) relay outputs rated up to 1 amp at 240 VAC normally open contact. Relay shall be configurable for Fault, Run and status. 240V 1A maximum rating.
- 2. AC Line Reactors and DC Filters
  - a. Provide AC line reactor to reduce harmonics.

b. Provide DC filters when cable lengths are greater than 20'.

# Keypad

- a. The VFD display shall be a backlit, full color OLED display. The VFD shall display information in complete English words (alpha-numeric codes are not acceptable unless accompanied by complete English descriptions on the display). Faults shall also be written in complete English words.
- b. The VFD shall have dedicated HOA buttons, and LED indicator lights to clearly designate HOA position.
- c. The VFD display shall clearly indicate the operational state of the VFD, in addition to running values on the home (default) screen. This shall include at minimum:
  - 1) Run status
  - 2) Fault status
  - 3) Forward/Reverse
  - 4) Speed in Hz or RPM
  - 5) Running current
  - 6) Average RMS voltage
  - 7) Run source (Terminal, Keypad, HOA, Communications)
  - 8) Min/Max Speed
  - 9) PID set point, and min/max units when running in PID mode
- d. VFD keypad shall be capable of passcode protection.

## 4. Electrical Ratings

- a. Voltage: Input 200~480 VAC +/- 10%, 3 phase, 48-63Hz
- b. Output Frequency: 0-400 Hz
- c. Power factor: ≥ .99
- d. Efficiency: ≥98%, full load
- e. Overload capacity: 110% for 60s @ 40°C, 83% for 30s @ 50°C
- f. Carrier Frequency: 2kHz 10kHz, 0.1kHz resolution, Default 2.5kHz
- g. Harmonics: R3Filtering ≤ 35% THDi, without external reactors or filters

h. EMI/RFI: VFD's shall include EMI/RFI filters acceptable for the 1st Environment (Category C2), compliant to EN 61800-3 Radiated and Conducted Emissions

# 5. Environmental Ratings

- a. Temperature
  - 1) Operating Temperature: -10 to 40°C
  - 2) Storage Temperature: -20 to 65°C
- b. Altitude
  - 1) Max 1000m above sea level
  - 2) De-rate 1% per 100m from 1000-2000m and 2% per 100m from 2000-3000m
- c. Humidity: 95% relative humidity, non-condensing
- d. Enclosures
  - 1) UL Type 1 minimum for indoor mounting locations
  - 2) UL Type 3R minimum for outdoor mounting locations
  - 3) VFD shall be IP20 (finger safe) with cover removed

### 6. Standard Features

- a. VFD shall provide start-up report in PDF format that details all running values, and settings. All settings that have been changed from factory default shall be highlighted in the report such that changes are easily distinguishable.
- b. The VFD shall incorporate a real-time clock with battery back-up allowing faults and setting changes to be logged with real time and date. The battery shall replaceable without removal of factory wiring or circuit boards. Battery shall have a minimum life span of 10 years under normal operating conditions.
- c. All programming shall be HVAC specific, with common HVAC applications available to expedite the start-up process by automatically adjusting parameters according to the application selected.
- d. All VFD must have a motor preheat function to prevent moisture accumulation in an idle motor.
- e. All VFD must be capable of maintaining a set point via microprocessor based PID control on closed loop systems utilizing external 4-10mA, or 0-

10V analog transmitters. VFD's must be capable of providing auxiliary power up to 0.5 amp at 24 VDC for external transmitters. PID set points shall be adjustable via the VFD keypad, communication protocols. Digital inputs shall be programmable to switch between pre-configured user defined set points.

- f. PID: Control action, proportional plus integral derivative.
- g. All VFD display units shall be selectable, and shall automatically adjust based on Applications selected at start up. VFD shall be capable of displaying PSI, Degrees F/C, inWC, Bar, mBar, Pa, kPa.
- h. VFD's shall have sleep and wake functions to save energy when set point is met in PID mode, and there is no additional demand on the system.
- i. Sleep boost functionality shall be used on PID controlled pressurized water systems to ensure the drive doesn't start and stop too frequently when at or near the desired pressure setpoint.
- j. The VFD shall provide frequency setting resolution of 0.01 Hz when its Digital Reference is utilized below 100 Hz and 0.1 Hz over 100 Hz. The VFD shall provide frequency setting resolution of 0.03 Hz / 60 Hz when Analog Reference is utilized.
- k. The VFD shall have the ability to automatically restart after an overcurrent, over-voltage, under-voltage, or loss of input signal protective trip. The number of restart attempts, trial time, and time between reset attempts shall be programmable.
- I. The VFD shall be capable of both Automatic and Manual Torque Boost function to overcome sudden fluctuation of the load.
- m. The VFD shall be capable of starting into a rotating load (forward or reverse) and accelerate or decelerate to set-point without safety tripping or component damage (flying start).
- n. All VFD shall have 1 analog output (0-10VDC) which can be programmed to function as one of the following: Output Frequency, Output Current, and DC Bus Voltage. Default is set to Output Frequency.
- o. If the input reference (4-20mA or 0-10V) is lost, the VFD shall give the user the option of either (1) stopping and automatically reset once a signal restored (2) displaying a fault, (3) holding the VFD speed based on the last good reference received 1 second prior to losing the signal. The drive shall be programmable to signal this condition via a keypad warning, relay output and/or over the serial communication bus.
- p. The customer terminal strip shall be isolated from the line and ground.
- q. The VFD shall have dedicated damper control terminals capable of providing up to 1 amp, 24VDC to open a damper actuator, and ensure end switch closure with normally open dry contact. To ensure proper damper functionality a damper time delay shall be programmable. The

VFD shall fault in the event that the damper fails to make contact with the end switch within the user defined time delay. Use of external relays and CPT's is prohibited unless damper loads exceed 1 Amp max.

- r. The Maximum current limit shall be fixed at 150% (minimum, instantaneous) of the VFD normal duty current rating.
- s. The VFD shall be capable of 3 preset speeds that are activated via Digital Input Terminals.
- t. The VFD shall provide from 1 to 6000 seconds of Acceleration and Deceleration time setting parameters.
- The VFD shall be optimized for various levels of carrier frequency programmable from 2 to 10 kHz to reduce motor noise and to provide high system efficiency.
- v. VFD's shall have a minimum of 3 critical lockout skip frequency ranges. Low and high frequency settings shall programmable for each lockout skip frequency range.
- w. VFD's shall be capable of recording minimum of 100 faults and 25 setting changes with true time and date stamping. Faults and settings shall be downloadable in PDF format.
- x. VFD's shall allow settings to be stored as configuration templates in manufacturer provided mobile application. Configuration templates shall be capable of being uploaded into un-configured VFD's to expedite the start-up process.
- y. The VFD shall have the following protection features. In the case of a protective trip, the drive shall stop and announce the fault condition. Options shall be available for faults to auto reset and retry with adjustable time delay. When VFD's are in fault conditions, display shall clearly indicate the name of the fault in plain English. Fault codes are not acceptable. The display shall also clearly indicate if the VFD is awaiting an automatic restart by counting down time until next restart.
  - Motor overload
  - 2) Motor overcurrent
  - 3) VFD overcurrent
  - 4) VFD short circuit
  - 5) Overvoltage
  - 6) Undervoltage
  - 7) Input phase open

- 8) Output phase open
- 9) No motor
- 10) Ground Fault
- z. The VFD shall have the following faults to ensue desired operation
  - 1) BMS communication loss
  - 2) Speed signal loss
  - 3) Transducer failure
- aa. All VFD shall be capable of configuring digital inputs or voltage inputs for dedicated shutdown, or fireman's override functionality under the following premise.
  - 1) Shutdown
    - a) When configured for shutdown, the digital input or voltage input terminal shall override all other commands and stop the VFD in any mode. This condition shall be stored in the VFD fault log.
  - 2) Fireman's Override
    - a) When configured for Fireman's Override, the digital input or voltage input terminal shall override all other commands and run the VFD at user defined preset speed until the terminal is deactivated. During a Fireman's override condition, all non-critical faults shall be ignored, and VFD shall "run to destruct" if configured terminal is not deactivated. Once the override signal is removed the VFD shall automatically return to normal operation.

#### 7. Communications

- a. All VFD's must have RS-485 ports as standard. The following BAS communication protocols shall be native to the VFD, without the need for option boards:
  - 1) BACnet MS/TP
  - 2) Modbus TCP
- b. Serial communications shall include the following capabilities; start/stop and speed control, monitoring of all running values, fault and alarm indication, fault detail, power consumption data, I/O configuration and status, VFD firmware and hardware identification, configuration of startup parameters, and configuration of protective functions.
- c. VFD's must be accompanied by wireless mobile application to assist with start-up, troubleshooting, uploading/downloading of parameters, firmware

- updates, reporting, and fault logging. Application to be provided at no additional charge.
- d. Minimum 128-bit AES encryption shall be used for any wireless communication.

# 8. Bypass

- a. VFD Bypass shall be integral to the VFD, and provide the same level of protection as the base VFD unit when in Bypass mode. Thermal overload protection is not acceptable.
- b. VFD Bypass shall not have a separate set of customer control terminals. A single set of control terminals shall be provided, with electrical isolation and control logic isolation to ensure bypass operation is unaffected in the event of VFD failure.
- c. VFD shall have the ability to automatically switch to bypass mode in the event of a VFD fault. For protective functions with automatic restart enabled, the VFD shall attempt to restart in VFD mode prior to switching to bypass. Auto-bypass functionality shall be user selectable.
- d. Bypass shall maintain BACnet or Modbus communication when in bypass mode, and in the event of VFD failure.
- e. Bypass shall have the following SmartStart protection features to ensure smooth across the line operation when in bypass mode:
  - 1) Stall prevention
  - 2) Locked rotor
  - 3) Max time to start
- f. Bypass shall be capable of monitoring current. Thermal overload protection is not acceptable.
- g. VFD bypass shall maintain control by monitoring the VFD's analog input. This will control the bypass in an on or off state to maintain desired setpoint/process output.

#### **PART 3 - EXECUTION**

## 3.01 INSTALLATION

A. Install piping and piping components to insure proper and efficient operation of the equipment and controls and in accordance with manufacturer's printed instructions. Proper supports for the mounting of vibration isolators, stands, guides, anchors, clamps and brackets shall be provided. Piping connections to equipment shall be arranged so that removal of equipment or components of equipment can be accomplished with the least amount of disassembly or removal of the piping system. Piping connected to equipment with vibration isolators shall be provided with flexible connections which shall conform to vibration and sound isolation requirements for the system. Electric isolation shall be provided between dissimilar metals to reduce the rate of galvanic corrosion.

1. Water Piping: Air vents shall be provided at high points and drains at low points in the chilled water system.

# 3.02 PIPING SYSTEMS

- A. Cut to the measurements established at the site and work into place without springing or forcing. Install piping with line flexibility included to absorb the expansion and contraction due to temperature changes of the piping systems. Piping line flexibility shall be achieved by the use of pipe bends or loops or bellows type expansion joints. Where piping shall pass through the structure of the building the pipe joints shall not be concealed but shall be located where they are accessible for inspection.
  - 1. Flanged Joints: Faced true, square, tight and used where necessary for normal maintenance. Mate with valves and various equipment connections. Select gaskets, packing and thread compounds for suitability with the particular fluid with which they shall be in contact.
  - 2. Reducing Fittings: Shall be used to connect changes of sizes in piping lines. Branch connections shall be made with tees except that factory made forged steel welding branch outlets or nozzles having integral reinforcements and conforming to ANSI B31.1 may be used if the nominal diameter of the piping system branch does not exceed one nominal pipe size less than the nominal size of the piping segment which contains the fitting.
  - Dielectric Unions or Flanges: Provide between ferrous and non ferrous piping, equipment and fittings; except that bronze valves and fittings may be used without dielectric couplings for ferrous to ferrous or non ferrous connections. Flanges and unions shall conform to the requirements of ANSI B16.10 Standard.
  - 4. Piping System Supports: Factory-fabricated by Elcen, Fee and Mason, Grinnell, or Unistrut; no chains or straps permitted. Provide concrete inserts, beam clamps, channel framing hanger rods and accessories required for proper pipe support. Concrete inserts must be used at all pre-stressed planks.
  - 5. Ramset or explosive type anchors are not permitted. Support steel and copper pipe at maximum spacing of 6 feet for pipes 1-1/2 inches and smaller, 10 feet for pipes 2 inches through 4 inches and 15 feet for pipes larger than 4 inches. Support vertical piping with hanger at base of riser and with pipe clamp at each floor. On vertical chilled water risers, clamps shall be mounted 2" above finished slab with steel rod supports. At each support point on insulated piping, provide Pittsburgh Corning Foamglass insulation around pipe with 18-gage sheet metal jacket each two pipe diameters in length. Pipe hangers shall be steel clevis hanger with adjustable hanger rod; 3/8-inch for pipe 2 inches and smaller, 1/2-inch for pipe 2-1/2 inches through 3-1/2 inches

- and 5/8-inch for pipe 4 inches and larger. Groups of lines may be supported from steel channel with pipe clamp.
- 6. Pipe Guides: Shall be spider type, cylindrical type or hold down slide type utilizing factory bonded graphite, teflon or oil impregnated metal matched surfaces. Teflon or oil impregnated matched surfaces shall be protected and cleaned prior to start up.
- 7. Condensate Drain Piping Systems: Slope lines at 1/4-inch per foot unless otherwise directed. Provide a water seal with water column 1-inch greater than the total static pressure of the fan in inches of water. Terminate condensate drain over nearest plumbing drain when not otherwise indicated. See insulation specified hereinafter.
- 8. Flexible Connections: Install flexible pipe connectors or couplings on piping connected to equipment. The material used and the configuration shall be suitable for pressure, temperature and circulating medium. The flexible section shall have flanged ends and shall be suitable for the service intended. The flexible section may be reinforced with metal retaining rings, with built-in braided wire reinforcement and restriction bolts or with wire braid cover suitable for the service intended.

# 3.03 CHILLED WATER PIPING

- A. Fabrication and Assembly of Piping and Components: Welding shall conform to ANSI B31.1 and as specified herein. Provide drain valves at low points of piping system and automatic air vent valves at high points where air pockets would occur. All piping shall follow the general arrangement shown, cut accurately to measurements established for the work by the Contractor and worked into place without springing or forcing, except where cold springing is indicated. Provide adequate clearance from walls and roofs to permit the welding of joints and reroofing work; at least 6 inches for pipe sizes 4 inches and less, 10 inches for pipe sizes over 4 inches and in corners provide sufficient clearance to permit the welder to work between the pipe and one wall. Provision for expansion and contraction of pipe lines shall be made. Changes in size of water lines shall be made with reducing fittings. Protect materials and equipment from the weather. Use flanged joints only where necessary for normal maintenance and where required to match valves and equipment. Install joints so that flange faces bear uniformly on gaskets. All gaskets, packing and thread compounds shall be suitable for the service. Long radius ells shall be used wherever possible to reduce pressure drops.
- B. Do not miter pipe to form elbows or notch straight runs to form full sized tees or any similar construction. All branch connections shall be made with welding tees except factory made forged welding branch outlets or nozzles having integral reinforcements conforming to ANSI B31.1 may be used, provided the nominal diameter of the branch is at least one pipe size less than the nominal diameter of the run. All piping shall be run essentially as indicated, avoid interference with other piping, conduit or equipment. Except where specifically shown otherwise, run vertical piping plumb and straight and parallel to walls. Trapping of lines shall not be permitted except as otherwise indicated. Provide sleeves of suitable size for all lines passing through building structure. Piping connected to equipment shall be installed to provide flexibility for thermal stresses and for vibration, and

shall be adequately supported and anchored so that strain from weight and thermal movement of piping is not imposed on the equipment. Each section of pipe, fittings and valves shall be thoroughly cleaned and positively free of all foreign matter before erection. Prior to erection, each piece of pipe shall be held in an inclined position and thoroughly tapped to loose sand, mill scale and foreign matter. Before all final connections are made to apparatus, wash the interior of all piping thoroughly with water. Blow out piping with compressed air to remove rust chips, oil and debris. Plug or cap open ends of mains during all shutdown periods. Lines shall not be left open at any place where foreign matter might accidentally enter pipe.

- 1. Valves: Install at equipment to allow maintenance or isolation, and to establish proper and sequential operation of the complete system.
- 2. Air Vent Valves: Provide at high points in water piping. Isolate valves and pipe to run off into the nearest floor drain.
- 3. Access Doors: Provide where required, whether shown on drawings or not, for adequate access to controls and equipment. Where installed in fire rated ceilings or walls, provide fire rated access panels to preserve the fire rating of the assembly.

## 3.04 CLEANING OF SYSTEMS

- A. When installations of the various components of the piping systems are completed, they shall be cleaned with water before final closing. All piping and components shall be cleaned free of scale and thoroughly flushed of all foreign matter. All strainers and valves shall be thoroughly cleaned. Equipment shall be wiped clean, with all traces of oil, dust, dirt or paint spots removed. The Contractor shall maintain the system in this clean condition until final approval. Piping and equipment shall be cleaned and painted.
  - 1. Safety Procedure: Ventilate work area and avoid skin contact. Solvent resistant gloves shall be used. Observe precautions and warnings on the manufacturer's product labels.

# 3.05 IDENTIFICATION OF PIPING

A. Conform to Section 15000, "General Mechanical Requirements" and as specified herein. Spacing of identification marking on runs shall not exceed 50 feet. Tag equipment, gauges, thermometers, valves and controllers. Tags shall be of brass or approved nonferrous material and shall be securely mounted or attached.

# 3.06 FIELD INSPECTIONS

A. Prior to initial operation the piping systems will be examined and inspected for conformance to plans and specifications and ANSI Code B31.1 for chilled water and condenser water piping. Equipment, material or work rejected because of defects or non-conformance with plans, specifications and ANSI Codes for pressure piping shall be corrected by the Contractor as directed.

## 3.07 FIELD TESTS

- A. After completion of the piping installation and prior to initial operation, tests shall be conducted on the piping system. Furnish materials and equipment required for tests. Defects disclosed by the test shall be corrected by the Contractor. Test after installation and prior to acceptance, shall be performed in the presence of the Owners Representative and shall be subject to its approval.
  - 1. Chilled Water Piping: Hydrostatically test in accordance with the requirements of ANSI B31.1. Test piping system at one and one-half times system pressure but at least 100 psig with water not exceeding 100 degrees F. Before tests, remove or isolate gauges, traps and other apparatus in the piping system which may be damaged. Repair leaks by tightening, rewelding joints or renewing pipe or fittings. Caulking of joints will not be permitted. Install a calibrated test pressure gauge in the system to observe loss in pressure. The required test pressure shall be maintained for a sufficient amount of time to enable an inspection to be made of joints and connections. Defects disclosed by the test shall be corrected by the Contractor.

#### 3.08 START-UP AND OPERATIONAL TESTS

A. The chilled water systems shall be started up and initially operated. During this time, the various strainers shall be periodically cleaned until no further accumulation of foreign material occurs. Adjust safety and automatic control instruments as necessary to place them in required operation and sequence.

**END OF SECTION 15700** 

# SECTION 15901 – TESTING, ADJUSTING AND BALANCING (TAB)

#### PART 1 - GENERAL

## 1.01 GENERAL CONDITIONS

A. As specified in Division 1 sections.

### 1.02 SCOPE

- A. Procure the services of an independent contractor qualified in TAB as defined in Chapter 34 of the 1995 ASHRAE Handbook HVAC Application. The TAB work shall include the following:
  - 1. Air conditioning equipment.
  - 2. Ducts, duct outlets and duct inlets.
  - 3. Transfer ducts, openings, grilles and registers.
  - 4. Pipes, coils, and valves.
  - 5. Electrical measurements.
  - 6. Controls and control components.
  - 7. Sound and vibration measurements.

## 1.03 RELATED WORK SPECIFIED ELSEWHERE

- A. Division 16 ELECTRICAL
- B. Section 15800 AIR CONDITIONING AND VENTILATION
- C. Section 15950 NETWORKED BUILDING CONTROLS.

## 1.04 GENERAL REQUIREMENTS:

A. It is the intent of the plans and specifications to provide a complete installation. Should there be omissions or discrepancies in the plans and specifications such as dampers, gauges, and sensors that will inhibit the proper TAB process, the Contractor shall call the attention of the WHFD AND/OR PROJECT MANAGER to such omissions and discrepancies in advance of the date of bid opening so that the necessary corrections can be made. Otherwise the Contractor shall furnish and install the omissions or discrepancies as if the same were specified and provided for. A test report shall be provided at the completion of each phase.

#### 1. Standards:

a. All work shall be done in accordance with applicable ordinances and codes of the County of Hawaii and in accordance with State Department of Health regulations.

- b. Work shall comply with applicable regulations of the State of Hawaii, National Fire Protection association (NFPA) Pamphlet No. 90A, and American Society of Heating, Refrigerating and Air Conditioning WHFD AND/OR PROJECT MANAGER s (ASHRAE) Standard 111.
- c. Applicable standard published by the National Environmental Balancing Bureau (NEBB) and/or the Associated Air Balance Council (AABC).
- d. Contractor shall obtain all permits, licenses and certificates and pay for all fees.
- 2. Drawings and Specifications: The drawings and specifications are intended to cover the complete installation of systems to function as described. The omission of reference to any necessary item of labor or material shall not relieve the Contractor from providing such labor or material. Drawings do not attempt to show exact details of piping and ductwork.
  - a. Contract Drawings: Mechanical plans are essentially diagrammatic, showing locations of ducts, and other mechanical equipment. Where locations are not dimensioned, they are approximate, Contractor shall study existing conditions and plan his work in the most logical manner.
  - b. Shop Drawings: As soon as practical, obtain a set of shop drawings and data submittals including the automatic control diagrams that have been reviewed by the WHFD AND/OR PROJECT MANAGER. Refer to section 15800, and coordinate with the Contractor to obtain all pertinent information on the mechanical systems.

#### 1.05 DEFINITIONS

- A. Accuracy: The accuracy of an instrument is the capability of that instrument to indicate the true value of a measured quantity.
- B. Adjusting: Adjusting is the varying of system flows by partially closing balancing devices, such as dampers and valves, and varying fan speeds to achieve optimum system operating conditions within design and installation limitations.
- C. AHJ: The local governing Authority Having Jurisdiction over the installation.
- D. Balancing: Balancing is the methodical proportioning of air and hydronic flows through the system mains, branches, and terminal devices using acceptable procedures to achieve the specified airflow or hydronic flow within testing and design limitations.
- E. Calibrate: The act of comparing an instrument of unknown accuracy with a standard of known accuracy to detect, correlate, report, or eliminate by adjustment any variation in the accuracy of the tested instrument.
- F. Conformed Contract Documents: Current and complete documents.
- G. Deficiency: Deficiency is considered any circumstance that adversely affects the specified balance of a device or system.

- H. Environmental Systems: Environmental Systems are systems that primarily use a combination of mechanical equipment, airflow, water flow and electrical energy to provide heating, ventilating, air conditioning, humidification, and dehumidification for the purpose of human comfort or process control of temperature and humidity.
- I. May: The word may is used to indicate a course of action that is permissible as determined by the NEBB/AABC Firm.
- J. NEBB/AABC Certified TAB Firm: A NEBB/AABC Certified TAB Firm is a firm that has met and maintains all the requirements of the National Environmental Balancing Bureau for firm certification in Testing, Adjusting, and Balancing and is currently certified by NEBB/AABC. A NEBB/AABC Certified TAB Firm shall employ at least one NEBB/AABC Qualified TAB Supervisor in a full time management position.
- K. NEBB/AABC Certified TAB Report: The data presented in a NEBB/AABC Certified TAB Report accurately represents system measurements obtained in accordance with the current edition of the NEBB/AABC Procedural Standards for Testing, Adjusting, and Balancing of Environmental Systems. A NEBB/AABC Certified TAB Report does not necessarily guarantee that systems included are balanced to design flows. Any variances from design quantities, which exceed NEBB/AABC tolerances or contract document tolerances, are noted in the test-adjust-balance report project summary.
- L. NEBB/AABC Qualified TAB Supervisor: A NEBB/AABC Qualified TAB Supervisor is a full time employee of the firm in a management position who has successfully passed the supervisor level written and practical qualification examinations and maintains the Supervisor re-qualification requirements of NEBB/AABC.
- M. NEBB/AABC Qualified TAB Technician: A NEBB/AABC Qualified TAB Technician is a full time employee of the firm who has met the technician level experience requirements of NEBB/AABC and has successfully passed the technician level written and practical qualification examinations. A NEBB/AABC Qualified TAB Technician shall be supervised by a NEBB/AABC Qualified TAB Supervisor. (Supervision is not intended to infer constant oversight. A NEBB/AABC Qualified TAB Technician is capable of performing assigned tasks with periodic supervision.)
- N. Precision: Precision is the ability of an instrument to produce repeatable readings of the same quantity under the same conditions. The precision of an instrument refers to its ability to produce a tightly grouped set of values around the mean value of the measured quantity.
- O. Procedure: A Procedure is defined as a specific set of tasks to be accomplished to achieve the defined result.
- P. Range: Range is the upper and lower limits of an instrument's ability to measure the value of a quantity for which the instrument is calibrated.
- Q. Resolution: Resolution is the smallest change in a measured variable that an instrument can detect.

- R. Shaft Pressurization System: A type of smoke-control system that is intended to positively pressurize stair and / or elevator shafts with outdoor air by using fans to keep smoke from contaminating the shafts during an alarm condition.
- S. Shall: The word shall is used to indicate mandatory requirements strictly to be followed in order to conform to the standard and procedures and from which no deviation is permitted. Note: In the event unique circumstances prevent a required action from being fulfilled, a notation shall be included in the TAB report explaining the exception. For example, such notation could be one of the following: Not Available, Not Applicable, or Not Accessible. The simple notation "N/A" is not allowed.
- T. Should: The word should is used to indicate that a certain course of action is preferred but not necessarily required.
- U. Smoke-Control System: An engineered system that uses fans to produce airflow and pressure differences across barriers to limit smoke movement.
- V. Smoke-Control Zone: A space within a building that is enclosed by smoke barriers and is a part of a zoned smoke-control system.
- W. Stair Pressurization System: A type of smoke-control system that is intended to positively pressurize stair towers with outdoor air by using fans to keep smoke from contaminating the stair towers during an alarm condition.
- X. System Effect: A phenomenon that can create undesired or unpredicted conditions that cause reduced capacities in all or part of a system.
- Y. TAB Technician: A TAB Technician is an employee of a NEBB/AABC Certified TAB firm who assists a NEBB/AABC Qualified TAB Supervisor and / or a NEBB/AABC Qualified TAB Technician by performing TAB work in the field. (Supervision is not intended to infer constant oversight. A TAB Technician may be capable of performing assigned tasks without direct, full time supervision.)
- Z. Terminal: A point where the controlled medium, such as fluid or energy, enters or leaves the distribution system
- AA.Testing: Testing is the use of specialized and calibrated instruments to measure temperatures, pressures, rotational speeds, electrical characteristics, velocities, and air and hydronic quantities for an evaluation of flow conditions.
- BB.Testing, Adjusting, and Balancing (TAB): TAB is a systematic process or service applied to heating, ventilating and air-conditioning (HVAC) systems and other environmental systems to achieve and document air and hydronic flow rates. The standards and procedures for providing these services are referred to as "Testing, Adjusting, and Balancing" and are described in this document.

## 1.06 TAB FIRM QUALIFICATIONS

A. The TAB Firm shall be NEBB/AABC Certified in Testing, Adjusting and Balancing of Air and Hydronic Systems.

# 1.07 <u>SUBMITTALS</u>

- A. Within 15 days after the "Notice to Proceed", the independent air balance agency shall submit 3 copies of documentation to confirm compliance with the following:
  - 1. The completion of five(s) project of similar size and scope of this project.
  - 2. The agency is a certified firm by the NEBB or the AABC and employs one or more qualified supervisor(s) as defined by the NEBB or AABC.
  - 3. All instruments and equipment used by the agency is accurately calibrated in accordance with the requirements of NEBB or AABC.
  - 4. Specimen copies of each of the report forms proposed for use on this project.
- B. At least 60 days prior to starting field work, submit 3 copies of:
  - 1. Shop drawings clearly showing the equipment, air devices and associated apparatus related to the report forms. Limit one entry to one line of the report form.
  - 2. A set of report forms filled out as to the design values and the installed equipment pressure drops, the required CFM for air terminals, and design parameters to be used in the TAB process.
  - 3. A complete list of instruments proposed to be used organized in appropriate categories, with data sheets for each. Show:
    - a. Manufacturer and model number.
    - b. Description and use when needed to further identify the instrument.
    - c. Size or capacity range.
    - d. Latest calibration date.
  - 4. WHFD AND/OR PROJECT MANAGER will review submittals for compliance with contract documents, and will return one set marked to indicate:
    - a. Discrepancies noted between data shown and contract documents.
    - b. Additional, or more accurate, instruments required.
    - c. Requests for re-calibration of specific instruments.

# 1.08 **GUARANTEE**

A. Testing agency shall include an extended warranty of 90 days, after completion of test and balance work, during which time the WHFD AND/OR PROJECT MANAGER at his discretion may request a recheck, or resetting of any outlet or supply air fan, as listed in test report. The testing agency shall provide technicians to assist the WHFD AND/OR PROJECT MANAGER in making tests he may require during this period of time.

## 1.09 CONTRACTOR RESPONSIBILITY TO TAB AGENCY

- A. Provide the NEBB/AABC Certified TAB Firm with a conformed set of contract documents (drawings, specifications, and approved submittals), including all current approved change orders / contract modifications.
- B. Develop a project schedule with the input of the NEBB/AABC Certified TAB Firm that coordinates the work of other disciplines and provides adequate time in the construction process to allow successful completion of the TAB work.
- C. Notify the NEBB/AABC Certified TAB Firm of schedule changes.
- D. Ensure that the building enclosure is complete, including but not limited to, all structural components, windows and doors installed, door hardware complete, ceilings complete, stair, elevator and mechanical shafts complete, roof systems complete, all plenums sealed, etc.
- E. Ensure that all necessary mechanical work is complete. This includes, but is not limited to, duct leakage testing and hydrostatic testing. The piping systems should be flushed, filled, vented, and chemically treated. The duct systems and equipment have been cleaned.
- F. Complete the installation of permanent electrical power systems serving the HVAC equipment and systems. Such systems shall be properly installed in accordance with all applicable codes to ensure the safety of all construction personnel.
- G. Complete the installation of all HVAC equipment and systems to ensure safe operation.
- H. Perform the start up of all HVAC equipment and systems in accordance with the manufacturer's recommendations.

## PART 2 - PRODUCTS (Not Used)

# **PART 3 - EXECUTION**

#### 3.01 JOB CONDITIONS & COORDINATION

- A. Prior to start of testing, adjusting and balancing, verify that the required "Job Conditions" are met:
  - 1. Systems installation is complete and in full operation.
  - 2. Outside conditions are within a reasonable range relative to design conditions.
  - 3. Lights are turned "on" when lighting is included in the cooling load.
  - 4. Special equipment such as computers, laboratory equipment, and electronic equipment are in full operation.

#### B. Coordination:

- 1. Coordinate services with the work of the various trades to ensure rapid completion of the services.
- Promptly report to the Contractor and WHFD AND/OR PROJECT MANAGER any deficiencies noted during performance of services to allow immediate corrective action.

# 3.02 <u>PROCEDURES FOR TESTING, ADJUSTING, AND BALANCING EXISTING</u> SYSTEMS

A. Perform TAB of existing systems to the extent indicated by the contract documents and the current edition of the NEBB/AABC TAB Standards.

#### 3.03 ACCEPTANCE CRITERIA

- A. The systems will be considered balanced in accordance with NEBB/AABC TAB Standards when the following conditions are satisfied:
  - All measured airflow and hydronic flow quantities are within ± 10 percent of the design quantities unless there are reasons beyond the control of the NEBB/AABC Certified TAB Firm. Deficiencies shall be noted in the TAB report.
  - There is at least one direct path with fully open dampers from the fan to an air inlet or outlet. Additionally, if a system contains branch dampers, there will be at least one wide-open path downstream of every adjusted branch damper.
  - 3. There is at least one direct path with fully open balancing valves from the pump discharge balancing valve (if present) to a terminal device. Additionally, if a system contains branch balancing valves, there will be at least one wide open path downstream of every adjusted branch balancing valve.

#### 3.04 REPORTING

- A. Provide appropriate deficiency information to the construction team as TAB work progresses.
- B. Deficiency information shall be sufficient to facilitate contractor's dispatch of appropriate personnel to resolve items noted prior to final TAB work.

# 3.05 FINAL REPORT

A. The final report shall be in accordance with the requirements of the current edition of the NEBB/AABC TAB Standards.

**END OF SECTION 15901** 

## SECTION 15950 - NETWORKED BUILDING CONTROLS

#### PART 1 - GENERAL

# 1.01 GENERAL CONDITIONS:

A. As specified in Division 1 sections.

# 1.02 <u>SECTION INCLUDES</u>

- A. Scope of Work
- B. Related Section
- C. Description
- D. Approved Control System Contractor
- E. Quality Assurance
- F. System Performance
- G. Submittals
- H. Warranty
- I. Ownership of Proprietary Material

# 1.03 PRODUCTS INSTALLED BUT NOT FURNISHED UNDER THIS SECTION

- A. Control devices and systems to provide the functional requirements of these specifications and as shown on the drawings.
  - 1. Direct Digital Control (DDC) and hard-wired interface controls of Heating, Ventilating, and Air Conditioning (HVAC) equipment and systems with electronic positioning of valves and dampers.
  - 2. Electronic control of air handling units, and similar units for control of room conditions.
  - Complete hard-wired HVAC controls and instrumentation for: air distribution systems including fan coil units, room temperature and humidity, exhaust systems for other special equipment, ventilating for mechanical and other utility spaces, and control wiring and piping.
- B. Connect the new DDC controls and electronic operators as indicated on the control diagrams and points list to the existing DDC system. All DDC control units shall be from American Control Inc, and shall communicate directly with the existing building control system serving The Kona Community Hospital (KCH) located at the Facilities Office.
- C. The successful controls bidder (controls contractor) will be responsible for all equipment and labor required to fully monitor and control the equipment as

shown and specified. The controls contractor will also be responsible for creating BACnet objects of all shown points and provide them to the ICS/Setpoint in the format acceptable to ICS/Setpoint

A separate contract will be generated to the ICS/Setpoint by the controls contractor for modifications and programming required to integrate the new work into the existing building management system.

## 1.04 RELATED SECTIONS

- A. The General Conditions of the Contract, Supplementary Conditions, and General Requirements are a part of these Specifications and shall be used in conjunction with this Section as a part of the Contract Documents. Consult them for further instructions pertaining to this work. The Contractor is bound by the provisions of Division 0 and Division 1.
- B. Section 15000 GENERAL MECHANICAL REQUIREMENTS
- C. Section 15800 AIR CONDITIONING AND VENTILATION
- D. Section 15901 TESTING, ADJUSTING, AND BALANCING (TAB)

#### 1.05 DESCRIPTION

- A. General: The control system shall be as indicated on the drawings and described in the specifications.
- B. Direct Digital Control (DDC) technology shall be used to provide the functions necessary for control of mechanical systems on this project.
- C. The control system shall accommodate simultaneous multiple user operation. Access to the control system data should be limited only by operator password. Multiple users shall have access to all valid system data. An operator shall be able to log onto any workstation on the control system and have access to all appropriate data.
- D. The control system shall be designed such that each mechanical system will be able to operate under stand-alone control. As such, in the event of a network communication failure, or the loss of any other controller, the control system shall manual bypass switch to continue to independently operate under control.
- E. Communication between the control panels and all workstations shall be over a high-speed network. All nodes on this network shall be peers. The operator shall not have to know the panel identifier or location to view or control an object. Application Specific Controllers shall be constantly scanned by the network controllers to update point information and alarm information.
- F. The documentation is schematic in nature. The Contractor shall provide hardware and software necessary to implement the functions and sequences shown.

# 1.06 APPROVED CONTROL SYSTEM CONTRACTOR:

- A. Approved Control System Contractor for Kona Community Hospital are:
  - 1. ICS/Setpoint.
  - 2. American Controls
  - 3. Hawaii Energy Systems

# 1.07 QUALITY ASSURANCE

- A. System Installer Qualifications
  - 1. The Installer shall have an established working relationship with the Control System Manufacturer of not less than three years.
  - The Installer shall have successfully completed Control System
     Manufacturer's classes on the control system. The Installer shall present for
     review the certification of completed training, including the hours of instruction
     and course outlines upon request.
  - 3. The installer shall provide 24-hour remote response in the event of a customer call.
  - 4. The above list of manufacturers applies to operator workstation software, controller software, the custom application programming language, Building Controllers, Custom Application Controllers, and Application Specific Controllers. All other products specified herein (i.e., sensors, valves, dampers, and actuators) need not be manufactured by the above manufacturers.
- B. Codes and Standards: Meet requirements of all applicable standards and codes, except when more detailed or stringent requirements are indicated by the Contract Documents, including requirements of this Section.
  - 1. National Electrical Code -- NFPA 70.
  - 2. Federal Communications Commission -- Part J.
  - 3. ASHRAE/ANSI 135-1995 (BACnet)
- C. All products used in this installation shall be new, currently under manufacture, and shall be applied in similar installations for a minimum of 2 years. This installation shall not be used as a test site for any new products unless explicitly approved by the WHFD AND/OR PROJECT MANAGER in writing prior to bid date. Spare parts shall be available for at least 5 years after completion of this contract.

#### 1.08 SYSTEM PERFORMANCE

- A. Performance Standards
  - 1. The system shall conform to the following:

- Graphic Display: The system shall display a graphic with a minimum of 20 dynamic points. All current data shall be displayed within 20 seconds of the request.
- b. Graphic Refresh: The system shall update all dynamic points with current data within 30 seconds.
- c. Object Command: The maximum time between the command of a binary object by the operator and the reaction by the device shall be 10 seconds. Analog objects shall start to adjust within 10 seconds.
- d. Object Scan: All changes of state and change of analog values shall be transmitted over the high-speed network such that any data used or displayed at a controller or workstation will be current, within the prior 60 seconds.
- e. Alarm Response Time: The maximum time from when an object goes into alarm to when it is annunciated at the workstation shall not exceed 45 seconds.
- f. Program Execution Frequency: Custom and standard applications shall be capable of running as often as once every 5 seconds. The Contractor shall be responsible for selecting execution times consistent with the mechanical process under control.
- g. Performance: Programmable Controllers shall be able to execute DDC PID control loops at a selectable frequency from at least once every 5 seconds. The controller shall scan and update the process value and output generated by this calculation at this same frequency.
- h. Multiple Alarm Annunciation: All workstations on the network shall receive alarms within 5 seconds of each other.
- i. Reporting Accuracy: Table 1 lists minimum acceptable reporting accuracies for all values reported by the specified system.

# Table I -- Reporting Accuracy

| Measured Variable | Reported Accuracy |
|-------------------|-------------------|
| Space temperature | ±0.5°C [±1°F]     |
| Ducted air        | ±1.0°C [±2°F]     |
| Outside air       | ±1.0°C [±2°F]     |
| Water temperature | ±0.5°C [±1°F]     |
| Delta-T           | ±0.15°C[±0.25°F]  |
| Relative humidity | ±5% RH            |

Water flow ±5% of full scale

Air flow (terminal) ±10% of reading \*Note 1

Air flow (measuring stations) ±5% of reading

Air pressure (ducts) ±25 Pa [±0.1 "W.G.]

Air pressure (space) ±3 Pa [±0.01 "W.G.]

Electrical Power 5% of reading \*Note 3

Carbon Dioxide (CO2) ± 50 PPM

Note 1: (10%-100% of scale) (cannot read accurately below 10%)

## 1.09 SUBMITTALS

- A. Contractor shall provide shop drawings and manufacturers' standard specification data sheets on all hardware and software to be provided. No work may begin on any segment of this project until the WHFD AND/OR PROJECT MANAGER and Hospital have reviewed submittals for conformity with the plan and specifications. Five (5) copies are required. All shop drawings shall be provided to the Hospital electronically as .dwg or .dxf file formats.
- B. Quantities of items submitted shall be reviewed by the WHFD AND/OR PROJECT MANAGER and Hospital. Such review shall not relieve the contractor from furnishing quantities required for completion.
- C. Provide the WHFD AND/OR PROJECT MANAGER and Hospital, any additional information or data which is deemed necessary to determine compliance with these specifications or which is deemed valuable in documenting the system to be installed.
- D. Submit the following within 60 days of contract award:
  - 1. A complete bill of materials of equipment to be used indicating quantity, manufacturer and model number.
  - 2. A schedule of all control valves including the valve size, model number (including pattern and connections), flow, CV, pressure rating, and location.
  - 3. A schedule of all control dampers. This shall include the damper size, pressure drop, manufacturer and model number.
  - 4. Provide manufacturers cut sheets for major system components. When manufacturer's cut sheets apply to a product series rather than a specific product, the data specifically applicable to the project shall be highlighted or clearly indicated by other means. Each submitted piece of literature and drawings shall clearly reference the specification and/or drawing that the submittal is being submitted to cover. Include:

- a. Building Controllers
- b. Custom Application Controllers
- c. Application Specific Controllers
- d. Operator Interface Computer
- e. Portable Operator Workstation
- f. Auxiliary Control Devices
- g. Proposed control system riser diagram showing system configuration, device locations, addresses, and cabling.
- h. Detailed termination drawings showing all required field and factory terminations. Terminal numbers shall be clearly labeled.
- Points list showing all system objects, and the proposed English language object names.
- j. Sequence of operations for each system under control. This sequence shall be specific for the use of the Control System being provided for this project.
- k. Provide a BACnet Product Implementation Conformance Statement (PICS) for each BACnet device type in the submittal.
- I. Color prints of proposed graphics with a list of points for display.
- E. Project Record Documents: Upon completion of installation submit one (1) copy of record (as-built) documents. The documents shall be submitted for approval prior to final completion and include:
  - Project Record Drawings: These shall be as-built versions of the submittal shop drawings. One set of electronic media including CAD .DWG or .DXF drawing files shall also be provided.
  - 2. Testing and Commissioning Reports and Checklists.
  - 3. Operating and Maintenance (O&M) Manual: These shall be as built versions of the submittal product data. In addition to that required for the submittals, the O&M manual shall include:
    - a. Names, address and 24-hour telephone numbers of Contractors installing equipment, and the control systems and service representative of each.
    - Operators Manual with procedures of operating the control systems including logging on/off, alarm handling, producing point reports, trending data, overriding computer control, and changing set points and other variables.

- c. Programming Manual with a description of the programming language including syntax, statement descriptions including algorithms and calculations used, point database creation and modification, program creation and modification, and use of the editor.
- d. Engineering, Installation and Maintenance Manual(s) that explains how to design and install new points, panels, and other hardware; preventative maintenance and calibration procedures; how to debug hardware problems; and how to repair or replace hardware.
- e. A listing and documentation of all custom software created using the programming language including the point database. One set of magnetic media containing files of the software and database shall also be provided.
- f. One set of electronic media containing files of all color-graphic screens created for the project.
- g. Complete original issue documentation, installation, and maintenance information for all third party hardware provided including computer equipment and sensors.
- h. Complete original issue media for all software provided including operating systems, programming language, operator workstation software, and graphics software.
- i. Licenses, Guarantee, and Warrantee documents for all equipment and systems.
- j. Recommended preventive maintenance procedures for all system components including a schedule of tasks (inspection, cleaning, calibration, etc.) time between tasks, and task descriptions.
- F. Training Manuals: The Contractor shall provide a course outline and training manuals for all training classes at least six weeks prior to the first class. The Hospital reserves the right to modify any or all of the training course outline and training materials. Review and approval by Hospital and WHFD AND/OR PROJECT MANAGER and shall be completed at least 3 weeks prior to first class.

# 1.10 WARRANTY

- A. Warrant all work as follows:
  - Labor & materials for control system specified shall be warranted free from defects for a period of twelve (12) months after final completion acceptance by the Hospital. Control System failures during the warranty period shall be adjusted, repaired, or replaced at no charge or reduction in service to the Hospital. The Contractor shall respond to the Hospital's request for warranty service within 24 hours during customary business hours.
  - 2. At the end of the final start-up/testing, if equipment and systems are operating satisfactorily to the Hospital and WHFD AND/OR PROJECT

MANAGER, the Hospital shall sign certificates certifying that the control system's operation has been tested and accepted in accordance with the terms of this specification. The date of Hospital's acceptance shall be the start of warranty.

- 3. Operator workstation software, project specific software, graphics, database, and firmware updates shall be provided to the Hospital at no charge during the warranty period.
- 4. Written authorization by Hospital must, however, be granted prior to the installation of such changes.
- 5. The system provider shall provide a web-accessible Users Network to give the Hospital access to question/answer forum, graphics library, user tips, upgrades, and training schedules.

## 1.11 OWNERSHIP OF PROPRIETARY MATERIAL

- A. All project developed hardware and software shall become the property of the Hospital. These include but are not limited to:
  - 1. Project graphic images
  - 2. Record drawings
  - 3. Project database
  - 4. Job-specific application programming code
  - 5. All documentation

#### **PART 2 - PRODUCTS**

# 2.01 <u>SECTION INCLUDES</u>

- A. Acceptable Manufacturers
- B. Operator Interface
- C. System Software
- D. Building Controllers
- E. Custom Application Controllers
- F. Application Specific Controllers
- G. Communications
- H. Input/Output Interface
- I. Auxiliary Control Devices

# 2.02 <u>ACCEPTABLE MANUFACTURERS</u>

- A. Acceptable systems are:
  - 1. Delta controls
- B. The Contractor shall use only listed manufacturer's products as shown in Section 1 of this division. When a product or component is referred to by manufacturer's name and/or model number, the Contractor shall use only that product.

# 2.03 OPERATOR INTERFACE

- A. Operator Interface: The existing system is Delta Controls enteliWEB.
- B. Integrate new work into the existing Web server and user workstations.
- C. System Software:
  - Operating System: Furnish a commercially available, concurrent multitasking operating system. Acceptable operating systems are Windows 2000 Professional and Windows XP Professional.
  - 2. System Graphics: The Operator Workstation software shall be graphically oriented. The system shall allow display of up to 10 graphic screens at once for comparison and monitoring of system status. Provide a method for the operator to easily move between graphic displays and change the size and location of graphic displays on the screen. The system graphics shall be able to be modified while on line. An operator with the proper password level shall be able to add, delete, or change dynamic points on a graphic. Dynamic points shall include analog and binary values, dynamic text, static text, and animation files. Graphics shall have the ability to show animation of equipment. Graphics shall be capable of launching other PC applications.
    - a. Custom Graphics: Custom graphic files shall be created with the use of commonly available graphics packages such as PC Paint. The graphics generation package shall create and modify graphics that are saved in industry standard formats such as PCX, BMP, GIF and JPEG. The graphics generation package shall also provide the capability of capturing or converting graphics from other programs such as Designer, or AutoCAD.
    - b. Graphics Library: Furnish a complete library of standard HVAC equipment such as chillers, boilers, air handlers, terminals, fan coils, and unit ventilators. This library shall also include standard symbols for other equipment including fans, pumps, coils, valves, piping, dampers, and ductwork. The library shall be furnished in a file format compatible with the graphics generation package program.
    - c. Engineering Units: Allow for selection of the desired engineering units (i.e. Inch Pound) in the system. Unit selection shall be able to be customized by locality to select the desired units for each measurement. Engineering units on this project shall be Standard Inch Pound.

- D. System Applications: Each workstation shall provide operator interface and offline storage of system information. Provide the following applications at each workstation.
  - 1. Automatic System Database Save and Restore: Each workstation shall store on the hard disk a copy of the current database of each building controller. This database shall be updated whenever a change is made in any panel in the system. The storage of this data shall be automatic and not require operator intervention. In the event of a database loss in a building management panel, the first workstation to detect the loss shall automatically restore the database for that panel.
  - Manual Database Save and Restore: A system operator with the proper password clearance shall be able to archive the database from any system panel and store on magnetic media. The operator shall also be able to clear a panel database and manually initiate a download of a specified database to any panel in the system.
  - System Configuration: The workstation software shall provide a graphical method of configuring the system. The user with proper security shall be able to add new devices, and assign modems to devices. This shall allow for future system changes or additions.
  - 4. On-Line Help and Training: Provide a context sensitive, on line help system to assist the operator in operation and editing of the system. On-line help shall be available for all applications and shall provide the relevant data for that particular screen. Additional help information shall be available through the use of hypertext. Provide an interactive tutorial CD, which will act as online training/help for the systems operator.
  - 5. Security: Each operator shall be required to log on to the system with a user name and password in order to view, edit, add, or delete data. System security shall be selectable for each operator. The system supervisor shall have the ability to set passwords and security levels for all other operators. Each operator password shall be able to restrict the operator's access for viewing and/or changing each system application, full screen editor, and object. Each operator shall automatically be logged off of the system if no keyboard or mouse activity is detected. This auto logoff time shall be set per operator password. All system security data shall be stored in an encrypted format.
  - 6. System Diagnostics: The system shall automatically monitor the operation of all workstations, printers, modems, network connections, building management panels, and controllers. The failure of any device shall be annunciated to the operator.
  - 7. Alarm Processing: Any object in the system shall be configurable to alarm in and out of normal state. The operator shall be able to configure the alarm limits, warning limits, states, and reactions for each object in the system.
    - a. Alarm Reactions: The operator shall be able to determine what actions, if any, are to be taken, by object (or point), during an alarm. Actions shall include logging, printing, starting programs, displaying messages, dialing

out to remote stations, paging, forwarding to an e-mail address, providing audible annunciation or displaying specific system graphics. Each of these actions shall be configurable by workstation and time of day. An object in alarm that has not been acknowledged within an operator specified time period shall be re-routed to an alternate operator specified alarm receipt device.

- b. Binary Alarms: Each binary object shall be set to alarm based on the operator-specified state. Provide the capability to disable alarming when the associated equipment is turned off or is being serviced.
- c. Analog Alarms: Each analog object shall have both high and low alarm limits and warning limits. Alarming must be able to be automatically and manually disabled.
- 8. Trend Logs: The operator shall be able to define a custom trend log for any data in the system. This definition shall include interval, start-time, and stoptime. Trend intervals of 1, 5, 15, 30, and 60 minutes as well as once a shift (8 hours), once a day, once a week, and once a month shall be selectable. All trends shall start based on the hour. Each trend shall accommodate up to 64 system objects. The system operator with proper password shall be able to determine how many samples are stored in each trend. Trend data shall be sampled and stored on the Building Controller panel and be archived on the hard disk. Trend data shall be able to be viewed and printed from the operator interface software. Trends must be viewable in a text-based format or graphically. They shall also be storable in a tab delimited ASCII format for use by other industry standard word processing and spreadsheet packages.
- 9. Dynamic Graphical Charting: The operator shall be able to select system values to be charted in real time. Up to three values at one time can be selected for each chart. The type of chart (bar, line, 3-D, etc.) shall be selectable.
- 10. Alarm and Event Log: The operator shall be able to view all logged system alarms and events from any location in the system. The operator shall be able to sort and filter alarms. Events shall be listed chronologically. An operator with the proper security level may acknowledge and clear alarms. All that have not been cleared by the operator shall be archived to the hard disk on the workstation.
- 11. Object and Property Status and Control: Provide a method for the operator with proper password protection to view, and edit if applicable, the status of any object and property in the system. These statuses shall be available by menu, on graphics, or through custom programs.
- 12. Clock Synchronization: The real time clocks in all building control panels and workstations shall be synchronized on command of an operator. The system shall also be able to automatically synchronize all system clocks; daily from any operator designated device in the system. The system shall automatically adjust for daylight savings and standard time if applicable.
- 13. Reports and Logs: Provide a reporting package that allows the operator to select, modify, or create reports. Each report shall be definable as to data content, format, interval, and date. Report data shall be archived on the hard

disk for historical reporting. Provide the ability for the operator to obtain real time logs of designated lists of objects. Reports and logs shall be stored on the PC hard disk in a format that is readily accessible by other standard software applications including spreadsheets and word processing. Reports and logs shall be readily printed to the system printer. The operator shall be able to designate reports that shall be printed or stored to disk at selectable intervals.

- a. Custom Reports: Provide the capability for the operator to easily define any system data into a daily, weekly, monthly, or annual report. These reports shall be time and date stamped and shall contain a report title and the name of the facility.
- b. Standard Reports: The following standard system reports shall be provided for this project. These reports shall be readily customized to the project by the Hospital.
  - 1) Schedule Report: Provide a summary of all schedules including Holiday and Exception schedules.
  - 2) Commissioning Report: Provide a one-time report that lists all equipment with the unit configuration and present operation.
  - 3) Tenant Override Reports: Provide a monthly report showing the daily total time in hours that each tenant has requested after hours HVAC and lighting services. Provide an annual summary report that shows the override usage on a monthly basis.
- E. Workstation Applications Editors: Each PC workstation shall support full screen editing of all system applications. Provide editors for each application at the PC workstation. The applications shall be downloaded and executed at the appropriate controller panels.
  - 1. Controller: Provide a full screen editor for each type controller and application that shall allow the operator with proper password to view and change the configuration, name, control parameters, and system set-points.
  - 2. Scheduling: An editor for the scheduling application shall be provided at each workstation. Provide a monthly calendar for each schedule. Exception schedules and holidays shall be shown clearly on the calendar. Provide a method for allowing several related objects to follow a schedule. The advance and delay time for each object shall be adjustable from this master schedule.
    - a. An operator with proper password level shall be able to modify the schedule. Schedules shall be able to be easily copied between objects and/or dates.
  - Air System Equipment Coordination: Provide a full screen editor that allows
    equipment to be grouped for proper operation as specified in the sequence of
    operations. This shall include the coordination of VAV boxes with their
    associated Air Handling Equipment.

F. Custom Application Programming: Provide the tools to create, modify, and debug custom application programming. The operator shall be able to create, edit, and download custom programs at the same time that all other system applications are operating. The system shall be fully operable while custom routines are edited, compiled, and downloaded.

#### 2.04 SYSTEM SOFTWARE

A. Furnish the following applications software for building and energy management. All software applications shall reside and run in the system controllers. Editing of applications shall occur at the operator workstation.

#### B. System Security:

- User access shall be secured using individual security passwords and user names.
- 2. Passwords shall restrict the user to only the objects, applications, and system functions as assigned by the system manager.
- 3. User logon/logoff attempts shall be recorded.
- 4. The system shall protect itself from unauthorized use by automatically logging off following the last keystroke. The delay time shall be user definable.
- C. Scheduling: Provide the capability to schedule each object or group of objects in the system. Each of these schedules shall include the capability for start, stop, optimal start, and optimal stop actions. Each schedule may consist of up to 10 events. When a group of objects are scheduled together, provide the capability to define advances and delays for each member. Each schedule shall consist of the following:
  - 1. Weekly Schedule. Provide separate schedules for each day of the week.
  - 2. Exception Schedules. Provide the ability for the operator to designate any day of the year as an exception schedule. This exception schedule shall override the standard schedule for that day. Exception schedules may be defined up to a year in advance. Once an exception schedule is executed it will be discarded and replaced by the standard schedule for that day of the week.
  - 3. Holiday Schedules. Provide the capability for the operator to define up to [99] special or holiday schedules. These schedules may be placed on the scheduling calendar and will be repeated each year. The operator shall be able to define the length of each holiday period.
  - 4. Optimal Start/Stop. The scheduling application outlined above shall support an optimal start/stop algorithm. This shall calculate the thermal characteristics of a zone and start the equipment prior to occupancy to achieve the desired space temperature at the specified occupancy time. The algorithm shall calculate separate sets of heating and cooling rates for zones that have been unoccupied for less then and greater than 24 hours. Provide the ability to modify the start/stop algorithm based on outdoor air

temperature. Provide an early start limit in minutes to prevent the system from starting before an operator determined time limit.

- D. Alarm Reporting: The operator shall be able to determine the action to be taken in the event of an alarm. Alarms shall be routed to the appropriate workstations based on time and other conditions. An alarm shall be able to start programs, be logged in the event log, printed, generate custom messages graphics.
- E. Maintenance Management: The system shall monitor equipment status and generate maintenance messages based upon user designated run time, starts, and/or calendar date limits.
- F. PID Control: A PID (proportional-integral-derivative) algorithm with direct or reverse action and anti-wind-up shall be supplied. The algorithm shall calculate a time-varying analog value used to position an output or stage a series of outputs. The controlled variable, set-point, and PID gains shall be user-selectable. The set-point shall optionally be chosen to be a reset schedule.
- G. Timed Override: A standard application shall be utilized to enable/disable temperature control when a user selects on/cancel at the zone sensor, workstation, or the operator display. The amount of time that the override takes precedence will be selectable from the workstation.
- H. Staggered Start: This application shall prevent all controlled equipment from simultaneously restarting after a power outage. The order in which equipment (or groups of equipment) is started, along with the time delay between starts shall be user-selectable.
- I. System Calculations: Provide software to allow instantaneous power (e.g. KW), flow rates (e.g. L/s [GPM]) to be accumulated and converted to energy usage data. Provide an algorithm that calculates a sliding-window KW demand value. Provide an algorithm that calculates energy usage and weather data (heating and cooling degree days). These items shall all be available for daily, previous day, monthly and the previous month.
- J. Anti-Short Cycling: All binary output points shall be protected from short cycling. This feature shall allow minimum on-time and off-time to be selected.

#### 2.05 BUILDING CONTROLLERS

- A. General: Provide Building Controllers to provide the performance specified in section 1 of this division. Each of these panels shall meet the following requirements.
  - 1. The Building Automation System shall be composed of one or more independent, stand-alone, microprocessor based Building Controllers to manage the global strategies described in System software section.
  - 2. The Building Controller shall have sufficient memory to support its operating system, database, and programming requirements.

- 3. The controller shall provide a communications port for connection of the Portable Operators Terminal using Point to Point BACnet physical/data link layer protocol or a connection to the inter-network.
- 4. The operating system of the Controller shall manage the input and output communications signals to allow distributed controllers to share real and virtual point information and allow central monitoring and alarms.
- 5. Controllers that perform scheduling shall have a real time clock.
- 6. Data shall be shared between networked Building Controllers.
- 7. The Building Controller shall utilize industry recognized open standard protocols for communication to unit controllers.
- 8. The Building Controller shall continually check the status of its processor and memory circuits. If an abnormal operation is detected, the controller shall:
  - a. Assume a predetermined failure mode.
  - b. Generate an alarm notification.
  - c. Create a retrievable file of the state of all applicable memory locations at the time of the failure.
  - d. Automatically reset the Building Controller to return to a normal operating mode.
- 9. BACnet: The Building Controller shall use the Read (Initiate) and Write (Execute) Services as defined in these BIBBS:

| DS-RP-A,B  |
|------------|
| DS-RPM-A,B |
| DS-WP-A,B  |
| DS-WPM-B   |

- B. Communications: Each Building Controller shall reside on the Enterprise wide network, which is same high-speed network as the workstations. The Enterprise wide network will be provided by the Hospital and supports the Internet Protocol (IP). Local connections of the Building Controller shall be on ISO 8802-3 (Ethernet). Communications shall use Annex J of ASHRAE Standard 135-95. Each Building Controller shall also perform routing to a network of Custom Application and Application Specific Controllers.] Each Building Controller shall perform communications to a network of Custom Application and Application Specific Controllers using LonTalk FTT-10 and LonMark profiles.
- C. Environment: Controller hardware shall be suitable for the anticipated ambient conditions. Controller used in conditioned ambient shall be mounted in an enclosure, and shall be rated for operation at 0 C to 50 C [32 F to 120 F].

- D. Serviceability: Provide diagnostic LEDs for power, communications, and processor. All wiring connections shall be made to field removable, modular terminal strips or to a termination card connected by a ribbon cable. The primary logic board shall be removable without disconnecting field wiring.
- E. Memory: The Building Controller shall maintain all BIOS and programming information in the event of a power loss for at least 72 hours.
- F. Immunity to Power and Noise: Controller shall be able to operate at 90% to 110% of nominal voltage rating and shall perform an orderly shut-down below 80% nominal voltage.
- G. The Building Controller shall have a seven segment LED display on the main board that indicates the current operating mode of the controller.

# 2.06 <u>CUSTOM APPLICATION CONTROLLERS</u>

- A. General: Provide Custom Application Controllers to provide the performance specified in section 1 of this division. Each of these panels shall meet the following requirements.
  - 1. The Building Automation System shall be composed of one or more independent, stand-alone, microprocessor based Building Controllers to manage the local strategies described in System software section.
  - 2. The Controller shall have sufficient memory to support its operating system, database, and programming requirements.
  - 3. Controllers that perform scheduling shall have a real time clock.
  - 4. The operating system of the Controller shall manage the input and output communications signals to allow distributed controllers to share real and virtual point information and allow central monitoring and alarms.
  - 5. The Controller shall continually check the status of its processor and memory circuits. If an abnormal operation is detected, the controller shall:
    - a. Assume a predetermined failure mode.
    - b. Generate an alarm notification.
  - Custom application controllers shall communicate using LonTalk. Controllers shall use FTT-10 transceivers. All communications shall be with the use of LonMark-approved SNVTs.
- B. Environment: Controller hardware shall be suitable for the anticipated ambient conditions.
  - 1. Controller used in conditioned ambient shall be mounted in NEMA 1 type enclosures, and shall be rated for operation at 0 C to 50 C [32 F to 120 F].

- Controllers used outdoors and/or in wet ambient shall be mounted within NEMA 4 type waterproof enclosures, and shall be rated for operation at -40 C to 70 C [-40 F to 158 F].
- C. Serviceability: Provide diagnostic LEDs for power, communications, and processor. All low voltage wiring connections shall be made such that the controller electronics can be removed and/or replaced without disconnection of field termination wiring.
- D. Memory: The Controller shall maintain all BIOS and programming information in the event of a power loss for at least 72 hours.
- E. Immunity to Power and Noise: Controller shall be able to operate at 90% to 110% of nominal voltage rating and shall perform an orderly shutdown below 80% nominal voltage.

# 2.07 <u>APPLICATION SPECIFIC CONTROLLERS</u>

- A. General: Application specific controllers (ASC) are microprocessor-based DDC controllers, which through hardware or firmware design are dedicated to control a specific piece of equipment. They are not fully user programmable, but are customized for operation within the confines of the equipment they are designed to serve.
  - 1. Each ASC shall be capable of stand-alone operation and shall continue to provide control functions without being connected to the network.
  - 2. Each ASC will contain sufficient I/O capacity to control the target system.
- B. Environment: The hardware shall be suitable for the anticipated ambient conditions.
  - Controllers used outdoors and/or in wet ambient shall be mounted within NEMA 4 type waterproof enclosures, and shall be rated for operation at -40 F to 150 F.
  - Controller used in conditioned ambient shall be mounted in NEMA 1 type rated enclosures. Controllers located where not to be disturbed by building activity (such as above ceiling grid), may be provided with plenum-rated enclosures and non-enclosed wiring connections for plenum cabling. All controllers shall be rated for operation at 32 F to 120 F.
- C. Serviceability: Provide diagnostic LEDs for power and communications. All wiring connections shall be clearly labeled and made to be field removable.
- D. Memory: The Application Specific Controller shall maintain all BIOS and programming information in the event of a power loss for at least 90 days.
- E. Immunity to Power and Noise: Controller shall be able to operate at 90% to 110% of nominal voltage rating and shall perform an orderly shutdown below 80%.
- F. Transformer: Power supply for the ASC must be rated at minimum of 125% of ASC power consumption, and shall be fused or current limiting type.

G. Application Specific Controllers shall communicate using LonTalk. Controllers shall use FTT-10 transceivers. All communications shall follow LonMark profiles. ASCs which do not have a profile that applies must comply with LonMark standards, utilize SNVTs for all listed points, and be provided with a XIF file for self-documentation.

# 2.08 COMMUNICATIONS

- A. This project shall comprise a network utilizing BACnet for communications between Building Controllers and PC Workstations. LonTalk subnetworks shall be used for communications between Building Controllers, Custom Application Controllers and Application Specific Controllers.
- B. Each BACnet device shall operate on the BACnet physical/data link protocols specified for that device as defined earlier in this section
- C. The Hospital will provide all communication media, connectors, repeaters, hubs, and routers necessary for the inter-network. A 10BaseT jack will be provided adjacent to each Building Control Panel and PC Workstation for connection to this network.
- D. All Building Controllers shall have a communications port for connections with the operator interfaces. This may be either an RS-232 port for Point to Point
- E. Connection or a network interface node for connection to the Ethernet network.
- F. Remote operator interface via a 9600 or faster baud modem shall allow for communication with any and all controllers on this network as described in F below.
- G. Communications services over the internetwork shall result in operator interface and value passing that is transparent to the internetwork architecture as follows:
  - Connection of an operator interface device to any one controller on the internetwork will allow the operator to interface with all other controllers as if that interface were directly connected to the other controllers. Data, status information, reports, system software, custom programs, etc., for all controllers shall be available for viewing and editing from any one controller on the internetwork.
  - 2. All database values (i.e., points, software variable, custom program variables) of any one controller shall be readable by any other controller on the internetwork. This value passing shall be automatically performed by a controller when a reference to a point name not located in that controller is entered into the controller's database. An operator/installer shall not be required to set up any communications services to perform internetwork value passing.
- H. The time clocks in all controllers shall be automatically synchronized daily.

# 2.09 <u>INPUT/OUTPUT INTERFACE</u>

- A. Hard-wired inputs and outputs may tie into the system through Building, Custom, or Application Specific Controllers.
- B. All input points and output points shall be protected such that shorting of the point to itself, another point, or ground will cause no damage to the controller. All input and output points shall be protected from voltage up to 24V of any duration, such that contact with this voltage will cause no damage to the controller.
- C. Binary inputs shall allow the monitoring of on/off signals from remote devices. The binary inputs shall provide a wetting current of at least 12 ma to be compatible with commonly available control devices.
- D. Pulse accumulation input points. This type of point shall conform to all the requirements of Binary Input points, and also accept up to 2 pulses per second for pulse accumulation, and shall be protected against effects of contact bounce and noise.
- E. Analog inputs shall allow the monitoring of low voltage (0-10 Vdc), current (4-20 ma), or resistance signals (thermistor, RTD). Analog inputs shall be compatible with, and field configurable to commonly available sensing devices.
- F. Binary outputs shall provide for on/off operation, or a pulsed low voltage signal for pulse width modulation control. Outputs shall be selectable for either normally open or normally closed operation.
- G. Analog outputs shall provide a modulating signal for the control of end devices. Outputs shall provide either a 0-10 Vdc or a 4-20 ma signal as required to provide proper control of the output device. Analog outputs on building or custom programmable controllers shall have status lights, a 2-position (auto/manual) switch, and manually adjustable potentiometer for manual override.

## 2.10 AUXILIARY CONTROL DEVICES

- A. Motorized dampers, unless otherwise specified elsewhere, shall be as follows:
  - 1. Damper frames shall be 16 gauge galvanized sheet metal or 1/8" extruded aluminum with reinforced corner bracing.
  - 2. Damper blades shall not exceed 8" in width or 48" in length. Blades are to be suitable for medium velocity performance (2,000 fpm). Blades shall be not less than 16 gauge.
  - 3. Damper shaft bearings shall be as recommended by manufacturer for application.
  - 4. All blade edges and top and bottom of the frame shall be provided with compressible seals. Side seals shall be compressible stainless steel. The blade seals shall provide for a maximum leakage rate of 10 CFM per square foot at 2.5" w.c. differential pressure.

- 5. All leakage testing and pressure ratings will be based on AMCA Publication 500.
- 6. Individual damper sections shall not be larger than 48" x 60". Provide a minimum of one damper actuator per section.
- B. Control dampers shall be parallel or opposed blade types as scheduled on drawings.
- C. Electronic damper/valve actuators.
  - 1. The actuator shall have electronic overload or digital rotation sensing circuitry to prevent damage to the actuator throughout the rotation of the actuator.
  - 2. Where shown, for power-failure/safety applications, an internal mechanical, spring return mechanism shall be built into the actuator housing.
  - All rotary spring return actuators shall be capable of both clockwise or counter clockwise spring return operation. Linear actuators shall spring return to the retracted position.
  - 4. Proportional actuators shall accept a 0-10 VDC or 0-20 ma control signal and provide a 2-10 VDC or 4-20 ma operating range.
  - 5. All 24 VAC/DC actuators shall operate on Class 2 wiring and shall not require more than 10 VA for AC or more than 8 W for DC applications. Actuators operating on 120 VAC or 230 VAC shall not required more than 11 VA.
  - 6. All non-spring return actuators shall have an external manual gear release to allow manual positioning of the damper when the actuator is not powered. Spring return actuators with more than 60 in-lb. torque capacity shall have a manual crank for this purpose.
  - 7. All modulating actuators shall have an external, built-in switch to allow the reversing of direction of rotation.
  - 8. Actuators shall be provided with a conduit fitting and a minimum 1m electrical cable and shall be pre-wired to eliminate the necessity of opening the actuator housing to make electrical connections.
  - 9. Actuators shall be Underwriters Laboratories Standard 873 listed.
  - 10. Actuators shall be designed for a minimum of 60,000 full stroke cycles at the actuator's rated torque.

#### D. Control Valves

- 1. Control valves shall be two-way type for modulating service as scheduled or shown.
- 2. Close-off (differential) Pressure Rating: Valve actuator and trim shall be furnished to provide the following minimum close-off pressure ratings:

#### a. Water Valves:

- 1) Two-way: 150% of total system (pump) head.
- 2) Three-way: 300% of pressure differential between ports A and B at design flow or 100% of total system (pump) head.

#### 3. Water Valves:

a. Body and trim style and materials shall be per manufacturer's recommendations for design conditions and service shown, with equal percentage ports for modulating service.

# b. Sizing Criteria:

- Two-way modulating service: Pressure drop shall be equal to twice the pressure drop through heat exchanger (load), 50% of the pressure difference between supply and return mains, or 5 psi, whichever is greater.
- Valves 1/2" through 2" shall be bronze body or cast brass ANSI Class 250, spring loaded, Teflon packing, quick opening for two-position service. Two-way valves to have replaceable composition disc, or stainless steel ball.
- 3) 2-1/2" valves and larger shall be cast iron ANSI Class 125 with guided plug and Teflon packing.
- c. Water valves shall fail normally open or closed as scheduled on plans or as follows:
  - 1) Chilled water control valves normally closed.
  - 2) Other applications as scheduled or as required by sequence of operation.
- d. Zone valves shall be sized to meet the control application and they shall maintain their last position in the event of a power failure.

#### 4. Temperature Sensors

- a. Temperature sensors shall be Resistance Temperature Device (RTD) or Thermistor.
- Immersion sensors shall be provided with a separable stainless steel well.
   Pressure rating of well is to be consistent with the system pressure in which it is to be installed.
- c. Provide matched temperature sensors for differential temperature measurement. Differential accuracy shall be within 0.2 F.

d. The space temperature, ICS/Setpoint, and override confirmation will be annunciated by a digital display for each zone sensor. The ICS/Setpoint will be selectable utilizing buttons.

#### 5. Status:

- a. Status Inputs for Pumps: Differential-pressure switch with pilot-duty rating and with adjustable pressure-differential range of 8 to 60 psig (55 to 414 kPa), piped across pump.
- b. Status Inputs for Electric Motors: Comply with ISA 50.00.01, currentsensing fixed- or split-core transformers with self-powered transmitter, adjustable and suitable for 175% of rated motor current.
- c. Current Switches: Self-powered, solid-state with adjustable trip current, selected to match current and system output requirements.
- d. Electronic Valve/Damper Position Indicator: Visual scale indicating percent of travel and 2- to 10-V dc, feedback signal.
- e. Water-Flow Switches: Bellows-actuated mercury or snap-acting type with pilot-duty rating, stainless-steel or bronze paddle, with appropriate range and differential adjustment, in NEMA 250, Type 1 enclosure.

## 6. Low Limit Thermostats

- a. Safety low limit thermostats shall be vapor pressure type with an element 20 feet minimum length. Element shall respond to the lowest temperature sensed by any one foot section.
- b. Low limit shall be manual reset only.

## 7. Magnetic-Inductive Flow Meter

a. Detect the flow rate of conductive media up to 160 gallons per minute. Stainless steel construction, in-line mounted. 4-digit numeric display with pushbutton setup indicates flow rate, fluid temperature and total flow volume with selectable engineering units. Two outputs are available to remotely monitor the binary or analog status of flow rate/volume and temperature parameters. Temperature monitoring from -4 to 176°F. IP 67 rated.

#### 8. Flow Switches

- a. Flow-proving switches shall be either paddle or differential pressure type, as shown.
- b. Paddle type switches (water service only) shall be UL listed, SPDT snapacting with pilot duty rating (125 VA minimum). Adjustable sensitivity with NEMA 1 Type enclosure unless otherwise specified:
- c. Differential pressure type switches (air or water service) shall be UL listed, SPDT snap-acting, pilot duty rated (125 VA minimum), NEMA 1

Type enclosure, with scale range and differential suitable for intended application, or as specified.

d. Current sensing relays may be used for flow sensing or terminal devices.

## 9. Relays

- a. Control relays shall be UL listed plug-in type with dust cover. Contact rating, configuration, and coil voltage suitable for application.
- b. Time delay relays shall be UL listed solid-state plug-in type with adjustable time delay. Delay shall be adjustable plus or minus 200% (minimum) from set-point shown on plans. Contact rating, configuration, and coil voltage suitable for application. Provide NEMA 1 Type enclosure when not installed in local control panel.

## 10. Transformers and Power Supplies

- a. Control transformers shall be UL listed, Class 2 current-limiting type, or shall be furnished with over-current protection in both primary and secondary circuits for Class 2 service.
- b. Unit output shall match the required output current and voltage requirements. Current output shall allow for a 50% safety factor. Output ripple shall be 3.0 mV maximum Peak-to-Peak. Regulation shall be 0.10% line and load combined, with 50 microsecond response time for 50% load changes. Unit shall have built-in over-voltage protection.
- c. Unit shall operate between 0 C and 50 C.
- d. Unit shall be UL recognized.
- e. Current Switches: Current-operated switches shall be self-powered, solid state with adjustable trip current. The switches shall be selected to match the current of the application and output requirements of the DDC system.

## 11. Local Control Panels

- All indoor control cabinets shall be fully enclosed NEMA 1 Type construction with hinged door, key-lock latch, and removable sub-panels.
   A single key shall be common to all field panels and sub-panels.
- b. Interconnections between internal and face-mounted devices pre-wired with color-coded stranded conductors neatly installed in plastic troughs and/or tie-wrapped. Terminals for field connections shall be UL listed for 600-volt service, individually identified per control/interlock drawings, with adequate clearance for field wiring. Control terminations for field connection shall be individually identified per control drawings.
- c. Provide on/off power switch with over-current protection and main air gauge for control power sources to each local panel.

#### **PART 3 - EXECUTION**

## 3.01 SUMMARY

- A. Section includes:
  - 1. Examination
  - 2. General Workmanship
  - 3. Wiring
  - 4. Fiber Optic Cable
  - 5. Installation of Sensors
  - 6. Flow Switch Installation
  - 7. Actuators
  - 8. Warning Labels
  - 9. Identification of Hardware and Wiring
  - 10. Controllers
  - 11. Cleaning
  - 12. Protection
  - 13. Training
  - 14. Field Quality Control
  - 15. Check-out, Start-up, and Testing
  - 16. Acceptance

## 3.02 **EXAMINATION**

- A. The project plans shall be thoroughly examined for control device and equipment locations, and any discrepancies, conflicts, or omissions shall be reported to the WHFD AND/OR PROJECT MANAGER for resolution before rough-in work is started.
- B. The contractor shall inspect the site to verify that equipment is installable as shown, and any discrepancies, conflicts, or omissions shall be reported to the WHFD AND/OR PROJECT MANAGER for resolution before rough-in work is started.

# 3.03 GENERAL WORKMANSHIP

A. Install equipment, piping, wiring/conduit parallel to building lines (i.e. horizontal, vertical, and parallel to walls) wherever possible.

- B. Provide sufficient slack and flexible connections to allow for vibration of piping and equipment.
- C. Install all equipment in readily accessible location as defined by chapter 1 article 100 part A of the NEC. Control panels shall be attached to structural walls unless mounted in equipment enclosure specifically designed for that purpose. Panels shall be mounted to allow for unobstructed access for service.
- D. Verify integrity of all wiring to ensure continuity and freedom from shorts and grounds.
- E. All equipment, installation, and wiring shall comply with acceptable industry specifications and standards for performance, reliability, and compatibility and be executed in strict adherence to local codes and standard practices.

## 3.04 WIRING

- A. All control and interlock wiring shall comply with the national and local electrical codes and Division 16 of these specifications. Where the requirements of this section differ with those in Division 16, the requirements of this section shall take precedence.
- B. Where Class 2 wires are in concealed and accessible locations including ceiling return air plenums, approved cables not in raceway may be used provided that:
  - 1. Circuits meet NEC Class 2 (current limited) requirements. (Low voltage power circuits shall be sub fused when required to meet Class 2 current limit.)
  - 2. All cables shall be UL listed for application, i.e., cables used in ceiling plenums shall be UL listed specifically for that purpose.
- C. Do not install Class 2 wiring in conduit containing Class 1 wiring. Boxes and panels containing high voltage may not be used for low voltage wiring except for the purpose of interfacing the two (e.g. relays and transformers).
- D. Where class 2 wiring is run exposed, wiring shall be run parallel along a surface or perpendicular to it, and bundled, using approved wire ties at no greater than 10 ft intervals. Such bundled cable shall be fastened to the structure, using specified fasteners, at 5 ft intervals or more often to achieve a neat and workmanlike result.
- E. All wire-to-device connections shall be made at a terminal blocks or terminal strip. All wire-to wire connections shall be at a terminal block, or with a crimped connector. All wiring within enclosures shall be neatly bundled and anchored to permit access and prevent restriction to devices and terminals.
- F. Maximum allowable voltage for control wiring shall be 120V. If only higher voltages are available, the Control System Contractor shall provide step down transformers.

- G. All wiring shall be installed as continuous lengths, where possible. Any required splices shall be made only within an approved junction box or other approved protective device.
- H. Install plenum wiring in sleeves where it passes through walls and floors. Maintain fire rating at all penetrations in accordance with other sections of this specification and local codes.
- Size of conduit and size and type of wire shall be the design responsibility of the Control System Contractor, in keeping with the manufacturer's recommendation and NEC.
- J. Control and status relays are to be located in designated enclosures only. These relays may also be located within packaged equipment control panel enclosures. These relays shall not be located within Class 1 starter enclosures.
- K. Follow manufacturer's installation recommendations for all communication and network cabling. Network or communication cabling shall be run separately from other wiring.
- L. Adhere to Division 16 requirements for installation of raceway.
- M. This Contractor shall terminate all control and/or interlock wiring and shall maintain updated (as built) wiring diagrams with terminations identified at the job site.
- N. Flexible metal conduits and liquid tight, flexible metal conduits shall not exceed 3' in length and shall be supported at each end. Flexible metal conduit less than 1/2" electrical trade size shall not be used. In areas exposed to moisture, including chiller and boiler rooms, liquid tight, flexible metal conduits shall be used.

### 3.05 INSTALLATION OF SENSORS

- A. Install sensors in accordance with the manufacturer's recommendations.
- B. Mount sensors rigidly and adequate for the environment within which the sensor operates.
- C. Room temperature sensors shall be installed on concealed junction boxes properly supported by the wall framing.
- D. All wires attached to sensors shall be air sealed in their conduits or in the wall to stop air transmitted from other areas affecting sensor readings.
- E. Install duct static pressure tap with tube end facing directly down-stream of air flow
- F. Sensors used in mixing plenums, and hot and cold decks shall be of the averaging type. Averaging sensors shall be installed in a serpentine manner horizontally across duct. Each bend shall be supported with a capillary clip.
- G. All pipe mounted temperature sensors shall be installed in wells. Install all liquid temperature sensors with heat conducting fluid in thermal wells.

- H. Wiring for space sensors shall be concealed in building walls. EMT conduit is acceptable within mechanical and service rooms.
- I. Install outdoor air temperature sensors on north wall complete with sun shield at designated location.

## 3.06 FLOW SWITCH INSTALLATION

- A. Install using a thread o let in steel pipe. In copper pipe use C x C x F Tee, no pipe extensions or substitutions allowed.
- B. Mount a minimum of 5 pipe diameters upstream and 5 pipe diameters downstream or 2 feet whichever is greater, from fittings and other obstructions.
- C. Install in accordance with manufacturers' instructions.
- D. Assure correct flow direction and alignment.
- E. Mount in horizontal piping flow switch on top of the pipe.

# 3.07 ACTUATORS

- A. Mount and link control damper actuators per manufacturer's instructions.
- B. To compress seals when spring return actuators are used on normally closed dampers, power actuator to approximately 5° open position, manually close the damper, and then tighten the linkage.
- C. Check operation of damper/actuator combination to confirm that actuator modulates damper smoothly throughout stroke to both open and closed positions.
- D. Valves Actuators shall be mounted on valves with adapters approved by the actuator manufacturer. Actuators and adapters shall be mounted following manufacturer's recommendations.

## 3.08 WARNING LABELS

A. Affix plastic labels on each starter and equipment automatically controlled through the Control System.

### 3.09 IDENTIFICATION OF HARDWARE AND WIRING

- A. All wiring and cabling, including that within factory fabricated panels, shall be labeled at each end within 2" of termination with a cable identifier and other descriptive information.
- B. Permanently label or code each point of field terminal strips to show the instrument or item served.
- C. Identify control panels with minimum 1-cm letters on laminated plastic nameplates.

D. Identify all other control components with permanent labels. Identifiers shall match record documents. All plug-in components shall be labeled such that removal of the component does not remove the label.

### 3.10 CONTROLLERS

- A. Provide a separate Controller for each major piece of HVAC equipment. Points used for control loop reset such as outside air or space temperature are exempt from this requirement.
- B. Building Controllers and Custom Application Controllers shall be selected to provide a minimum of [15%] spare I/O point capacity for each point type found at each location. If input points are not universal, [15%] of each type is required. If outputs are not universal, [15%] of each type is required. A minimum of one spare is required for each type of point used.
- C. Future use of spare capacity shall require providing the field device, field wiring, points database definition, and custom software. No additional Controller boards or point modules shall be required to implement use of these spare points.

## 3.12 PROGRAMMING

- A. Provide sufficient internal memory for the specified control sequences and trend logging. There shall be a minimum of 25% of available memory free for future use.
- B. Point Naming: System point names shall be modular in design, allowing easy operator interface without the use of a written point index.
- C. Software Programming: Provide programming for the system as per specifications and adhere to the strategy algorithms provided. All other system programming necessary for the operation of the system but not specified in this document shall also be provided by the Control System Contractor. Imbed into the control program sufficient comment statements to clearly describe each section of the program. The comment statements shall reflect the language used in the sequence of operations.

#### D. Operators' Interface

- Standard Graphics: Provide graphics for each major piece of equipment and floor plan in the building. This includes each Air Handler and VAV Terminal. These standard graphics shall show all points dynamically as specified in the points list.
- The controls contractor shall provide all the labor necessary to install, initialize, start up, and trouble-shoot all operator interface software and their functions as described in this section. This includes any operating system software, the operator interface data base, and any third party software installation and integration required for successful operation of the operator interface.

- As part of this execution phase, the controls contractor will perform a complete test of the operator interface. Test duration shall be a minimum of 16 hours on-site. Tests shall be made in the presence of the Hospital or WHFD AND/OR PROJECT MANAGER.
- E. Demonstration: A complete demonstration and readout of the capabilities of the monitoring and control system shall be performed. The contractor shall dedicate a minimum of 16 hours on site with the Hospital and his representatives for a complete functional demonstration of all the system requirements. This demonstration constitutes a joint acceptance inspection, and permits acceptance of the delivered system for on line operation.

# 3.13 CLEANING

- A. This contractor shall clean up all debris resulting from his or her activities daily. The contractor shall remove all cartons, containers, crates, etc. under his control as soon as their contents have been removed. Waste shall be collected and placed in a location designated by the Construction Manager or General Contractor.
- B. At the completion of work in any area, the Contractor shall clean all of his/her work, equipment, etc., making it free from dust, dirt and debris, etc.
- C. At the completion of work, all equipment furnished under this Section shall be checked for paint damage, and any factory finished paint that has been damaged shall be repaired to match the adjacent areas. Any metal cabinet or enclosure that has been deformed shall be replaced with new material and repainted to match the adjacent areas.

# 3.14 PROTECTION

- A. The Contractor shall protect all work and material from damage by his/her work or workers, and shall be liable for all damage thus caused.
- B. The Contractor shall be responsible for his/her work and equipment until finally inspected, tested, and accepted. The Contractor shall protect his/her work against theft or damage, and shall carefully store material and equipment received on site that is not immediately installed. The Contractor shall close all open ends of work with temporary covers or plugs during storage and construction to prevent entry of foreign objects.

#### 3.15 TRAINING

- A. Provide a minimum of 2 classroom training sessions, 8 hours each, throughout the contract period for personnel designated by the Hospital. Computer based training may be substituted for up to 4 hours of hands on training.
- B. Train the designated staff of WHFD AND/OR PROJECT MANAGER and Hospital to enable them to proficiently operate the system; create, modify and delete programming; add, remove and modify physical points for the system; add additional panels when required.

- C. These objectives will be divided into three logical groupings; participants may attend one or more of these, depending on level of knowledge required:
  - 1. Day-to-day Operators
  - 2. System Troubleshooter
  - 3. System Manager: parts
- D. Provide course outline and materials as per Part 1 of this Section. The instructor(s) shall provide one copy of training material per student.
- E. The instructor(s) shall be factory-trained instructors experienced in presenting this material.
- F. Classroom training shall be done using a network of working controllers representative of the installed hardware or at the customer's site.

## 3.16 FIELD QUALITY CONTROL

- A. All work, materials and equipment shall comply with the rules and regulations of applicable local, state, and federal codes and ordinances as identified in Part 1 of this Section.
- B. Contractor shall continually monitor the field installation for code compliance and quality of workmanship. All visible piping and or wiring runs shall be installed parallel to building lines and properly supported.
- C. Contractor shall arrange for field inspections by local and/or state authorities having jurisdiction over the work.

#### 3.17 ACCEPTANCE

A. The control systems will not be accepted as meeting the requirements of Completion until all tests described in this specification have been performed to the satisfaction of both the WHFD AND/OR PROJECT MANAGER and Hospital. Any tests that cannot be performed due to circumstances beyond the control of the Contractor may be exempt from the Completion requirements if stated as such in writing by the WHFD AND/OR PROJECT MANAGER. Such tests shall then be performed as part of the warranty.

### **DIVISION 16 - ELECTRICAL**

# SECTION 16010 - BASIC ELECTRICAL REQUIREMENTS

#### PART 1 - GENERAL

## 1.01 RELATED DOCUMENTS

Drawings and general provisions of Contract, including General and Supplementary Conditions and Division-1 Specification sections, apply to work of this section.

# 1.02 SUMMARY

- A. This section specifies the basic requirements for the electrical installations and includes requirements common to more than one section of Division 16. It expands and supplements the requirements specified in sections of Division 1.
- B. Standards of the organizations listed below but referred to in the various sections by basic designation only, form a part of this specification to the extent indicated by the reference thereto:
  - 1. American Society for Testing and Materials (ASTM).
  - 2. National Fire Protection Association (NFPA).
  - 3. American National Standards Institute (ANSI).
  - 4. Illuminating Engineering Society (IES).
  - 5. Institute of Electrical and Electronics Engineers (IEEE).
  - 6. Insulated Cable Engineers Association ICEA).
  - 7. National Electrical Manufacturer's Association (NEMA).
  - 8. National Electrical Contractors' Association (NECA).
  - 9. Underwriters' Laboratories, Inc. (UL).
  - 10. Factory Mutual (FM).
  - 11. Federal Specifications (FS).
  - 12. National Electrical Code (NEC) with County of Hawaii Amendments.
  - 13. ANSI TIA/EIA Telecommunication Building Wiring Standards.
- C. References shall mean to the latest edition of the standard.
- D. Conform to local ordinances and codes.

#### 1.03 QUALITY ASSURANCE

- A. Verify final locations for rough-ins with field measurements and with the requirements of the actual equipment to be connected. Contractor shall coordinate with the appropriate supplier, vendor, or subcontractor regarding the exact and specific rough-in requirements for equipment actually supplied.
- B. Conduits, junction boxes, wireway, etc. required for low voltage/telecommunications, cabling shall be coordinated with telecommunications cabling divisions prior to rough-in.

# 1.04 ELECTRICAL INSTALLATIONS

A. Coordinate electrical equipment and materials installation with other building

Kona Community Hospital

16010-1

HVAC Reheat System Improvements

BASIC ELECTRICAL REQUIREMENTS

components.

- B. Verify all dimensions by field measurement. Do not scale drawings.
- C. Arrange for chases, slots, and openings in other building components to allow for electrical installations.
- D. Sequence, coordinate, and integrate installations of electrical materials and equipment for efficient flow of the work.
- E. Coordinate the access panel requirements with General Contractor to accommodate the installation of electrical equipment and materials.
- F. Where mounting heights are not detailed or dimensioned, install electrical services and overhead equipment to provide the maximum headroom possible.
- G. Install electrical equipment to facilitate maintenance and repair or replacement of equipment components. As much as practical, connect equipment for ease of disconnecting, with minimum of interference with other installations.
- H. Coordinate the installation of electrical materials and equipment above ceilings with suspension system, mechanical equipment and systems, and structural components.
- I. Contractor shall review Mechanical, Structural, and Architectural drawings prior
- J. Final connections to equipment shall be per manufacturer's approved wiring diagrams, details and instructions. It shall be the Contractor's responsibility to provide materials and equipment compatible with equipment actually supplied.
- K. It is the intent of these drawings and specifications to establish a standard of quality.
- L. Work shall be performed in a workmanlike manner to the satisfaction of the Hospital.
- M. Contractor shall verify and coordinate exact location of equipment to be furnished by others prior to rough-in.
- N. Contractor shall be responsible for replacing equipment which is damage due to incorrect field wiring provided under this section or factory wiring in equipment provided under this division.
- O. Contractors shall visit site prior to bid and verify that conditions are as indicated. Contractor shall include in his bid, costs required to make his work meet existing conditions.
- P. Proposed substitutions of electrical equipment or request for "or equal" or approved equal" listing shall be submitted to the Hospital as specified under Division 1.

- Q. Wire termination provisions for panelboards, circuit breakers, safety switches and all other electrical apparatus shall be listed as suitable for 75 degree C.
- R. Systems shall be complete, operable and ready for continuous operations. Lights, switches, receptacles, motors, etc., shall be connected and operable.
- S. Electrical equipment shall be located to maintain clear and level clearances outlined in NEC 110-26. Panelboards, switchboards, transformers, disconnects, switches, breakers, etc. shall be located to comply with NEC 110-26(a). Where the clearances outlined in NEC 110-26 cannot be obtained, the Contractor shall notify the engineer prior to performing any rough-in.
- T. Maintain separation between telecommunication conduits and electrical feeders, electronic ballasts, transformers, etc. to minimize electromagnetic compatibility issues.

## 1.05 ELECTRICAL SUBMITTALS

- A. Refer to Division 1 Specifications for submittal requirements.
- B. Data shall be submitted at one time in three ring binders and indexed as scheduled below. Partial submittals will not be accepted.
  - 1. 16060 Grounding and Bonding
  - 2. 16073 Hangers and Supports for Electrical Systems
  - 3. 16075 Electrical Identification
  - 4. 16120 Conductors and Cables
  - 5. 16130 Raceways and Boxes
  - 6. 16140 Wiring Devices
  - 7. 16410 Enclosed Switches and Circuit Breakers
  - 8. 16491 Fuses
- C. Submit shop drawings and product data grouped to include complete submittals of related systems, products and accessories in a single submittal.
- D. Identify products requiring color selections.
- E. Identify products for use on project.

### 1.06 PRODUCT OPTIONS AND SUBSTITUTIONS

Substitutions shall be made in accordance with Division 1 Specifications.

# 1.07 PRODUCT LISTING

- A. Prepare listing of major electrical equipment and materials for the project.
- B. Submit this listing as a part of the submittal requirement specified in the Division1 Specifications.

#### 1.08 NAMEPLATE DATA

A. Provide permanent operational data nameplate on each item of power operated equipment, indicating, manufacturer, product name, model number, serial

number, capacity, operating and power characteristics, labels of tested compliances, and similar essential data. Locate nameplates in an accessible location.

## 1.09 <u>DELIVERY, STORAGE AND HANDLING</u>

- A. Deliver products to project properly identified with names, model numbers, types, compliance labels and similar information needed for distinct identification; adequately packaged and protected to prevent damage during shipment, storage and handling.
- B. Store equipment and materials at the site, unless off-site storage is authorized in writing. Contractor shall protect stored equipment and materials from damage and theft.
- C. Coordinate deliveries of electrical materials and equipment to minimize construction congestion. Limit each shipment of materials and equipment to the items and quantities needed for the smooth and efficient flow of installations.

#### 1.10 RECORD DOCUMENTS

- A. Refer to the Division 1 Specifications for requirements. The following paragraphs supplement the requirements of Division 1.
- B. Mark drawings to indicate revisions to conduit size and location both exterior and interior, actual equipment locations, dimensioned to column lines; concealed equipment, dimensioned to column lines; distribution and branch electrical circuitry; fuse and circuit breaker size and arrangement support and hanger details; Change Orders; Addendums; concealed control system devices.
- C. Mark specifications to indicate approved substitutions; Change Orders; Addendums and equipment and materials used.

## 1.11 WARRANTIES

- A. Refer to the Division 1 Specifications for procedures and submittal requirements for warranties. Refer to individual equipment specifications for warranty requirements.
- B. Compile and assemble the warranties specified in Division 16, into a separated set of vinyl covered, three ring binders, tabulated and indexed for easy reference.
- C. Provide complete warranty information for each item to include product or equipment to include date of beginning of warranty or bond; duration of warranty or bond; and names, addresses and telephone numbers and procedures for filing a claim and obtaining warranty services.

#### 1.12 CLEANING

A. Refer to the Division 1 Specifications for general requirements for final cleaning.

### SECTION 16047- ELECTRICAL DEMOLITION

#### **PART 1 - GENERAL**

## 1.01 RELATED DOCUMENTS

A. Drawings and general provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to work specified in this section.

# 1.02 SUMMARY

- A. The extent of general building demolition work is shown on the drawings. Coordinate the required electrical work with the general demolition.
- B. Demolition includes removal and disposal of demolished materials, as shown on drawings and herein specified.
- C. Interior demolition includes complete wrecking of interior partitions, work above ceilings, finishes, and structures and removal and disposal of demolished materials, as shown on drawings and herein specified.
- D. The Owner shall have the option of retaining any items removed. The Contractor shall deliver these items to the Owner's designated storage area. Any items not retained by the Owner shall be disposed of off-site by the Contractor.

### 1.03 JOB CONDITIONS

- A. Condition of Structures: The Owner assumes no responsibility for actual condition of structures to be demolished.
- B. Conditions of the structure existing at time of inspection for bidding purposes will be maintained by Owner in so far as practicable. However, variations within structure may occur by Owner's removal and salvage operations prior to start of demolition work. The drawings are schematic and provided as an aid in bidding. The Contractor shall visit the site and determine the actual conditions prior to bidding.
- C. Partial Removal: Items of salvageable value to Contractor may be removed from structure as work progresses. Salvaged items must be transported from site as they are removed. Storage or sale of removed items on site will not be permitted.
- D. Traffic: Conduct demolition operations and removal of debris to ensure minimum interference with roads, streets, walks, occupied areas, and other adjacent occupied or used facilities.
- E. Protections: Ensure safe passage of persons around or through area of demolition. Conduct operations to prevent injury to adjacent buildings, structures, other facilities, and persons.
- F. Install temporary electrical services, lighting, etc. as required by the Owner or

- authorities having jurisdiction.
- G. Damages: Promptly repair damages caused to adjacent facilities by demolition operations at no cost to Owner.
- H. Utility Services: Maintain existing utilities indicated to remain, keep in service, and protect against damage during demolition operations. Allow no interruption in service unless coordinated with Owner at least 24 hours in advance.
- Do not interrupt existing utilities serving occupied or used facilities, except when authorized in writing by authorities having jurisdiction. Provide temporary services during interruptions to existing utilities, as acceptable to governing authorities.
- J. Contractor will disconnect and seal utilities serving each structure to be demolished, or interior area to be demolished, prior to start of demolition work.
- K. If Contractor is required to disconnect utility services or other services to an occupied area, the Contractor shall provide temporary or alternative service to that area.

# **PART 2 – PRODUCTS**

A. Not Applicable

#### **PART 3 - EXECUTION**

### 3.01 DEMOLITION

- A. Remove all branch and feeder conduit and wire back to panelboards, where specified.
- B. Where walls, ceilings, or floors are to remain, remove devices and wire. Provide blank cover plate at outlet box.
- C. All items shown to remain active shall be furnished with necessary accessible junction boxes and all conduit and wire as required to maintain circuit continuity.
- D. All outlet boxes which must be removed due to demolition but which must remain active in order to maintain circuit continuity shall be relocated into ceilings or walls and shall be accessible.
- E. All material fixtures and equipment to be reused shall be removed and stored on site. Before reinstallation, all items are to be cleaned, tested, and prepared for re-use. Fixtures shall be re-lamped and new ballasts installed.

# 3.02 <u>DISPOSAL OF DEMOLISHED MATERIAL</u>

- A. General: Remove from site debris, rubbish, and other materials resulting from demolition operations. Apply all fees related to removal and pumping.
- B. Remove and dispose of interior demolition debris only.

- C. Burning of removed materials from demolished structures will not be permitted on site.
- D. Transport materials removed from demolished structures and dispose of offsite.

### **SECTION 16060- GROUNDING AND BONDING**

#### PART 1 – GENERAL

# 1.01 RELATED DOCUMENTS

Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

# 1.02 SUMMARY

This Section includes methods and materials for grounding systems and equipment grounding requirements specified in this section ay be supplemented by special requirements of section described in other sections.

# 1.03 <u>SUBMITTALS</u>

A. Product Data: For each type of product indicated.

# 1.04 QUALITY ASSURANCE

A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.

#### **PART 2 - PRODUCTS**

# 2.01 CONDUCTORS

- A. Insulated Conductors: Copper wire or cable insulated for 600V unless otherwise required by applicable Code or authorities having jurisdiction.
- B. Equipment Grounding Conductors: Insulated with green-colored insulation.

#### 2.02 CONNECTORS

A. Listed and labeled by a nationally recognized testing laboratory acceptable to authorities having jurisdiction for applications in which used, and for specific types, sizes, and combinations of conductors and other items connected.

#### **PART 3 - EXECUTION**

#### 3.01 APPLICATIONS

A. Conductors: Install solid conductor for No. 8 AWG and smaller, and stranded conductors for No. 6 AWG and larger, unless otherwise indicated.

### 3.02 EQUIPMENT GROUNDING

- A. Install insulated equipment grounding conductors with all feeders and branch circuits.
- B. Install insulated equipment grounding conductors with the following items, in

addition to those required by NFPA 70:

- 1. Feeders and branch circuits.
- 2. Lighting circuits.
- 3. Receptacle circuits.
- 4. Single-phase motor and appliance branch circuits.
- 5. Three-phase motor and appliance branch circuits.
- 6. Flexible raceway runs.
- 7. Armored and metal-clad cable runs.
- C. Air-Duct Equipment Circuits: Install insulated equipment grounding conductor to duct-mounted electrical devices operating at 120 V and more, including air cleaners, heaters, dampers, humidifiers, and other duct electrical equipment. Bond conductor to each unit and to air duct and connected metallic piping.

# 3.03 <u>INSTALLATION</u>

- A. Grounding Conductors: Route along shortest and straightest paths possible, unless otherwise indicated or required by Code. Avoid obstructing access or placing conductors where they may be subjected to strain, impact, or damage.
- B. Bonding Straps and Jumpers: Install in locations accessible for inspection and maintenance, except where routed through short lengths of conduit.
  - 1. Bonding to Equipment Mounted on Vibration Isolation Hangers and Supports: Install so vibration is not transmitted to rigidly mounted equipment.
- C. Bonding Interior Metal Ducts: Bond metal air ducts to equipment grounding conductors of associated fans, blowers, electric heaters, and air cleaners. Install bonding jumper to bond across flexible duct connections to achieve continuity.

### SECTION 16073 – HANGERS & SUPPORTS FOR ELECTRICAL SYSTEMS

#### PART 1 – GENERAL

#### 1.01 RELATED DOCUMENTS

Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

# 1.02 SUMMARY

- A. This Section includes the following:
  - 1. Hangers and supports for electrical equipment and systems.

#### 1.03 **DEFINITIONS**

- A. EMT: Electrical metallic tubing.
- B. IMC: Intermediate metal conduit.
- C. RMC: Rigid metal conduit.

## 1.04 SUBMITTALS

A. Product Data: For each support device.

### 1.05 QUALITY ASSURANCE

A. Comply with NFPA 70.

## PART 2 - PRODUCTS

#### 2.01 SUPPORT, ANCHORAGE, AND ATTACHMENT COMPONENTS

- A. Raceway and Cable Supports: As described in NECA 1 and NECA 101.
- B. Conduit and Cable Support Devices: Steel and malleable-iron hangers, clamps, and associated fittings, designed for types and sizes of raceway or cable to be supported.
- C. Mounting, Anchoring, and Attachment Components: Items for fastening electrical items or their supports to building surfaces include the following:
  - 1. Powder-Actuated Fasteners: Threaded-steel stud, for use in hardened portland cement concrete, steel, or wood, with tension, shear, and pullout capacities appropriate for supported loads and building materials where used.
    - a. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
    - b. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

- 1) Hilti Inc.
- 2) ITW Ramset/Red Head; a division of Illinois Tool Works, Inc.
- 3) MKT Fastening, LLC.
- 4) Simpson Strong-Tie Co., Inc.; Masterset Fastening Systems Unit.
- 2. Mechanical-Expansion Anchors: Insert-wedge-type, zinc-coated steel, for use in hardened portland cement concrete with tension, shear, and pullout capacities appropriate for supported loads and building materials in which used.
  - a. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
  - b. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - 1) Cooper B-Line, Inc.; a division of Cooper Industries.
    - 2) Empire Tool and Manufacturing Co., Inc.
    - 3) Hilti Inc.
    - 4) ITW Ramset/Red Head; a division of Illinois Tool Works, Inc.
    - 5) MKT Fastening, LLC.
- 3. Concrete Inserts: Steel or malleable-iron, slotted support system units similar to MSS Type 18; complying with MFMA-4 or MSS SP-58.
- 4. Clamps for Attachment to Steel Structural Elements: MSS SP-58, type suitable for attached structural element.
- 5. Through Bolts: Structural type, hex head, and high strength. Comply with ASTM A 325.
- 6. Toggle Bolts: All-steel springhead type.
- 7. Hanger Rods: Threaded steel.

### **PART 3 - EXECUTION**

### 3.01 APPLICATION

- A. Comply with NECA 1, NECA 101 and manufacturer's instructions for application of hangers and supports for electrical equipment and systems except if requirements in this Section are stricter.
- B. Maximum Support Spacing and Minimum Hanger Rod Size for Raceway: Space supports for EMT, IMC, and RMC as required by NFPA 70. Minimum rod size shall be 1/4 inch (6 mm) in diameter.
- D. Spring-steel clamps designed for supporting single conduits without bolts may be used for 1-1/2-inch (38-mm) and smaller raceways serving branch circuits and communication systems above suspended ceilings and for fastening raceways to trapeze supports.
- E. Do not support raceway with wire or perforated pipe straps. Remove wire used for temporary supports. Do not attach raceway to ceiling support wires or other piping systems.

### 3.02 SUPPORT INSTALLATION

- A. Comply with NECA 1 and NECA 101 for installation requirements except as specified in this Article.
- B. Raceway Support Methods: In addition to methods described in NECA 1, EMT may be supported by openings through structure members, as permitted in NFPA 70.
- C. Strength of Support Assemblies: Where not indicated, select sizes of components so strength will be adequate to carry present and future static loads within specified loading limits. Minimum static design load used for strength determination shall be weight of supported components plus 200 lb (90 kg).
- D. Mounting and Anchorage of Surface-Mounted Equipment and Components: Anchor and fasten electrical items and their supports to building structural elements by the following methods unless otherwise indicated by code:
  - 1. To Wood: Fasten with lag screws or through bolts.
  - 2. To New Concrete: Bolt to pre-set concrete inserts or expansion anchors.
  - 3. To Masonry: Approved toggle-type bolts on hollow masonry units and expansion anchor fasteners or pre-set concrete inserts on solid masonry units.
  - 4. To Existing Concrete: Expansion anchor fasteners.
  - 5. To Steel: Welded threaded studs complying with AWS D1.1/D1.1M, with lock washers and nuts. Beam clamps (MSS Type 19, 21, 23, 25, or 27), complying with MSS SP-69.
  - 6. To Light Steel: Sheet metal screws.
  - 7. Items Mounted on Hollow Walls and Nonstructural Building Surfaces: Mount cabinets, panelboards, disconnect switches, control enclosures, pull and junction boxes, transformers, and other devices on slotted-channel racks attached to substrate by means that meet seismic-restraint strength and anchorage requirements.
- E. Drill holes for expansion anchors in concrete at locations and to depths that avoid reinforcing bars.
- F. Install surface-mounted cabinets and panelboards with minimum of four anchors.
- G. In wet and damp locations use steel channel supports to stand cabinets and panelboards one inch off wall.
- H. Use sheet metal channel to bridge studs above and below cabinets and panelboards recessed in hollow partitions.
- I. Do not fasten supports to pipes, ducts, mechanical equipment, and conduit.
- J. Do not use power-actuated anchors.
- K. Obtain permission from Owner before drilling or cutting structural members.

#### 3.03 PAINTING

- A. Touchup: Clean field welds and abraded areas of shop paint. Paint exposed areas immediately after erecting hangers and supports. Use same materials as used for shop painting. Comply with SSPC-PA 1 requirements for touching up field-painted surfaces.
  - 1. Apply paint by brush or spray to provide minimum dry film thickness of 2.0 mils (0.05 mm).
- B. Touchup: Comply with requirements in Division 9 painting Sectionsfor cleaning and touchup painting of field welds, bolted connections, and abraded areas of shop paint on miscellaneous metal.
- C. Galvanized Surfaces: Clean welds, bolted connections, and abraded areas and apply galvanizing-repair paint to comply with ASTM A 780.

## 3.04 FIRESTOPPING

A. Apply firestopping to cable and raceway penetrations of fire-rated floor and wall assemblies to achieve fire-resistance rating of the assembly.

# 3.05 <u>DEMOLITION</u>

- A. Protect existing electrical equipment and installations indicated to remain. If damaged or disturbed in the course of the Work, remove damaged portions and install new products of equal capacity, quality, and functionality.
- B. All abandoned wiring shall be removed in its entirety in accordance with the locally amended National Electrical Code. NFPA 70.
- C. Accessible Work: Remove exposed electrical equipment and installations, indicated to be demolished, in their entirety.
- D. Abandoned Work: Cut and remove buried raceway, indicated to be abandoned in place, 2 inches below the surface of adjacent construction. Cap raceways and patch surface to match existing finish.
- E. Remove demolished material from Project site.
- F. Remove, store, clean, reinstall, reconnect, and make operational components indicated for relocation.

### **SECTION 16075 - ELECTRICAL IDENTIFICATION**

#### PART 1 – GENERAL

## 1.01 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

## 1.02 SUMMARY

- A. This Section includes the following:
  - 1. Identification for raceways
  - 2. Identification for conductors.
  - 3. Equipment identification labels.

# 1.03 <u>SUBMITTALS</u>

A. Product Data: For each electrical identification product indicated.

## 1.04 **QUALITY ASSURANCE**

- A. Comply with ANSI A13.1 and ANSI C2.
- B. Comply with NFPA 70.
- C. Comply with 29 CFR 1910.145.

## 1.05 COORDINATION

- A. Coordinate identification names, abbreviations, colors, and other features with requirements in the Contract Documents, Shop Drawings, manufacturer's wiring diagrams, and the Operation and Maintenance Manual, and with those required by codes, standards, and 29 CFR 1910.145. Use consistent designations throughout Project.
- B. Coordinate installation of identifying devices with completion of covering and painting of surfaces where devices are to be applied.
- C. Coordinate installation of identifying devices with location of access panels and doors
- D. Install identifying devices before installing acoustical ceilings and similar concealment.

#### PART 2 – PRODUCTS

# 2.01 RACEWAY IDENTIFICATION MATERIALS

A. Comply with ANSI A13.1 for minimum size of letters for legend and for minimum length of color field for each raceway and cable size.

- B. Color for Printed Legend:
  - 1. Power Circuits: Black letters on an orange field.
  - 2. Legend: Indicate system or service and voltage, if applicable.
- C. Self-Adhesive Vinyl Labels: Preprinted, flexible label laminated with a clear, weather- and chemical-resistant coating and matching wraparound adhesive tape for securing ends of legend label.
- D. Snap-Around Labels: Slit, pretensioned, flexible, preprinted, color-coded acrylic sleeves, with diameter sized to suit diameter of raceway or cable it identifies and to stay in place by gripping action.
- E. Snap-Around, Color-Coding Bands: Slit, pretensioned, flexible, solid-colored acrylic sleeves, 2 inches (50 mm) long, with diameter sized to suit diameter of raceway or cable it identifies and to stay in place by gripping action.
- F. Self-Adhesive Vinyl Tape: Colored, heavy duty, waterproof, fade resistant; 2 inches (50 mm) wide; compounded for outdoor use.

# 2.02 CONDUCTOR IDENTIFICATION MATERIALS

- A. Color-Coding Conductor Tape: Colored, self-adhesive vinyl tape not less than 3 mils (0.08 mm) thick by 1 to 2 inches (25 to 50 mm) wide.
- B. Marker Tapes: Vinyl or vinyl-cloth, self-adhesive wraparound type, with circuit identification legend machine printed by thermal transfer or equivalent process.
- C. Aluminum Wraparound Marker Labels: Cut from 0.014-inch- (0.35-mm-) thick aluminum sheet, with stamped, embossed, or scribed legend, and fitted with tabs and matching slots for permanently securing around wire or cable jacket or around groups of conductors.
- D. Metal Tags: Brass or aluminum, 2 by 2 by 0.05 inch (50 by 50 by 1.3 mm), with stamped legend, punched for use with self-locking nylon tie fastener.

## 2.03 EQUIPMENT IDENTIFICATION LABELS

A. Engraved, Laminated Acrylic or Melamine Label: Punched or drilled for screw mounting. White letters on black face for normal power. White letters on red face for emergency power. Minimum letter height shall be 3/8 inch (10 mm).

### 2.04 MISCELLANEOUS IDENTIFICATION PRODUCTS

- A. Cable Ties: Fungus-inert, self-extinguishing, 1-piece, self-locking, Type 6/6 nylon cable ties.
  - 1. Minimum Width: 3/16 inch (5 mm).
  - 2. Tensile Strength: 50 lb (22.6 kg), minimum.
  - 3. Temperature Range: Minus 40 to plus 185 deg F (Minus 40 to plus 85 deg C).
  - 4. Color: According to color-coding.
- B. Fasteners for Labels and Signs: Self-tapping, stainless-steel screws or stainless-steel machine screws with nuts and flat and lock washers.

## **PART 3 – EXECUTION**

#### 3.01 APPLICATION

- A. Accessible Raceways, 600 V or Less, for Service, Feeder, and Branch Circuits More Than: Identify with orange self-adhesive vinyl label, paint, or self-adhesive vinyl tape applied in bands.
- B. Accessible Raceways of Auxiliary Systems: Identify the following systems with color-coded, self-adhesive vinyl tape applied in bands or paint:
  - 1. Color coding for raceways shall be as follows, verify exact requirements based on existing identification convention present at the facility:

| Color                  |        | Minimum    |
|------------------------|--------|------------|
| Service                | Band   | Band Width |
| Power                  | Yellow | 2"         |
| Emergency Power        | Red    | 2"         |
| Life Safety/Fire Alarm | White  | 2"         |

- C. Branch-Circuit Conductor Identification: Where there are conductors for more than three branch circuits in same junction or pull box, use color-coding conductor tape. Identify each ungrounded conductor according to source and circuit number.
- D. Equipment Identification Labels: On each unit of equipment, install unique designation label that is consistent with wiring diagrams, schedules, and Operation and Maintenance Manual. Apply labels to disconnect switches and protection equipment, central or master units, control panels, control stations, terminal cabinets, and racks of each system. Systems include power, lighting, control, communication, signal, monitoring, and alarm systems unless equipment is provided with its own identification.
  - 1. Labeling Instructions:
    - a. Indoor Equipment: Engraved, laminated acrylic or melamine label. Unless otherwise indicated, provide a single line of text with 1/2-inch- (13-mm-) high letters on 1-1/2-inch- (38-mm-) high label; where 2 lines of text are required, use labels 2 inches (50 mm) high.
    - b. Elevated Components: Increase sizes of labels and letters to those appropriate for viewing from the floor.
  - 2. Equipment to Be Labeled:
    - a. Panelboards, electrical cabinets, and enclosures.
    - b. Access doors and panels for concealed electrical items.
    - c. Disconnect switches.
    - d. Enclosed circuit breakers.

# 3.02 <u>INSTALLATION</u>

A. Verify identity of each item before installing identification products.

- B. Location: Install identification materials and devices at locations for most convenient viewing without interference with operation and maintenance of equipment.
- C. Apply identification devices to surfaces that require finish after completing finish work.
- D. Self-Adhesive Identification Products: Clean surfaces before application, using materials and methods recommended by manufacturer of identification device.
- E. Attach nonadhesive signs and plastic labels with screws and auxiliary hardware appropriate to the location and substrate.
- F. System Identification Color Banding for Raceways and Cables: Each color band shall completely encircle cable or conduit. Place adjacent bands of two-color markings in contact, side by side. Locate bands at changes in direction, at penetrations of walls and floors, at 50-foot (15-m) maximum intervals in straight runs, and at 25-foot (7.6-m) maximum intervals in congested areas.
- G. Color-Coding for Phase and Voltage Level Identification, 600 V and Less: Use the colors listed below for ungrounded service, feeder, and branch-circuit conductors.
  - 1. Color shall be factory applied or, for sizes larger than No. 10 AWG, field applied.
  - 2. Colors for 208/120-V Circuits:
    - a. Phase A: Black.
    - b. Phase B: Red.
    - c. Phase C: Blue.
    - d. Neutral: White
    - e. Ground: Green
  - 3. Colors for 480/277-V Circuits:
    - a. Phase A: Brown.
    - b. Phase B: Orange.
    - c. Phase C: Yellow.
    - d. Neutral: Grav
    - e. Ground: Green
  - 4. Field-Applied, Color-Coding Conductor Tape: Apply in half-lapped turns for a minimum distance of 6 inches (150 mm) from terminal points and in boxes where splices or taps are made. Apply last two turns of tape with no tension to prevent possible unwinding. Locate bands to avoid obscuring factory cable markings.

## SECTION 16120 - CONDUCTORS & CABLES

# **PART 1 - GENERAL**

# 1.01 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

## 1.02 <u>SUMMARY</u>

- A. This Section includes the following:
  - 1. Building wires and cables rated 600 V and less.
  - 2. Connectors, splices, and terminations rated 600 V and less.
  - 3. Sleeves and sleeve seals for cables.

# 1.03 DEFINITIONS

- A. EPDM: Ethylene-propylene-diene terpolymer rubber.
- B. NBR: Acrylonitrile-butadiene rubber.

### 1.04 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Field quality-control test reports.

### 1.05 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- B. Comply with NFPA 70.

#### **PART 2 - PRODUCTS**

### 2.01 CONDUCTORS AND CABLES

- A. Copper Conductors: Comply with NEMA WC 70.
- B. Conductor Insulation: Comply with NEMA WC 70 for Types THHN-THWN XHHW and SO.

## 2.02 CONNECTORS AND SPLICES

Description: Factory-fabricated connectors and splices of size, ampacity rating, material, type, and class for application and service indicated.

#### **PART 3 - EXECUTION**

## 3.01 CONDUCTOR MATERIAL APPLICATIONS

- A. Feeders: Solid for No. 10 AWG and smaller; stranded for No. 8 AWG and larger, except as indicated below.
  - 1. Use standard conductors for control circuits.
  - 2. Use conductor not smaller than 14 AWG for control circuits.
  - 3. Use 10 AWG conductors for 20 ampere, 120 volt branch circuits longer than 75 feet (25 m).
  - 4. Use 10 AWG conductors for 20 ampere, 277 volt branch circuits longer than 200 feet (160 m).
- B. Branch Circuits: Copper. Minimum size #12 AWG; solid for No. 10 AWG and smaller; stranded for No. 8 AWG and larger.

#### 3.02 CONDUCTOR INSULATION APPLICATIONS AND WIRING METHODS

A. Feeders Concealed in Ceilings, Walls, Partitions, below raised floors and Crawlspaces: Type THHN-THWN, single conductors in raceway

#### 3.03 INSTALLATION OF CONDUCTORS AND CABLES

- A. Conceal cables in finished walls, ceilings, and floors, unless otherwise indicated.
- B. Use manufacturer-approved pulling compound or lubricant where necessary; compound used must not deteriorate conductor or insulation. Do not exceed manufacturer's recommended maximum pulling tensions and sidewall pressure values.
- C. Use pulling means, including fish tape, cable, rope, and basket-weave wire/cable grips, that will not damage cables or raceway.
- D. Support cables according to Division 16 Section "Hangers and Supports for Electrical Systems."
- E. Identify and color-code conductors and cables according to Division 16 Section "Electrical Identification."
- F. Use no wire smaller than 12 AWG for power and lighting circuits, and no wire smaller than 16 AWG for control wiring.
- G. Utilize 10 AWG conductor for 20 ampere, 120 volt branch circuit homeruns longer than 75 feet (23m), and for 20 ampere, 277 volt branch circuit homeruns longer than 200 feet (61m).

#### 3.04 CONNECTIONS

A. Tighten electrical connectors and terminals according to manufacturer's published torque-tightening values. If manufacturer's torque values are not indicated, use

those specified in UL 486A and UL 486B.

B. Make splices and taps that are compatible with conductor material and that possess equivalent or better mechanical strength and insulation ratings than unspliced conductors.

# 3.05 FIRESTOPPING

A. Apply firestopping to electrical penetrations of fire-rated floor and wall assemblies to restore original fire-resistance rating of assembly.

## 3.06 FIELD QUALITY CONTROL

- A. Tests and Inspections:
  - 1. After installing conductors and cables and before electrical circuitry has been energized, test service entrance and feeder conductors, for compliance with requirements.
  - 2. Perform each visual and mechanical inspection and electrical test stated in NETA Acceptance Testing Specification. Certify compliance with test parameters.
- B. Remove and replace malfunctioning units and retest as specified above.

## **SECTION 16130 – RACEWAYS AND BOXES**

#### **PART 1 - GENERAL**

# 1.01 <u>SUMMARY</u>

A. This Section includes raceways, fittings, boxes and enclosures, for electrical wiring.

# 1.02 <u>DEFINITIONS</u>

A. EMT: Electrical metallic tubing.

B. FMC: Flexible metal conduit.

C. IMC: Intermediate metal conduit.

D. LFMC: Liquidtight flexible metal conduit.

E. RGSC: Rigid galvanized steel conduit.

F. RNC: Rigid nonmetallic conduit.

## 1.03 SUBMITTALS

- A. Product Data: For surface raceways, wireways and fittings, floor boxes, hinged-cover enclosures, and cabinets.
- B. Coordination Drawings: Conduit routing plans, drawn to scale, on which the following items are shown and coordinated with each other, based on input from installers of the items involved:
  - 1. Structural members in the paths of conduit groups with common supports.
  - 2. Plumbing items and architectural features in the paths of conduit groups with common supports.

### 1.04 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- B. Comply with NFPA 70.

## **PART 2 - PRODUCTS**

# 2.01 METAL CONDUIT AND TUBING

A. Rigid Steel Conduit: ANSI C80.1.

B. IMC: ANSI C80.6.

C. EMT: ANSI C80.3.

- D. FMC: Zinc-coated steel.
- E. LFMC: Flexible steel conduit with PVC jacket.
- F. Fittings for Conduit (Including all Types and Flexible and Liquidtight), EMT, and Cable: NEMA FB 1; listed for type and size raceway with which used, and for application and environment in which installed.
  - a. Conduit Fittings for Hazardous (Classified) Locations: Comply with UL 886.
  - b. Fittings for EMT: Steel compression type.
  - c. Coating for Fittings for PVC-Coated Conduit: Minimum thickness, 0.040 inch (1 mm), with overlapping sleeves protecting threaded joints.
- G. Joint Compound for Rigid Steel Conduit or IMC: Listed for use in cable connector assemblies, and compounded for use to lubricate and protect threaded raceway joints from corrosion and enhance their conductivity.

#### 2.03 METAL WIREWAYS

- A. Description: Sheet metal sized and shaped as indicated, NEMA 250, Type 1, unless otherwise indicated.
- B. Fittings and Accessories: Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, and other fittings to match and mate with wireways as required for complete system.
- C. Wireway Covers: Screw-cover type or Flanged-and-gasketed type as required.
- D. Finish: Manufacturer's standard enamel finish.

#### 2.04 BOXES

- A. Sheet Metal Outlet and Device Boxes: NEMA OS 1.
- B. Cast-Metal Outlet and Device Boxes: NEMA FB 1, ferrous alloy, Type FD, with gasketed cover.
- C. Small Sheet Metal Pull and Junction Boxes: NEMA OS 1.
- D. Cast-Metal Access, Pull, and Junction Boxes: NEMA FB 1, galvanized, cast iron with gasketed cover.

#### PART 3 - EXECUTION

## 3.01 RACEWAY APPLICATION

- A. Comply with the following indoor applications, unless otherwise indicated:
  - 1. Exposed, Not Subject to Physical Damage: EMT.
  - 2. Exposed, Not Subject to Severe Physical Damage: EMT.

- 3. Exposed and Subject to Physical Damage: Rigid galvanized steel conduit. Includes raceways in the following locations:
- 4. Concealed in Ceilings and Interior Walls and Partitions: EMT.
- 5. Connection to Vibrating Equipment (Including Transformers and Hydraulic, Pneumatic, Electric Solenoid, or Motor-Driven Equipment): FMC, except use LFMC in damp or wet locations.
- 6. Damp or Wet Locations: Rigid galvanized steel conduit, IMC.
- 7. Boxes and Enclosures: NEMA 250, Type 1, except use NEMA 250, Type 4, stainless steel in damp or wet locations.
- B. Minimum Raceway Size: 3/4-inch (24-mm) trade size for homeruns and conduits below grade or slab on grade.
- C. Raceway Fittings: Compatible with raceways and suitable for use and location.
  - 1. Rigid and Intermediate Steel Conduit: Use threaded rigid steel conduit fittings, unless otherwise indicated.
- D. All conduits larger than 1" shall be furnished with grounding type busing with equipment grounding conductor solidly connected at both ends.

#### 3.02 INSTALLATION

- A. Comply with NECA 1 for installation requirements applicable to products specified in Part 2 except where requirements on Drawings or in this Article are stricter. Raceway and boxes located as shown on Drawings, and at other locations where required for splices, taps, wire pulling, equipment connections, and compliance with regulatory requirements. Raceway and boxes are shown in approximate locations unless dimensioned. Provide raceway as required to complete wiring system. Sizes shall meet or exceed NEC requirements. Raceway routing is shown for reference only. Route as required for a complete raceway system.
- B. Keep raceways at least 6 inches (150 mm) away from parallel runs of flues and steam or hot-water pipes. Install horizontal raceway runs above water and steam piping.
- C. Complete raceway installation before starting conductor installation.
- D. Arrange stub-ups so curved portions of bends are not visible above the finished slab.
- E. Install no more than the equivalent of three 90-degree bends in any conduit run between boxes. Provide no more than the equivalent of two (2) 90 degree bends between boxes.
- F. Conceal conduit and EMT within finished walls, ceilings, and floors, unless otherwise indicated except as follows:
  - 1. Any variance shall be obtained from the Contracting Officer.
- G. Threaded Conduit Joints, Exposed to Wet, Damp, Corrosive, or Outdoor Conditions:

Apply listed compound to threads of raceway and fittings before making up joints. Follow compound manufacturer's written instructions.

- H. Raceway Terminations at Locations Subject to Moisture or Vibration: Use insulating bushings to protect conductors, including conductors smaller than No. 4 AWG.
- I. Install raceway sealing fittings at suitable, approved, and accessible locations and fill them with listed sealing compound. For concealed raceways, install each fitting in a flush steel box with a blank cover plate having a finish similar to that of adjacent plates or surfaces. Install raceway sealing fittings at the following points:
  - 1. Where conduits pass from warm to cold locations, such as boundaries of refrigerated spaces.
  - 2. Where otherwise required by NFPA 70.
- J. Route raceways, concealed or exposed parallel and perpendicular to walls and building structural components.
- K. Flexible Conduit Connections: Use maximum of 72 inches (1830 mm) of flexible conduit for recessed and semi-recessed lighting fixtures, maximum 36 inches (915 mm) for connection to equipment subject to vibration, noise transmission, or movement; and for transformers and motors.
  - 1. Use LFMC in damp or wet locations.
- L. Avoid moisture traps; provide junction box with drain fitting at low points in conduit system.
- M. Cut conduit square using saw or pipecutter; de-burr cut ends.
- N. Bring conduit to shoulder of fittings; fasten securely.
- O. Use conduit hubs or sealing locknuts to fasten conduit to sheet metal boxes in damp and wet locations and to cast boxes.
- P. Use conduit bodies to make sharp changes in direction, as around beams. Use hydraulic one-shot bender to fabricate bends in metal conduit larger than 2-inch (50mm) trade size.

### 3.03 BOX APPLICATIONS

- A. Set wall mounted boxes at elevations to accommodate mounting heights indicated. Comply with ADA requirements.
- B. Orient boxes to accommodate wiring devices oriented as specified in Section 16140.
- C. Install pull boxes and junction boxes above accessible ceilings and in unfinished areas only.
- D. Inaccessible Ceiling Areas: Install outlet and junction boxes no more than 6 inches (150mm) from ceiling access panel or from removable recessed luminaire.
- E. Locate flush mounting box in masonry wall to require cutting of masonry unit corner only. Coordinate masonry cutting to achieve neat opening.

- F. Do not install flush mounting box back-to-back in walls; provide minimum 6 inches (150 mm) separation. Provide minimum 24 inches (600 mm) separation in acoustic and fire rated walls.
- G. Secure flush mounting box to interior wall and partition studs. Accurately position to allow for surface finish thickness.
- H. Use stamped steel bridges to fasten flush mounting outlet box between studs.
- I. Use adjustable steel channel fasteners for hung ceiling outlet box.
- J. Do not fasten boxes to ceiling support wires or other piping systems.
- K. Support boxes independently of conduit.
- L. Use gang box where more than one device is mounted together. Do not use sectional box.
- M. Use gang box with plaster right for single device outlets.
- N. Do not use boxes smaller than 4-inches square.

### 3.04 FIRESTOPPING

A. Apply firestopping to electrical penetrations of fire-rated floor and wall assemblies to restore original fire-resistance rating of assembly.

#### 3.05 PROTECTION

- A. Provide final protection and maintain conditions that ensure coatings, finishes, and cabinets are without damage or deterioration at time of Substantial Completion.
  - 1. Repair damage to galvanized finishes with zinc-rich paint recommended by manufacturer.
  - 2. Repair damage to PVC or paint finishes with matching touchup coating recommended by manufacturer.
- B. Use suitable caps to protect installed conduit against entrance of dirt and moisture.

### SECTION 16410 – ENCLOSED SWITCHES AND CIRCUIT BREAKERS

#### PART 1 - GENERAL

#### 1.01 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 1 Specification Sections, apply to this Section.

# 1.02 SUMMARY

- A. This Section includes the following individually mounted, enclosed switches and circuit breakers:
  - Fusible switches.
  - 2. Nonfusible switches.
  - 3. Molded-case circuit breakers.
  - 4. Enclosures.

# 1.03 DEFINITIONS

- A. GD: General duty.
- B. GFCI: Ground-fault circuit interrupter.
- C. HD: Heavy duty.
- D. RMS: Root mean square.
- E. SPDT: Single pole, double throw.

## 1.04 SUBMITTALS

- A. Product Data: For each type of enclosed switch, circuit breaker, accessory, and component indicated. Include dimensioned elevations, sections, weights, and manufacturers' technical data on features, performance, electrical characteristics, ratings, and finishes.
  - 1. Enclosure types and details for types other than NEMA 250, Type 1.
  - 2. Current and voltage ratings.
  - 3. Short-circuit current rating.
  - 4. UL listing for series rating of installed devices.
  - 5. Features, characteristics, ratings, and factory settings of individual overcurrent protective devices and auxiliary components.

#### 1.05 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- B. Comply with NFPA 70.
- C. Product Selection for Restricted Space: Drawings indicate maximum dimensions Kona Community Hospital

for enclosed switches and circuit breakers, including clearances between enclosures, and adjacent surfaces and other items. Comply with indicated maximum dimensions.

## 1.06 PROJECT CONDITIONS

- A. Environmental Limitations: Rate equipment for continuous operation under the following conditions, unless otherwise indicated:
  - 1. Ambient Temperature: Not less than minus 22 deg F (minus 30 deg C) and not exceeding 140 deg F (60 deg C).
  - 2. Altitude: Not exceeding 2500 feet (above sea level).

# 1.07 COORDINATION

A. Coordinate layout and installation of switches, circuit breakers, and components with other construction, including conduit, piping, equipment, and adjacent surfaces. Maintain required workspace clearances and required clearances for equipment access doors and panels.

#### **PART 2 - PRODUCTS**

## 2.01 MANUFACTURERS

- A. In other Part 2 articles where titles below introduce lists, the following requirements apply to product selection:
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the manufacturers specified.

#### 2.02 FUSIBLE AND NONFUSIBLE SWITCHES

- A. Manufacturers:
  - 1. Eaton Corporation; Cutler-Hammer Products.
  - 2. General Electric Co.; Electrical Distribution & Control Division.
  - 3. Siemens Energy & Automation, Inc.
  - 4. Square D/Group Schneider.
- B. Fusible Switch, 600 A and Smaller: NEMA KS 1, Type HD, with clips or bolt pads to accommodate specified fuses, lockable handle with capability to accept two padlocks, and interlocked with cover in closed position.
- C. Nonfusible Switch, 600 A and Smaller: NEMA KS 1, Type HD, lockable handle with capability to accept two padlocks, and interlocked with cover in closed position.
- D. Accessories:
  - 1. Equipment Ground Kit: Internally mounted and labeled for copper and aluminum ground conductors.

## 2.04 MOLDED-CASE CIRCUIT BREAKERS AND SWITCHES

- A. Manufacturers:
  - 1. Eaton Corporation; Cutler-Hammer Products.

- 2. General Electric Co.; Electrical Distribution & Control Division.
- 3. Siemens Energy & Automation, Inc.
- 4. Square D/Group Schneider.
- B. Molded-Case Circuit Breaker: NEMA AB 1, with interrupting capacity to meet available fault currents.
  - Thermal-Magnetic Circuit Breakers: Inverse time-current element for low-level overloads and instantaneous magnetic trip element for short circuits.
     Adjustable magnetic trip setting for circuit-breaker frame sizes 250 A and larger.
  - 2. Adjustable Instantaneous-Trip Circuit Breakers: Magnetic trip element with front-mounted, field-adjustable trip setting.
  - 3. Electronic Trip-Unit Circuit Breakers: RMS sensing; field-replaceable rating plug; with the following field-adjustable settings:
    - a. Instantaneous trip.
    - b. Long- and short-time pickup levels.
    - c. Long- and short-time time adjustments.
    - d. Ground-fault pickup level, time delay, and I2t response.
- C. Molded-Case Circuit-Breaker Features and Accessories:
  - 1. Standard frame sizes, trip ratings, and number of poles.
  - 2. Lugs: Mechanical style suitable for number, size, trip ratings, and conductor material.
  - 3. Application Listing: Type SWD for switching fluorescent lighting loads; Type HACR for heating, air-conditioning, and refrigerating equipment.
- D. Molded-Case Switches: Molded-case circuit breaker with fixed, high-set instantaneous trip only, and short-circuit withstand rating equal to equivalent breaker frame size interrupting rating.
- E. Molded-Case Switch Accessories:
  - 1. Lugs: Mechanical style suitable for number, size, trip ratings, and material of conductors.
  - 2. Application Listing: Type HACR for heating, air-conditioning, and refrigerating equipment.

#### 2.05 ENCLOSURES

- A. NEMA AB 1 and NEMA KS 1 to meet environmental conditions of installed location.
  - 1. Outdoor Locations: NEMA 250, Type 3R.
  - 2. Kitchen Areas: NEMA 250, Type 4X, stainless steel.
  - 3. Other Wet or Damp Indoor Locations: NEMA 250, Type 4.
  - 4. Hazardous Areas Indicated on Drawings: NEMA 250, Type 7C.

#### **PART 3 - EXECUTION**

# 3.01 **EXAMINATION**

A. Examine elements and surfaces to receive enclosed switches and circuit

breakers for compliance with installation tolerances and other conditions affecting performance.

B. Proceed with installation only after unsatisfactory conditions have been corrected.

#### 3.02 <u>INSTALLATION</u>

- A. Comply with applicable portions of NECA 1, NEMA PB 1.1, and NEMA PB 2.1 for installation of enclosed switches and circuit breakers.
- B. Mount individual wall-mounting switches and circuit breakers with tops at uniform height, unless otherwise indicated.
- C. Comply with mounting and anchoring requirements specified in Division 16 Section "Hangers and Supports for Electrical Systems"
- D. Temporary Lifting Provisions: Remove temporary lifting eyes, channels, and brackets and temporary blocking of moving parts from enclosures and components.

#### 3.03 IDENTIFICATION

- A. Identify field-installed conductors, interconnecting wiring, and components; provide warning signs as specified in Division 16 Section "Electrical Identification."
- B. Enclosure Nameplates: Label each enclosure with engraved metal or laminatedplastic nameplate as specified in Division 16 Section "Electrical Identification."

#### 3.04 FIELD QUALITY CONTROL

- A. Prepare for acceptance testing as follows:
  - 1. Inspect mechanical and electrical connections.
  - 2. Verify switch and relay type and labeling verification.
  - 3. Verify rating of installed fuses.
  - 4. Inspect proper installation of type, size, quantity, and arrangement of mounting or anchorage devices complying with manufacturer's certification.

#### 3.05 CLEANING

- A. On completion of installation, vacuum dirt and debris from interiors; do not use compressed air to assist in cleaning.
- B. Inspect exposed surfaces and repair damaged finishes.

**END OF SECTION** 

#### SECTION 16491 - FUSES

#### **PART 1 - GENERAL**

#### 1.01 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

#### 1.02 SUMMARY

- A. This Section includes the following:
  - 1. Cartridge fuses rated 600 V and less for use in switches, panelboards, switchboards, controllers and motor-control centers.

#### 1.03 SUBMITTALS

- A. Product Data: Include the following for each fuse type indicated:
  - 1. Dimensions and manufacturer's technical data on features, performance, electrical characteristics, and ratings.
  - 2. Let-through current curves for fuses with current-limiting characteristics.
  - 3. Time-current curves, coordination charts and tables, and related data.
  - 4. Fuse size for elevator feeders and elevator disconnect switches.
- B. Ambient Temperature Adjustment Information: If ratings of fuses have been adjusted to accommodate ambient temperatures, provide list of fuses with adjusted ratings.
  - 1. For each fuse having adjusted ratings, include location of fuse, original fuse rating, local ambient temperature, and adjusted fuse rating.
  - 2. Provide manufacturer's technical data on which ambient temperature adjustment calculations are based.
- C. Operation and Maintenance Data: For fuses to include in emergency, operation, and maintenance manuals.
  - 1. In addition to items specified in Division 1, include the following:
    - a. Let-through current curves for fuses with current-limiting characteristics.
    - b. Time-current curves, coordination charts and tables, and related data.
    - c. Ambient temperature adjustment information.

#### 1.04 QUALITY ASSURANCE

- A. Source Limitations: Obtain fuses from a single manufacturer.
- B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- C. Comply with NEMA FU 1.

D. Comply with NFPA 70.

#### 1.05 PROJECT CONDITIONS

A. Where ambient temperature to which fuses are directly exposed is less than 40 deg F (5 deg C) or more than 100 deg F (38 deg C), apply manufacturer's ambient temperature adjustment factors to fuse ratings.

#### 1.06 COORDINATION

A. Coordinate fuse ratings with utilization equipment nameplate limitations of maximum fuse size.

#### 1.07 EXTRA MATERIALS

- A. Furnish extra materials described below that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
  - 1. Fuses: Provide six (6) spare fuses.

#### PART 2 - PRODUCTS

#### 2.01 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Cooper Bussman, Inc.
  - 2. Ferraz Shawmut, Inc.
  - 3. Tracor, Inc.; Littelfuse, Inc. Subsidiary.

#### 2.02 CARTRIDGE FUSES

A. Characteristics: NEMA FU 1, nonrenewable cartridge fuse; class and current rating indicated; voltage rating consistent with circuit voltage.

#### **PART 3 - EXECUTION**

#### 3.01 EXAMINATION

- A. Examine utilization equipment nameplates and installation instructions. Install fuses of sizes and with characteristics appropriate for each piece of equipment.
- B. Evaluate ambient temperatures to determine if fuse rating adjustment factors must be applied to fuse ratings.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

#### 3.02 FUSE APPLICATIONS

A. Motor Branch Circuits: Class RK5, time delay.

#### 3.03 <u>INSTALLATION</u>

A. Install fuses in fusible devices. Arrange fuses so rating information is readable without removing fuse.

#### 3.04 <u>IDENTIFICATION</u>

A. Install labels indicating fuse replacement information on inside door of each fused switch.

**END OF SECTION** 



#### **APPENDIX L**

### **CONTRACTORS HANDBOOK**

See following pages.



# **Contractor Guidelines**



care You can count on

# **Table of Contents**

| Table of Contents                                       | 2 - 3   |  |
|---|---------|--|
| Introduction  | 4       |  |
| Important Phone Numbers                                 | 5       |  |
| Human Resources Requirements                            | 6       |  |
| Employee Health Requirements                            |         |  |
| Request for Records and Documentation                   |         |  |
| Confidentiality   | 8       |  |
| General Safety  | 8       |  |
| Contractor Check-In                                     | 9       |  |
| Identification Badges                                   | 9       |  |
| Parking   | 9       |  |
| Smoking and Tobacco Use                                 | 9       |  |
| Personal Appearance                                     | 10      |  |
| Appropriate Behavior                                    | 10      |  |
| Workplace Violence Prevention                           | 10      |  |
| Interacting with Patients and Hospital Staff            | 11      |  |
| Healthcare Personal Protective Equipment Requirements   |         |  |
| Hand washing and Disinfection                           | 12      |  |
| Clothing and Construction Personal Protective Equipment | 13 - 14 |  |
| First Aid   | 14      |  |
| Entering Patient Rooms                                  | 14      |  |
| Patients on Special Precautions                         | 15      |  |
| Designated Entrance and Exit Route                      | 15      |  |
| Workplace Set-up  | 16      |  |
| Traffic Control   | 16      |  |
| Housekeeping and Waste Disposal                         | 17      |  |
| Hot Work Permits  | 18 - 19 |  |
| Infection Control Permits                               | 19 - 21 |  |
| Fire and Smoke Barrier Penetration Permits              | 21      |  |

# **Table of Contents**

| 22      |
|---------|
| 23      |
| 23      |
| 23      |
| 24      |
| 24      |
| 24      |
| 25      |
| 25      |
| 25      |
| 26      |
| 28 - 29 |
| 29      |
| 30      |
| 30      |
| 30      |
| 31      |
| 31      |
| 31      |
| 32      |
| 33 - 35 |
| 35 - 36 |
| 37 - 40 |
| 41      |
| 42      |
| 43 - 45 |
| 46 - 47 |
|         |
|         |
|         |

# **Introduction**

This Contractor Guidelines Booklet is designed for contractors and sub-contractors who provide services to Kona Community Hospital.

This booklet provides requirements and expectations of the contractors and sub-contractors that are contracted to perform work in the hospital.

Contractors and sub-contractors working in the hospital must successfully complete all requirements listed in the booklet prior to any project work beginning on-site at Kona Community Hospital.

Each General / Primary Contractor is responsible for any of their Sub-contractors activities and is expected to ensure compliance with all applicable regulatory or compliance guidelines set out in this booklet.

Failure to comply with the requirements of this booklet may result in the halting of the project and/or termination of the contract.

To ask questions about the booklet or its contents or to obtain additional copies please contact:

KCH Maintenance at 808-322-4592

# **Important Phone Numbers**

| Human Resources                | 322-4458 |
|--------------------------------|----------|
| Employee Health                | 322-4478 |
| Infection Prevention           | 322-4478 |
| Facility Director              | 322-4495 |
| Maintenance Clerk              | 322-4592 |
| Risk Manager                   | 322-6976 |
| Hospital Supervisor            | 322-4594 |
| Patient Access (Admitting)     | 322-5803 |
| Security                       | 322-4525 |
| Maintenance Supervisor         | 322-4566 |
| Housekeeping                   | 322-4521 |
| ICU Manager                    | 322-5824 |
| Emergency Room Manager         | 322-4484 |
| Medical/Surgical Manager       | 322-4477 |
| Surgical Services (OR) Manager | 322-6909 |
| First Floor Acute Manager      | 322-4407 |
| Behavior Health Manager        | 322-4573 |
| Obstetrics Manager             | 322-4598 |
| Imaging Manager                | 322-5872 |
| Pharmacy Manager               | 322-4402 |
| Clinical Labs Manager          | 322-4422 |
| Dietary Manager                | 322-4415 |
| Administration (CEO, CNE)      | 322-6970 |
| IT Department                  | 322-5887 |
| Contracts Management           | 322-4442 |

# **Human Resource Requirements**

Contact Human Resources to schedule an appointment to pick up and review documents listed below:

- Read the Contractor Guideline booklet. Return Contractor Guidelines Confirmation of Understanding to Human Resources.
- ▲ Drug Screening: Each contractor / sub-contractor will have to complete a five panel drug screen within six months of the project start date. Negative drug screening results are to be submitted to Human Resources. Additionally, if management has a reasonable individualized suspicion that a contractor is currently violating the Hospital Drug Free workplace policy, a urine drug screen may be requested. Arrangements to complete a drug screening can be made through Human Resources at a fee of \$17.00 per person. Contact Human Resources to schedule an appointment (page 4).
- ▲ State and Federal Criminal History Record Check: Each contractor / sub-contractor will have to complete a State and Federal criminal background check within six months of project start date. Background check results are to be submitted to Human Resources. Persons with any criminal charges pending or with any felony convictions shall not be eligible to work in the Hospital. Arrangements to complete a background check can be made through Human Resources at a fee of \$50.00 per person. Contact Human Resources to schedule an appointment (page 4).
- **♦** Complete **Request for State Federal Criminal History Record Check** form
- ▲ Complete and return the **Acknowledgement and Understanding.**
- ▲ Camera Surveillance and Image Recording form. Initial, sign, and date **Appendix A**. Policy is for your records.

## **Employee Health Requirements**

Contact Employee Health / Infection Control to review documents listed below: All documents can be picked up at Human Resources.

- ▲ Complete the following forms:
  - -Contractor Health Evaluation
  - -Immunization Declination Requirements for Maintenance and Construction Contractors
- ▲ Submit a completed annual Tuberculosis test. Arrangements to complete a TB test can be made through your primary care physician or contact the Hawaii Department of Health at 808-322-1522.
- ▲ Completion of an annual influenza vaccine (or declination form) during the flu season of October through March.



# **Request for Records and Documentation**

Contractor will cooperate with and make available to Kona Community Hospital any records and documentation required by such authorities within eight (8) hours upon request. Kona Community Hospital will make such requests during normal business hours.

### **Confidentiality**

At Kona Community Hospital, privacy of patients is valued and protected by law. Although contractor employees will never have reason to use private health information, they may come into contact with documents and computer screens, or overhear conversations that contain private information. Please remember that this information is protected and private and should not be discussed or shared.

Not all areas of the hospital are open to the public for reasons of safety or privacy. If contractors are required to work in clinical areas they must observe specific HIPPA security/confidentially rules.

# **General Safety**

Kona Community Hospital is committed to the safety of employees, students, visitors, and patients. All employees, including contractor employees, are expected to take safety seriously and follow good safety practices. If there is any doubt regarding the safety of a job or task, notify the Facilities Director.

If you are feeling ill stay home. You are more prone to germs from others and more likely to spread your germs to patients who are already sick and have little defenses left to use against them. You will get better faster and you won't get anyone else sick either.

Kona Community Hospital has adopted and follows a safety plan designed to provide a safe environment. The goal of this plan is to create a workplace that is free from hazards and where risks of injuries to employees, patients, visitors, and contractors is at a minimum.

Since safety is a team effort, everyone working at Kona Community Hospital must look out for themselves and each other by watching for unsafe practices and correcting or reporting them if encountered.

#### **Contractor Check-In**

Upon the daily arrival of a contractor to Kona Community Hospital, the contractor is required to check-in and sign-in at the Maintenance Office. Contractors must also check-out and sign-out daily at the Maintenance Office. Hours of normal operations are 0600 to 1430 Mondays thru Fridays. Any off shift, holiday and weekend work requires prior approval and 48 hours notice arranged with the Facilities Director. Arrangements for card access to project areas requires 48 hours notice.

# **Identification Badges and Basic Security**

All contractor employees must wear a KCH badge (permanent / temporary). Badges are issued from HR after all HR and Employee Health requirements are completed. Badges are signed out and back in daily through the Maintenance Department. The badge must be worn above the waist. Contractor employees without badges will be asked to check in at the Maintenance Department. Off shift, holiday and weekend arrangements will be made with the Maintenance Clerk and approval of the Facilities Director to have the badges sent to Patient Access to be signed in and returned at end of shift.

# **Parking**

Parking at Kona Community Hospital is at a premium. Contractors must park in areas designated by the facility.

# **Smoking and Tobacco Use**

Kona Community Hospital is a Smoke and Tobacco Free Campus. Use of tobacco products including cigarettes, chew and electronic cigarettes is not allowed on campus.

#### **Personal Appearance**

- ▲ A shirt displaying the contractor's name is preferred. Long work pants or jeans and covered shoes are required
- ▲ Identification badge must be worn above the waist.
- ▲ Not allowed are slippers, shorts and sleeveless shirts with holes, and / or offensive language and / or artwork.

#### **Appropriate Behavior**

Kona Community Hospital promotes a healthy work environment and expects appropriate behavior by everyone on campus.

Reports of inappropriate behavior will be investigated and disciplinary action may result.

Whistling, inappropriate language and any other gesture that is perceived to be offensive to Kona Community Hospital employees and guests will not be tolerated and will be cause for dismissal.

All contractors are responsible for adhering to these guidelines and must report inappropriate actions to the Nursing Supervisor, Facilities Director, or Risk Manager.

# **Workplace Violence Prevention**

Violence, threat of violence, intimidation, harassment or coercion is not tolerated on the KCH campus.

Contractor employees are responsible for adhering to these guidelines and for reporting disruptive or violent behavior to Security, Nursing Supervisor, Facilities Director or the Risk Manager.

#### **Interacting with Patients and Hospital Staff**

The employees of Kona Community Hospital are proud of their facilities and are always careful to ensure the comfort and welfare of patients, visitors and co-workers. Even if only temporarily, contractor employees will become part of the KCH work force and may even be viewed as KCH employees by patients, guests or visitors.

All contact with patients, staff and visitors must demonstrate respect for the individual. Any action or words that suggest bias or prejudice are not appropriate.

# Healthcare Personal Protective Equipment Requirements

Personal protective equipment (PPE) is provided in an assortment of sizes and includes the following examples: gloves, isolation gown, mask, face shield, shoe covers and jumpsuits. Observe sterile work zone requirements and restrictions. Do not enter sterile corridors or rooms without appropriate attire required (ie. Scrubs, hats, booties, face mask, etc.) Do not wear this clothing out of the sterile area and re-enter, if you have exited area replace with clean PPE's prior to re-entry into area. You must coordinate with unit manager if you are unsure of appropriate attire or procedure required.



#### **Hand-washing and Disinfection**

In the Hospital setting any surfaces (phones, elevator buttons, tool handles etc.) can become a breeding ground for germs. Anyone that comes into contact with these surfaces can then transmit the germs to other areas in the hospital and potentially to our vulnerable patients. Every year thousands of people die from infections acquired at the hospital. The best defense against germs is hand washing; frequent hand washing in a healthcare setting will keep patients, staff and you safe from potential life threatening germs and spread of disease. KCH has alcohol hand washing stations throughout the facility for your convenience; to use just apply the foam/gel to your hands and rub until dry. If you like the traditional soap and water method please remember to scrub your hands for at least 20 seconds and use a paper towel to dry your hands and another one to turn off the faucet. Hand washing is expected during the following activities:

- ▲ When entering and exiting the facility and construction locations
- ▲ Before and after working on hospital equipment/locations
- ♠ When entering and exiting patient care areas
- ▲ Before applying and immediately after removing personal protective equipment.
- ▲ After removing gloves
- ▲ After using the restroom
- ♠ Before eating meals





# <u>Clothing and Construction Personal</u> <u>Protective Equipment</u>

While working at KCH, your personal protective equipment protects you as a worker, but also alerts our patients and staff to potential hazards in the area. To maintain the healing environment, please ensure all clothing is clean and dust free and is in a respectful condition.

While working at KCH the following OSHA guidelines must be followed:

- 29 CFR 1926 Construction Industry
- 1926 Subpart C, General safety and health provisions
- 1926.28, Personal protective equipment
- -1926 Subpart E, Personal protective and life saving equipment •1926.95, Criteria for personal protective equipment
- 1926.96, Occupational foot protection
- 1926.100, Head protection
- 1926.101, Hearing protection
- 1926.102, Eye and face protection
- 1926.103, Respiratory protection
- 1926.104, Safety belts, lifelines, and lanyards
- 1926.105, Safety nets
- 1926.106, Working over or near water
- 1926.107, Definitions applicable to this subpart
- 1926 Subpart M, Fall protection [related topic page]
- 1926.500, Scope, application, and definitions applicable to this subpart

# <u>Clothing and Construction Personal</u> <u>Protective Equipment</u>

- 1926.501, Duty to have fall protection
- 1926.502, Fall protection systems criteria and practices
- 1926.503, Training requirements
- 1926 Subpart P, Excavations [related topic page]
- 1926.651, Specific excavation requirements
- 1926.652, Requirements for protective systems

#### First Aid

Contractors must provide adequately stocked first aid kits on their job sites for use by their employees and any injury requiring more than on site first aid must be reported to the Facilities Director as soon as possible.



# **Entering Patient Rooms**

Non-healthcare contract workers may enter patient rooms only after making arrangements with the Facilities Director and the Maintenance Supervisor. They will coordinate with the nursing staff as applicable.

## **Patients on Special Precautions**

Sometimes there are patients who are on special precautions such as Contact, Droplet, Airborne, GI Contact, and Neutropenic. If so, color coded signage will be posted outside their door. **You must wear** specific personal protective equipment to protect yourself, other patients and staff from potential infections. **YOU MUST** coordinate entry and exit from these rooms with the unit manager. Wear all required protective equipment (gloves, gown and/or mask) prior to entering rooms and remove all equipment before you leave the room. Most importantly be sure to perform good hand washing upon exiting the room. (Images of these signs are located on pages **33 - 35**)

Contractor employees must be aware that patients with suppressed immune systems may be found just about anywhere in the buildings. To these individuals, a simple virus could be very serious. For this reason all employees, contractor and staff, are expected to observe basic infection control procedures.

Contractor employees must protect patients by following standard precautions at all times. These include hand washing, wearing of gloves, gowns, masks, and shoe covers as appropriate. The Hospital Maintenance Department, or nursing staff will assist you in selecting the appropriate personal protection.

# **Designated Entrance and Exit Routes**

The Facilities Director shall define entrance and exit routes for contractors that provide the least amount of interference with activities in that area. These routes must accommodate the safe transport of construction equipment/debris, construction workers, staff, patients, and guests. No egress can be blocked or restricted without the approval and coordination with the Facilities Director. Any routes blocking egress must have signage and alternative egress pathways incorporated.

#### **Workplace Set-up**

All work areas must be marked off with cones, tape, barriers, or other traffic diverters. More than 50 percent of the width of a hallway may never be blocked without making arrangements with the Facilities Director.

No impairments to the fire alarm, fire suppression, or egress routes can be made unless approved by the Facilities Director three working days in advance.

Tools and materials must be safely secured or packaged when unattended. Items must not be left in a way that could injure staff, patient(s), or visitor(s).

Tools and materials must also be safeguarded in such a manner to minimize the risk to everyone. The responsibility for safeguarding all materials/equipment from theft is the responsibility of every individual.

Patients, staff, and public areas must be protected from dust, dirt, and other construction-related contamination. The use of non-combustible dust barriers and air filtration systems with HEPA filters may be required. Transport of tools, equipment and construction debris must be done in a way to minimize dust and dirt. All transported materials must be covered and secured at all times.

# **Traffic Control**

When a project includes motorized and pedestrian traffic control the Facilities Director and Contractor will determine the safest routes and procedures to facilitate this traffic. Whistles and other devices used to control traffic shall be used respectfully, and for the purpose of traffic control only. Three (3) days notice must be give prior to restriction of any roadway at KCH & must be coordinated through the Facilities Director and KCH Security Department.

## **Housekeeping & Waste Disposal**

Contractor employees are expected to maintain an orderly and safe jobsite. Daily cleanup of the jobsites is required. Temporary storage of construction waste can not exceed 50 Cubic feet of materials.

# Keep floors and walkways clear by cleaning up spilled liquids, and keeping cords and other obstacles out of the way of pedestrian

traffic. Continually sweep and mop as necessary per requirements in the infection control risk assessment/permit. Remove construction debris daily in the following manner: during transport of materials, both in and out of the facility ensure they are properly secured and covered, ensure all dump carts (including wheels) are cleaned up prior to entering patient care areas. Transport of materials in and out of work areas should occur at the beginning and end of shifts whenever possible. NEVER clean up an unidentified spill; notify housekeeping immediately if you believe there may be a hazardous (body fluid) or chemical spill.

All entry ways need sticky mats, sticky mats need to be changed frequently and upon the discovery that the sticky mats are no longer sticky. Contractors are responsible for their own waste hauling receptacles. Reference Hawaii County waste hauling guidelines and separation of solid wastes. Contractors are responsible for removing and disposing of their hazardous waste via a certified hazardous waste hauler. A manifest is required for disposal and evidence to KCH the waste was disposed of properly.





#### **Hot Work Permits**

Any work that involves use of an open flame, such as torch smoldering, welding, grinding or cutting requires a Hot Work Permit. To obtain a hot work permit the welding/cutting equipment and the individuals performing the work must be on the job site. A serviceable 10 pound ABC fire extinguisher must be at each location. Please contact the Facilities Director to request a Hot Work Permit. Example of permit is located on page 43-44.

An individual will be dispatched to issue the permit.

**Torches**: No Liquefied Petroleum Gas, Mapp Gas or oxygen acetylene bottles over 5 lbs of volume are allowed in the facility.

Smoke detectors will require a manufacturers cover to be applied during work & cover will be removed after the project is completed for the day. A Interim Life Safety Deficiency Form must be created. See attached form and policy on pages 46 - 47.

**Fire Sprinkler Heads:** Must be protected when working within 4 feet of a head. Contact the Facilities Director.

If the fire sprinkler is impaired an Interim Safety Life Measure (page 46 - 47) must be created.

**Smoke detectors:** The following procedures apply:

- 1. Use a zip lock bag and cut the bottom of the bag off.
- 2. Use blue painter's tape to secure the bottom of the zip lock bag to the base of smoke detector. **Bag must be dated and contractors name listed.**
- 3. At the start of each shift the zip lock bag is closed and at the end of the shift the bag either removed or the zip lock is opened.

NOTE: Hot Work Permits CAN NOT be issued if fire suppression systems are not functional. If hot work must be performed a fire watch is required.

#### A fire watch is defined as:

- 1. The assignment of a person or persons to the area for the express purpose of notifying the Fire Department, the building occupants, or both, of an emergency.
- 2. Preventing a fire from happening.
- 3. Extinguishing small fires.
- 4. Protecting the public from fire or life safety dangers.

This/ these personnel must be specially trained in fire prevention techniques, and they should understand the particular fire safety situation. All fire watch(es) must be coordinated prior to the event with the Facilities Director.

**Fire Blankets/Welding Pads/Smoke Eaters:** May be required depending on the area that work is being performed in.

#### **Infection Control Permits**

Infection Control is taken very seriously and applies to all areas of the KCH facility. It applies both to how construction projects affect our patients as well as how our patients and the environment affect you. To ensure we are providing a safe healing environment for our patients and staff the following requirements shall be strictly followed:

You will be required to obtain an Infection Control Permit from Maintenance prior to performing construction related tasks within all patient care, laboratory or any other areas where the services rendered are directly related to patient care. There are four types of construction that are associated with four risk levels. This information defines the criteria for an Infection Control Permit.

You may <u>not</u> begin your work until the appropriate authorization has been completed and the permit is posted at/near the entrance of the worksite. Posting of this permit is required over the construction period. Please see Facilities Director to determine if a permit is required for your tasks.

All Infection Control requirements will be followed at all times as defined by the Infection Control Permit. Daily Infection Control compliance surveys will be completed by KCH maintenance staff. If at any time contractors are not meeting infection control risk assessment/permit requirements the job site can be shut down until the proper requirements are satisfactorily met. Repeat offenses can result in KCH stopping contractors work on the project. Example of Infection Control Risk Assessment and permit can be viewed on pages 37 - 40.

#### **Dust Containment:**

Negative Air Machines with HEPA filters are required in all construction areas.

- Sticky mats must be placed outside of the construction area and changed frequently.
- Plastic zip wall and/or temporary barriers must be in place prior to start of project.
- ▲ Coveralls must be worn over any soiled/contaminated clothing.
- ▲ Dusty or contaminated shoes must be covered with paper booties.
- ▲ Appropriate PPE and/or jumpsuits/scrubs will be used when entering "clean or sterile" work areas such as OR suites.
- ♠ All negative air exhaust shall be exhausted outside of the building unless circumstances deem this impossible/unreasonable.
  Discharge of exhaust air within the facility is a last resort and must be pre-approved by the Facilities & Infection Prevention Directors.
- ▲ Discharge of negative air exhaust into the hospital HVAC system is strictly prohibited.
- ▲ You may inspect ceiling spaces by removing one 2x2 tile or one 2x4 tile. If multiple tiles removed or any work is completed a containment unit (ie: Aire Guardian) and ladder permit (example page 42) must be in place. You are responsible for immediate clean up of any debris resulting in tile removal.

#### **Dust Contamination:**

- ▲ HEPA filters and pre-filters will be supplied by the contractor. A written log must be kept with the contractor owned air scrubber. Pre filters must be changed when visually dirty and at the beginning of each new project.
- ▲ Discharge of exhaust is required and must be pre-approved by the Facilities and Infection Control Directors.





#### **Fire and Smoke Barrier Penetration Permits**

All fire and smoke barriers must be sealed as specified in the construction documents. When working within KCH any cutting, opening, or otherwise penetrating **ANY** wall requires a wall penetration permit (Example on page 41) from the Maintenance Department. Never penetrate any walls without coordinating with the Facilities Director to obtain a permit.

#### **Dig Permits**

Prior to beginning excavation, a utility line locator firm shall be employed to physically locate the utility lines in order to avoid unplanned outages that can result from accidental damage.

# No Digging may take place with out the direct involvement of the Facilities Director.

To begin a project that requires digging, call the utility line locater that is responsible for your work area to ask for the location and voltage of underground utility lines and tell them where and when you are working in that area.

Advise co-workers before you start digging and mark on your blueprints or plan the exact location of the utility lines. Then place warning signs along the route, if they are not already posted.

Protect your self by working with another person who can be a spotter or signaler, and can call for assistance in an emergency. Always keep equipment, workers, materials well outside the minimum safety distance.

If a power line has been severed, have someone call the KCH Maintenance Department immediately to shut off the electricity. If you are sitting on earth-moving or other riding equipment, stay on the equipment—don't attempt to jump off unless the machine is on fire and your life is in immediate danger.

Move the equipment away from the power source if it is at all possible. Keep others away from the accident, don't let anyone attempt to attach a winch line or approach the machinery in any way.

# **Security of Doors**

Every individual is responsible for ensuring the job site and facility is secure.

- ▲ Do not allow another person to "tailgate" through badge entry door. If that person should have access they will have badge access.
- ▲ Do not leave doors unlocked or prop open locked doors.
- Ensure all doors are again secured when you exit.

# **Weekly Safety Meeting**

All contractors are required to have a weekly safety meeting and documentation of meeting highlighting different OSHA standards and guidelines. The presenter needs to have the 30 hour OSHA safety training and provide documentation to KCH of completion prior to commencement of work.



# **Ladder Safety**

Contractors must follow OSHA guidelines 3124-12R-2003. Example of permit on page 42

#### **Electrical Safety**

All power tools must be UL approved and have a three prong grounded plug. Two prong plugs are not permitted. No three receptacle cord adaptors are allowed. Limit extension cords. No plug strip to plug strip power extenders. Manage cords safely in corridors and use approved cord covers. No extension cords or power tool cords can be repaired with electrical tape if frayed. A new cord or cord end must be installed. Lock out / Tag out procedures shall be followed per OSHA guidelines 23 CPR 1910.147. Consult with Facilities Director for KCH specific guidelines. Lock out / Tag out is not only applicable to electric work it is also applicable to plumbing, medgas, vacuums, reheat, steam, and chilled water systems.

#### **Red Receptacle Outlets**

Red receptacle outlets are located throughout KCH and are not to be used by contractors.

These red receptacle outlets are connected to the emergency power systems and will provide power even during an outage. Red receptacle outlets are not to be used for non-emergencies. Never unplug equipment from red receptacle outlets as they are used for critical patient care equipment only.

# **Emergency Preparedness**

Kona Community Hospital requires that all employees and contractor employees must be familiar with the basic requirements of the Emergency Plans before they begin work.

# **Reporting an Emergency**

To report an emergency at Kona Community Hospital please call the Hospital Operator at 322-9311 or dial 0 from hospital phone.

# **Emergency Response**

In the event that emergency procedures are announced (Page Codes) check immediately with your Supervisor or the nearest KCH staff member to ask what is expected in this situation. You may be asked to leave the area.

### **Page Codes**

Kona Community Hospital uses a color code system to notify employees, vendors and contractor employees of emergency situations. These codes will be given verbally over the public address system. These codes are:

For example, if there is a fire, there will be a page over the public address system stating: "Code Red" followed by the location.

If employees wait until an emergency is actually occurring before attempting to determine what is expected of them they may be too late because time is a very valuable commodity during an emergency.

| Code Black          | Severe Weather                   |
|---------------------|----------------------------------|
| Code Blue           | Cardiac Arrest/Medical Emergency |
| Code Gray           | Security Assistance              |
| Code Green          | Bomb Threat                      |
| Code Orange         | Hazmat/ Bioterrorism             |
| Code Pink           | Infant Abduction                 |
| Code Red            | Fire                             |
| Code Silver         | Adult Elopement                  |
| Code Active Shooter | Active Shooter                   |
| Code Triage         | Disaster Activation              |

#### Code Red—Fire Plan

Everyone working in Kona Community Hospital must always be aware of the locations of the nearest fire alarm pull station, the nearest fire extinguisher and the nearest exit.

When the fire alarm sounds everyone needs to leave the building.

# R.A.C.E

#### R - Rescue

Rescue anyone in danger. Protecting of life is paramount.

#### A - Activate

Activate the nearest fire alarm station by pulling down the lever.

Dial # 40 on telephone handset and announce loudly 3 times "Code Red and location of fire (example code red electrical room first floor)". Assist others who may need assistance.

# <u>C</u> - Confine

Close all doors, windows or openings in the room or corridor area where smoke and/or fire are present to isolate the condition.

Remember that smoke is also very dangerous, many victims of fires succumb to smoke.

If a closed door is hot, this may mean that there is fire on the other side. DO NOT OPEN a hot door.

#### <u>E - Extinguish</u>: Secure fire extinguishers for use.

Fire extinguishers may be used only for small fires that are getting started, do not attempt to use a fire extinguisher on a fire that is too large or dangerous.

Only the respiratory therapy department or nursing may turn off medical gasses.

#### If you elect to extinguish the fire remember:

When using a fire extinguisher, remember the word "P.A.S.S". Each letter represents a step for using the fire extinguisher.

- **P– Pull** the pin from the fire extinguisher.
- **A– Aim** the hose at the base of the fire.
- **S- Squeeze** the handle (lasts 20 seconds)
- **S- Sweep** from side to side.

#### Evacuation—General Guidelines

- ♠ Keep Calm
- ▲ Leave lights on
- ▲ Do not use elevators (unless directed by Fire Dept.)
- ▲ Do not use telephones (unless directed by Fire Dept.)
- ▲ Keep all corridors clear at all times.
- ▲ Do not block the fire extinguishers or fire hoses.
- ▲ Do not block or lock any designated exits
- ▲ Know the location of fire extinguishers and pull stations.

#### Fire Safety General Guidelines—<u>DO</u>

- ♠ Obtain a Hot Work Permit prior to performing any hot work, including welding, soldering, torch cutting, or any work using an open flame.
- Participate in fire drills.
- ▲ Follow Interim Life Safety Measures (ILSM's) implemented due to construction. Refer to attached policy (page 46)
- Place ceiling tiles back in place when completed with above ceiling.
- Protect penetrations through fire rated walls in accordance with UL System requirements.

#### Fire Safety General Guidelines—DON'T

- ▲ Do not remove or tamper with any fire protection or life safety equipment, including: smoke detectors, fire alarm speaker/strobes, fire alarm pull stations, fire sprinklers, and fire extinguishers
- ▲ Do not prop open fire rated or smoke barrier doors, especially stairwell doors.
- ▲ Do not tamper with the latch on fire rated doors (to prevent the door from latching).
- ♠ Do not store equipment or supplies in the corridor or the stairwells.
- Do not block any exit or egress.

#### **Hazardous Materials**

Materials in use in Kona Community Hospital:

Hazardous Materials are present and in use at KCH. These chemicals may include flammables, toxics, corrosives, biohazards or radioactive. Safety Data Sheets (SDS) for these chemicals are available through the SDS line located on a label affixed to every KCH phone.

Read all warning labels carefully. If the warning label is missing from a suspected hazardous chemical, notify a Supervisor or the Facilities Director.

#### Chemicals Brought by Contractor:

Safety Data Sheets (SDS) must be submitted to the Facilities Director for approval. All chemicals must be labeled in accordance with 29 CFR 1910.1200 (Hazard Communication).

#### Hazardous Material Spills:

If you discover a spill believed to be hazardous or questionable, contact:

▲ Housekeeping at 322-4521.

In addition, notify your supervisor and the Facilities Director.

# **Exposure to Human Blood or Body Fluids**

The OSHA Blood Borne Pathogen Standard (1992) is to protect workers that have a reasonable anticipated risk of an occupational blood or body fluid exposure on their job. Typically contractors do not fall into this category however anyone working with in a healthcare facility can be at risk for blood and body fluid exposure. Some of the potential blood borne disease includes HIV and Hepatitis.

Needles and other sharp instruments are used throughout KCH and patient blood and body fluids are transported throughout the campus. Our expectation is that these are contained appropriately; however, exposures can still occur and KCH has developed a plan of action to address any exposure that does occur.

Contractors experiencing an exposure such as being pricked by a "sharp" or splashed (eyes, mouth, or skin) by body fluids while on the KCH campus, should immediately stop what you are doing and wash the area thoroughly with soap and water. Proceed directly to the KCH Emergency Department for a post exposure work up. Time is very important with exposure injuries so **DO NOT DELAY** in reporting injury and seeking evaluation in the Emergency Room. The incident must also be reported to your supervisor by the end of the shift.



#### **Noise and Vibration**

Noise and vibration can have severe impact on our patients and their ability to heal, staff ability to provide safe and proper care and KCH's ability to provide a harm free work environment for our employees.

All construction activities resulting in potential harmful noise levels will be pre authorized by the Facilities Director and communicated prior to the beginning work with unit managers that may be impacted by the noise/vibrations. If excessive noise levels are reported the construction work will be halted and alternative construction methods or noise barriers will be required.

#### **Medical Equipment**

Medical Equipment such as ventilators and heart monitors are found throughout KCH.

Only authorized individuals may operate or change settings on medical equipment. Contractor employees involved in construction are not authorized to operate, move, or change settings on any medical equipment. All issues regarding medical equipment must be referred to nursing staff or the Facilities Director. **Never unplug equipment that** is plugged into a RED outlet.

# **Utility Systems**

Kona Community Hospital depends on uninterrupted delivery of utilities to operate equipment that is crucial to daily operations. Any utility shutdown must be coordinated with the Facilities Director to avoid interruption of any utility service. **NO contractor shall turn off** any valve, circuit or switch.

### **English Proficiency Guidelines**

For safety and general information purposes, contract workers with limited English proficiency shall be assigned within close proximity to contract workers that have a fluency in English.

# **Confined Space**

Many workplaces contain spaces that are considered "confined" because their configurations hinder the activities of employees who must enter, work in, and exit them. A confined space has limited or restricted means for entry or exit, and it is not designed for continuous human occupancy. Confined spaces include, but are not limited to underground vaults, tanks, storage bins, manholes, pits, silos, process vessels, and pipelines. Contractors must follow the OSHA guideline standard for Confined Space 1940.146 subpart A, B, C, D, E and F. A confined entry permit must be approved by the Facilities Director, as well as, 48 hours prior notice of the confined space being entered.

# **Signage**


Kona Community Hospital maintains signage in the buildings. Construction or renovation contractors, however, must ensure that proper signage remains posted as facilities are modified or new construction is added.

## **Infection Control Containment Systems**


Containment units such as Aire Guardian, Hepacart and Zip Wall Systems are the responsibility of the contractor to procure and maintain. The plastic vinyl sheeting used on the containment units must be flame resistant and UL labeled to support flammability standards. The contractor is responsible for the proper use, setup, and the disinfection of the cubes daily and more frequently if needed and required by the infection control risk assessment/permit. Primary filtration on HEPA units must be replaced as needed when observed to be clogged or dirty. HEPA filters are to be changed every 2 years or as needed. Record keeping is required on filter change outs.




The following five Infection Control Isolation Signs are used in the facility to indicate serious and potentially infectious conditions. Personal Protective Equipment and specific disinfection procedures are REQUIRED to enter/exit these areas safely. You MUST work with nursing on appropriate procedures prior to entering these rooms.

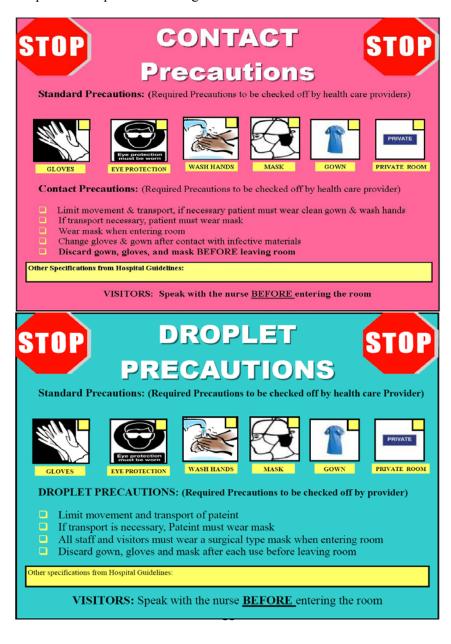



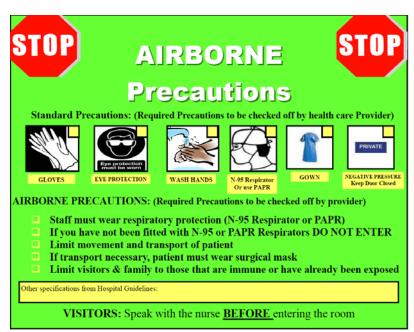

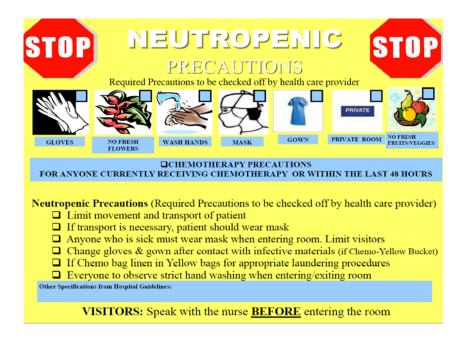

| 110165 |
|--------|
|        |
|        |
|        |
|        |
|        |
|        |
|        |
|        |
|        |
|        |
|        |
|        |

Notos

# INFECTION CONTROL RISK ASSESSMENT Matrix of Precautions for Construction and Renovation

| STEP ON Using the Activity | e following table identify: Type of Construction Project  |  |  |  |  |  |
|----------------------------|---|--|--|--|--|--|
| Type A                     | Inspection and Non-invasive Activities  |  |  |  |  |  |
|                            | Includes, but not limited to:   |  |  |  |  |  |
|                            | Removal of ceiling tiles for visual inspection-limited to 1 tile per 50 square feet. Painting, but not sanding; and wall covering, electrical trim work, minor plumbing, and activities that do not generate dust, require cutting of walls or access to ceilings other than for visual inspection. |  |  |  |  |  |
| Type B                     | Small Scale, Short Duration Activities that Create Minimal Dust   |  |  |  |  |  |
|                            | Includes, but not limited to:   |  |  |  |  |  |
|                            | Installation of telephone and computer cabling; access to chase spaces; and cutting of walls or ceiling where dust  |  |  |  |  |  |
|                            | migration can be controlled.  |  |  |  |  |  |
| Type C                     | Work that Generates a Moderate to High Level of Dust or Requires Demolition or Removal of Any Fixed-Building Components or Assemblies Includes, but not limited to:   |  |  |  |  |  |
|                            | Sanding of walls for painting or wall covering; removal of floor coverings, ceiling tiles, and casework; new wall construction; minor duct work or electrical work above ceilings; major cabling activities and any activity that cannot be completed within a single work shift.                   |  |  |  |  |  |
| Type D                     | Major Demolition and Construction Projects  |  |  |  |  |  |
|                            | Includes, but not limited to:   |  |  |  |  |  |
|                            | Activities that require consecutive work shifts;  |  |  |  |  |  |
|                            | Requires heavy demolition or removal of a complete cabling system; and new construction.  |  |  |  |  |  |

### **STEP TWO:**

**Using the following tables identify: Patient Risk Groups** that will be affected. If more than one group select the higher risk group.

| LOW<br>RISK     | MEDIUM RISK  | HIGH RISK  | HIGHEST RISK   |
|-----------------|--|--|--|
| Office<br>Areas | Cardiology Echo- Cardiography Endoscopy  Nuclear Med | Critical Care Emergency Dept Labor & Delivery Newborn Nursery Laboratory | Any area caring for Immuno compromised Burn Units Cardiac Cath Lab Oncology Central Sterile Supply   |
|                 | Rehab Therapy  Radiology/MRI Respiratory Therapy     | Surgery Pharmacy Pediatrics Post Anesthesia Care Unit Surgical Units     | Intensive Care Units Medical Units Negative pressure isolation rooms Operating rooms C-Section rooms |

## **STEP THREE:**

#### Match:

Construction Project Type – A, B, C or D

Patient Risk Groups – Low, Medium, High or Highest

## **Class of Precautions**

I, II, III, or IV will determine the level of infection control activities required for your construction project.

**Class I-IV or Color-coded Precautions** 

| IC Matrix—Class of Precautions Construction Project by Patient Risk |                             |        |        |        |  |  |
|---|-----------------------------|--------|--------|--------|--|--|
| PATIENT<br>RISK GROUP   | CONSTRUCTION PROJECT TYPE   |        |        |        |  |  |
|   | Type A Type B Type C Type D |        |        |        |  |  |
| LOW Risk  | T I                         | П      | П      | III/IV |  |  |
| MEDIUM Risk   | _                           | =      | ≡      | IV     |  |  |
| HIGH Risk   | _                           | =      | III/IV | IV     |  |  |
| <b>HIGHEST</b> Risk   | I                           | III/IV | III/IV | IV     |  |  |

|             | During Construction Project   | Upon Completion of Project   |
|-------------|---|--|
| Class<br>I  | Execute work by methods to minimize di<br>Immediately replace a ceiling tile displace   | ·  |
| Class<br>II | Provide active means to prevent airborne dust from dispersing into air. Water mist work area to control dust while cutting. Seal unused doors with duct tape. Isolate & seal air vents. Place sticky mat at entrance & exit of work area. Remove or isolate HVAC system in areas where work is being performed.   | Wipe all surfaces with disinfectant. Contain construction waste & transport in tightly covered containers. Wet mop &/or vacuum with a HEPA filtered vacuum prior to leaving work area. Clean & disinfect containment units. Remove isolation of HVAC system in areas that work is being performed.   |
| Class       | Isolate HVAC to prevent contamination of duct system. Construct critical barriers (sheet rock, plywood, zip wall) sealing area or implement containment unit with HEPA filtration prior to start of project. Maintain negative air pressure at work site with HEPA air-filtration. Contain construction waste & equipment before transport in tightly covered containers. Cover transport container or carts & tape covering, unless solid cover.   | Do not remove barriers from area until completed project is inspected by Maintenance or Infection Control & is thoroughly cleaned by Environmental Services. Remove barrier material carefully after wiped with disinfectant to minimize the spread of construction dirt & debris. Vacuum area with HEPA filtered vacuum. Wet mop area with disinfectant. Remove isolation of HVAC system in work areas. Disinfect containment units.                            |
| Class<br>IV | Isolate HVAC to prevent contamination of duct system. Construct critical barriers (sheet rock, plywood, zip wall) sealing area or implement containment unit with HEPA filtration prior to start of project. Maintain negative air pressure at work Site with HEPA air-filtration. Seal holes pipes/conduits & punctures properly. Construct anteroom all workers pass through to be vacuumed off using HEPA vacuum before exiting area, or they must wear jumpsuits that are removed each time they exit work site. Shoe covers required when entering work site & must be changed each time worker exits area. Do not remove barriers from area until completed project is inspected by Maintenance or Infection Control & thoroughly cleaned by Environmensual Services. | Remove barrier material carefully after wiped with disinfectant to minimize the spreading of construction dirt & debris. Contain construction waste & transport in tightly covered containers. Cover transport receptacle or cart & tape covering, unless solid cover. Vacuum work area with HEPA filtered vacuum & wet mop area with disinfectant. Remove isolation of HVAC system in areas where work is being performed. Clean & disinfect containment units. |

| INFECTION CONTROL CONSTRUCTION PERMIT   |  |    |  |         |       |        |   |
|---|--|----|--|---------|-------|--------|---|
| Locat   | Location of Construction: Permit No.:  |    |  |         |       |        |   |
| Proje   | ct Coo   | rd | inator:  | Р       | oje   | ct St  | tart Date:  |
| Contr   | actor I  | Рe | rforming Work:                                       | E       | st. 7 | Гime   | of Completion:  |
| Super   | visor:   |    | Telephone:   | Р       | erm   | nit Ex | piration Date:  |
| YES   | NO   |    | CONSTRUCTION<br>ACTIVITY                             | YES     |       | NO     | RISK GROUP  |
|   |  | 7  | TYPE A Inspection, non-                              |         |       |        | GROUP 1 Low Risk  |
|   |  |    | nvasive  |         |       |        |   |
|   |  |    | TYPE B Small scale short                             |         |       |        | GROUP 2 Medium Risk   |
|   |  | ·  | duration minimal dust                                |         |       |        |   |
|   |  |    | TYPE C Mod/high dust,                                |         |       |        | GROUP 3 Medium/High Risk  |
|   |  |    | nultiple shifts demolition.  TYPE D Major demolition |         | -     |        | GROUP 4: Highest Risk   |
|   |  |    | construction multiple shift                          |         |       |        | GROUP 4. Highest Risk   |
|   |  |    |  | ction o | per   | ation  | s. Immediately replace ceiling  |
| CLAS  | SI   |    | tiles displaced for visual ins                       |         |       |        |   |
| CLAS  | Provides active means to prevent airborne dust from dispersing into air.  Water mist work surfaces to control dust while cutting. Seal unused doors.  Block off & seal air vents. Wipe surfaces with disinfectant. Contain construction waste for transport in tightly covered containers. Wet mop &/or vacuum with HEPA filtered vacuum prior to leaving area. Place sticky mat at entrance & exit. Isolate HVAC to prevent containment of duct system. Construct containment barriers. Clean containment cubicles daily. |    |  |         |       |        |   |
|   | Block HVAC prevent contamination of duct system. Construct containment barriers. Negative air pressure & HEPA air-filtration. Do not remove barrier until project inspected & cleaned. Vacuum with HEPA filters & wet mop with disinfectant. Remove barrier minimizing spread of dirt & debris. Contain waste before transport in tightly covered carts & tape covering if not secure. Clean containment units & disinfect daily.  |    |  |         |       |        |   |
| Block HVAC prevent contamination of duct system. Construct containment barriers. Negative air pressure & HEPA air-filtration. Seal holes, pipes, conduits, & punctures. Construct anteroom all workers pass through to be vacuumed off with HEPA vacuum prior to exiting, or can wear jumpsuit that is removed each time they exit work site. When entering work site shoe Covers required. Barriers remain up until project is inspected & thoroughly cleaned by ES. Vacuum area with HEPA filtered vacuum & wet mop with disinfectant. Remove barrier minimizing spread of dirt and debris. Contain waste before transport in tightly covered carts & tape covering if not secure. Clean containment units & disinfect daily. |  |    |  |         |       |        |   |
| Addit   | Additional Requirements:   |    |  |         |       |        |   |
| Date: Initials:   |  |    |  | ar      |       |        | and/or additions to this permit<br>by attached memoranda.<br>Initials |
| Permi   | Permit Requested By: Date:   |    |  |         | ermi  | it Aut | thorized By: Date:  |

| F<br>a<br>F | FIRE OR SMOKE BARRIER PENETRATION PERMIT  ContractorIn House WorkDate Issued:  Penetration Permit is required for work that will, or has potential to; disrupt the integrity of any floor, wall or ceiling which serves as a smoke or fire barrier by drilling, cutting, boring, destruction or other means. PERMIT must be completed if a Work Permit has been requested which includes penetration.  Permit MUST be signed by the Facilities staff PRIOR to the ceiling tiles being replaced. Failure to return this signed permit may prohibit payment until you are in compliance with this policy.  This permit MUST be posted on the ladder or in the immediate area of work. |     |          |            |   |       |            |
|-------------|---|-----|----------|------------|---|-------|------------|
| 7           | his permit MUST be post<br>Briefly Descri   |     |          |            |   |       |            |
|             | Type of Penetration   |     | ocation  | Purpose    |   |       | plete Date |
|             |   |     |          |            |   |       |            |
|             | CRITERIA CONSIDERATIONS Accept  |     |          |            |   |       |            |
|             | Is wall, ceiling or floor a fire or smoke barrier?  Does current fire stopping exist or is this a new penetration?  Is the fire stop to be used approved by the hospital?  Has documented training for the application of fire stop  If not smoke/fire barrier, no permit is required  Current fire stop material to be evaluated for integrity post re-penetration work  To have barrier?  Ourrent fire stop material to be evaluated for integrity post re-penetration work  To have barrier?  Any person applying fire stop MUST be trained on application   |     |          |            |   |       |            |
| -           | been done?  Must review existing plans/ drawings for any concealed hazards?  Are UL Specifications available?  Attach proper UL Specifications.   |     |          |            |   |       |            |
| F           | TO BE COMPLETED BY FA<br>Facilities Representative<br>SPECIAL INSTRUCTIONS/<br>WORK APPROVED (Bet   | COI | NDITIONS | S FOR PERM | - | DENIE | D          |

COMPLETED PERMIT MUST BE RETURNED TO FACILITIES & POSTED AT WORK SITE.  $$^{41}$$ 

Facilities Representative:\_\_\_\_\_\_ Date:\_\_\_\_\_\_ Print

### PORTABLE LADDER USE PERMIT

**Note:** This permit, which mut be accessible during performance of the work, is to be used when performing work from a portable ladder where a fall exposure of 6 feet or greater exisits & an approved conventional fall protection system is not available or creates a greater hazard.

|  | Proi | ect & Job Location: | Issue Date: |
|--|------|---------------------|-------------|
|--|------|---------------------|-------------|

### PORTABLE LADDER USE JUSTIFICATION

| SELECT CONTROLS                    | TO BE USED TO R    | EDUCE FALL HAZARD        |  |  |
|------------------------------------|--------------------|--------------------------|--|--|
| Safety Monitor Assigned*           | 3 Point contac     | t maintained during task |  |  |
| Secure ladder to fixed object      | Short Duration     | n Task (less 10 mins)    |  |  |
| Light Duty Task (material bei      | ng handled weigh   | s less than 5 lbs)       |  |  |
| Use of special instructions (D     | escribe):          |                          |  |  |
| Selection of Special Work Methods: |                    |                          |  |  |
|                                    | APPROVALS          |                          |  |  |
| Prepared By: Print:                | Sign:              | Date:                    |  |  |
|                                    |                    |                          |  |  |
| Approved By: Print:                | Sign:              | Date:                    |  |  |
| (Field                             | d Work Supervisor  | ·)                       |  |  |
|                                    |                    |                          |  |  |
| Approved By: Print:                | Sign:              | Date:                    |  |  |
| (Proj                              | ject Safety Repres | entative)                |  |  |

## **UF HOT WORK PERMIT**

This Hot Work Permit is required for any operation involving upon flames or producing heat and/or sparks and must be completed by a Competent Hot Work Supervisor (CHWS) and posted at the site. Hot Work includes, but is not limited to: Brazing, Torch Cutting, Grinding, Soldering, and Welding. If the required precautions cannot be met, Hot Work is not permitted.

| Covered with damp sand or fire resistant sheets.    Remove other combustibles where possible. Otherwise protect with fire-resistant tarpaulins, screens or shelds.   All wall and floor openings covered.  | HOT WORK DONE BY   | Combustible floors wet down,   |
|--|--|--|
| Remove other combustibles where possible. Otherwise protect with finr-resistant tarpaulins, screens or shields.   All wall and floor openings covered.   | CONTRACTOR   | covered with damp sand or fire-  |
| BUILDING NAME. BLDG #, ROOM #, LOCATION  NATURE OF JOB  NAME OF HOT WORK OPERATOR  I verify the above location has been examined, the precautions checked on the Required Precautions Checklist have been taken to prevent lire, and permission is authorized for work.  Work on walls or ceilings/enclosed equipment   Construction is noncombustible and without combustible covering or insulation.  Combustibles on other side of walls moved away.  No danger exists by conduction of heat into another room or area   Enclosed equipment cleaned of all combustibles.  Contact # Fax # PERMIT DATE TIME OAM OPM  SIGNATURE OF CHWS  REQUEST OPM  ENHES OPM  SIGNATURE OF CHWS  REQUIRED PRECAUTIONS CHECKLIST  Approved Deprivation Date  Notes:  REQUIRED PRECAUTIONS CHECKLIST  Approved Deprivation Date  Notes:  Available sprinklers, hose streams, and extinguishers are in service/operable. Hot work equipment in good repair.  Requirements within 35t of work Plannable liquids, dust, lint and oil deposits removed.  Explosive atmosphere in area climinated. Floors swept clean of combustibles.  | DATE: WO#  | resistant sheets.  |
| NATURE OF JOB  | MINISTER STREET, STREE | Remove other combustibles where  |
| NATURE OF JOB  | BUILDING NAME, BLDG #, ROOM #, LOCATION  | possible. Otherwise protect with   |
| NAME OF HOT WORK OPERATOR    Verify the above location has been examined, the precautions checked on the Required Precautions Checkfulst have been taken to prevent fire and permission is authorized for work.    Vork on, walls or ceilings/enclosed equipment   | A STATE OF THE STA |  |
| NAME OF HOT WORK OPERATOR  | NATURE OF JOB  | The state of the s |
| NAME OF HOT WORK OPERATOR  |  | All wall and floor openings covered.   |
| NAME OF HOT WORK OPERATOR  |  | Fire-resistant tarpaulins suspended  |
| Construction is noncombustible and without combustible on on the Required Precautions Checklist have been taken to prevent fire, and permission is authorized for work.  NAME OF COMPETENT HOT WORK SUPERVISOR (CHWS)    Contact #   | NAME OF HOT WORK OPERATOR  | beneath elevated hot work.   |
| checked on the Required Precoutions Checklist have been taken to prevent fire, and permission is authorized for work.  NAME OF COMPETENT HOT WORK SUPERVISOR (CHWS)  Contact # Fax # Fax # PERMIT DATE TIME OAM REQUEST OPM  PERMIT DATE TIME OAM OPM  EXPIRES OPM  SIGNATURE OF CHWS  REQUIRED PRECAUTIONS CHECKLIST  Approved Expiration Date  Notes:  REQUIRED PRECAUTIONS CHECKLIST  Approved Expiration Date  Notes:  Available sprinklers, hose streams, and extinguishers are in service/operable. Hot work equipment in good repair.  Requirements within 35ft of work  Flammable liquids, dust, fint and oil deposits removed.  Explosive atmosphere in area climinated.  Floors swept clean of combustibles.  Combustibles covering or insulation.  Combustible covering or insulation.  Combustible covering or insulation.  Combustibles on other side of walls moved away.  Conduction of heat into another room or area  Enclosed equipment cleaned of all combustibles.  Containers purged of flammable liquids and vapors.  Fire watch for work area monitoring.  Fire watch work area monitoring.  Fire watch is supplied with suitable ext nguishers.  Fire watch will be provided during and continuously for 30 minutes after job is completed.  Confined space entry permit required.  Area is protected with smoke or heat detecti |  | Work on walls or ceilings/enclosed equipment   |
| checked on the Required Precautions Checklist have been taken to prevent fire, and permission is authorized for work.  NAME OF COMPETENT HOT WORK SUPERVISOR (CHWS)  Contact # Fax #  PERMIT DATE TIME OAM REQUEST OPM  EERMIT DATE TIME OAM OPM  EXPIRES OPM  EIMAS Approval  EHAS Approval  REQUIRED PRECAUTIONS CHECKLIST  Approved Expiration Date  Notes:  Available sprinklers, hose streams, and extinguishers are in service/operable. Hot work equipment in good repair.  Requirements within 35ft of work  Flammable liquids, dust, lint and oil deposits removed.  Explosive atmosphere in area climinated.  Floors swept clean of combustibles.  Combustibles covering or insulation.  Combustible covering or insulation.  Combustible covering or insulation.  Combustible covering or insulation.  Combustibles covering or insulation.  Combustibles on ther side of walls moved away.  No danger exists by conduction of heat into another room or area  Enclosed equipment cleaned of all combustibles into another room or area  Enclosed equipment cleaned of all combustibles on other side of walls moved away.  Contact # Fax #  Enclosed equipment cleaned of all combustibles into another room or area  Enclosed equipment cleaned of all combustibles on other side of walls moved away.  Contact # Fax #  Enclosed equipment cleaned of all combustibles into another room or area  Enclosed equipment cleaned of all combustibles on other side of walls moved away.  Contact # Fax #  Enclosed equipment cleaned of all combustibles into another room or area  Enclosed equipment deaned of all combustibles into another room or area  Enclosed equipment deaned of all combustibles into another room or area  Enclosed equipment deaned of all combustibles into another room or area  Enclosed equipment deaned of all combustibles into another room or area  Enclosed equipment deaned of all combustibles and vapors.  Containers purged of flammable liquids and vapors.  Fire watch will be provided during and continuously for 30 minutes after work including during and excent was | I verify the above location has been examined, the precautions   | Construction is noncombustible and without   |
| NAME OF COMPETENT HOT WORK SUPERVISOR (CHWS)  Contact # Fax # Fax #  PERMIT DATE TIME OAM OPM PERMIT DATE TIME OAM OPM SIGNATURE OF CHWS  SIGNATURE OF CHWS  Fire watch/hot work area monitoring. Fire watch will be provided during and continuously for 30 minutes after work, including during any work breaks. Fire watch is supplied with suitable extinguishers.  REQUIRED PRECAUTIONS CHECKLIST Approved Expiration Date Notes:  Available sprinklers, hose streams, and extinguishers are in service/operable. Hot work equipment in good repair. Requirements within 35ft of work Flammable liquids, dust, lint and oil deposits removed.  Explosive atmosphere in area eliminated. Floors swept clean of combustibles.   | checked on the Required Precautions Checklist have been  | combustible covering or insulation.  |
| Contact #  |  | Combustibles on other side of walls  |
| Contact # Fax #   Fax  |  | moved away.  |
| Enclosed equipment cleaned of all combustibles.   Containers purged of flammable liquids and vapors.   | (CHWS)   | No danger exists by conduction of heat into  |
| PERMIT   DATE   TIME   | Contact # Fay #  | another room or area   |
| REQUEST DATE TIME OAM OPM  SIGNATURE OF CHWS  SIGNATURE OF CHWS  EM&S Approval  EH&S Approval  REQUIRED PRECAUTIONS CHECKLIST  Approved Expiration Date Notes:  Available sprinklers, hose streams, and extinguishers are in service/ operable. Hot work equipment in good repair.  Requirements within 35ft of work Flammable liquids, dust, lint and oil deposits removed. Explosive atmosphere in area climinated. Floors swept clean of combustibles.  Containers purged of flammable liquids and vapors.  Fire watch/hot work area monitoring. Fire watch/hot work area monitoring. Fire watch work area in supplied with suitable extinguishers.  Fire watch is supplied with suitable extinguishers.  Fire watch is supplied with suitable extinguishers.  Fire watch is supplied with surve of this equipment and in sounding alarm. Fire watch may be required for adjoining areas, above and below. Hot work area inspected 30 minutes after job is completed.  Other precautions Taken Confined space entry permit required.  Area is protected with smoke or heat detection.  Ample ventilation to remove smoke/vapor from work area. Lockout/tagout required. Comments:   |  | ☐ Enclosed equipment cleaned of all  |
| Containers purged of flammable liquids and vapors.    Fire watch/hot work area monitoring.   |  | combustibles.  |
| Fire watch/hot work area monitoring.    Fire watch will be provided during and continuously for 30 minutes after work, including during any work breaks.   Fire watch is supplied with suitable extinguishers.   Fire watch is trained in use of this equipment and in sounding alarm.   Fire watch may be required for adjoining areas, above and below.   Hot work area inspected 30 minutes after job is completed.   Available sprinklers, hose streams, and extinguishers are in service/operable.   Hot work area inspected 30 minutes after job is completed.   Confined space entry permit required.   Area is protected with smoke or heat detection.   Ample ventilation to remove smoke/vapor from work area.   Lockout/tagout required.   Comments:  |  | Containers purged of flammable liquids   |
| Fire watch/hot work area monitoring.  Fire watch will be provided during and continuously for 30 minutes after work, including during any work breaks.  Fire watch is supplied with suitable extinguishers.  Fire watch is trained in use of this equipment and in sounding alarm.  Fire watch may be required for adjoining areas, above and below.  Hot work area inspected 30 minutes after job is completed.  Other precautions Taken  Confined space entry permit required.  Area is protected with smoke or heat detection.  Ample ventilation to remove smoke/vapor from work area.  Lockout/tagout required.  Comments:   |  | and vapors.  |
| Fire watch will be provided during and continuously for 30 minutes after work, including during any work breaks.   Fire watch is supplied with suitable extinguishers.   Fire watch is trained in use of this equipment and in sounding alarm.   Fire watch may be required for adjoining areas, above and below.   Hot work area inspected 30 minutes after job is completed.   Other precautions Taken   Confined space entry permit required.   Area is protected with smoke or heat detection.   Ample ventilation to remove smoke/vapor from work area.   Lockout/tagout required.   Comments:  | SIGNATURE OF CHWS  |  |
| Continuously for 30 minutes after work, including during any work breaks.    Fire watch is supplied with suitable extinguishers.   Fire watch is trained in use of this equipment and in sounding alarm.   Fire watch may be required for adjoining areas, above and below.   Hot work area inspected 30 minutes after job is completed.   Other precautions Taken   Confined space entry permit required.   Area is protected with smoke or heat detection.   Ample ventilation to remove smoke/vapor from work area.   Lockout/tagout required.   Comments:  |  |  |
| including during any work breaks.    Fire watch is supplied with suitable extinguishers.   | THE CA   |  |
| Fire watch is supplied with suitable extinguishers.   Fire watch is trained in use of this equipment and in sounding alarm.   Fire watch may be required for adjoining areas, above and below.   Hot work area inspected 30 minutes after job is completed.   Other precautions Taken   Confined space entry permit required.   Area is protected with smoke or heat detection.   Ample ventilation to remove smoke/vapor from work area.   Lockout/tagout required.   Comments:   | Erioco Approvat  |  |
| REQUIRED PRECAUTIONS CHECKLIST  Approved Expiration Date Notes:  Available sprinklers, hose streams, and extinguishers are in service/operable. Hot work equipment in good repair. Requirements within 35ft of work Flammable liquids, dust, lint and oil deposits removed. Explosive atmosphere in area eliminated. Floors swept clean of combustibles.  extinguishers. Fire watch is trained in use of this equipment and in sounding alarm. Fire watch may be required for adjoining areas, above and below. Hot work area inspected 30 minutes after job is completed.  Other precautions Taken Confined space entry permit required. Area is protected with smoke or heat detection. Ample ventilation to remove smoke/vapor from work area. Lockout/tagout required. Comments:   |  |  |
| Fire watch is trained in use of this equipment and in sounding alarm.   Fire watch may be required for adjoining areas, above and below.   Hot work area inspected 30 minutes after job is completed.     Available sprinklers, hose streams, and extinguishers are in service/operable.   Hot work equipment in good repair.   Confined space entry permit required.     Area is protected with smoke or heat detection.   Ample ventilation to remove smoke/vapor from work area.   Lockout/tagout required.     Explosive atmosphere in area eliminated.   Floors swept clean of combustibles.   Comments:  |  |  |
| Approved  Expiration Date  Notes:    Available sprinklers, hose streams, and extinguishers are in service/operable.   Hot work equipment in good repair.   Requirements within 35ft of work   Flammable liquids, dust, lint and oil deposits removed.   Explosive atmosphere in area eliminated.   Floors swept clean of combustibles.   And in sounding alarm.   Fire watch may be required for adjoining areas, above and below.   Hot work area inspected 30 minutes after job is completed.   Confined space entry permit required.   Area is protected with smoke or heat detection.   Ample ventilation to remove smoke/vapor from work area.   Lockout/tagout required.   Comments:   |  |  |
| Expiration Date  Notes:    Fire watch may be required for adjoining areas, above and below.   Hot work area inspected 30 minutes after job is completed.    Available sprinklers, hose streams, and extinguishers are in service/operable.   Hot work equipment in good repair.   Confined space entry permit required.   Area is protected with smoke or heat detection.   Ample ventilation to remove smoke/vapor from work area.   Lockout/tagout required.   Comments:   | and the same of th |  |
| Notes:  areas, above and below. Hot work area inspected 30 minutes after job is completed.  Other precautions Taken Confined space entry permit required.  Hot work equipment in good repair. Requirements within 35ft of work Flammable liquids, dust, fint and oil deposits removed. Explosive atmosphere in area eliminated. Floors swept clean of combustibles.  areas, above and below. Hot work area inspected 30 minutes after job is completed.  Confined space entry permit required.  Area is protected with smoke or heat detection.  Ample ventilation to remove smoke/vapor from work area. Lockout/tagout required. Comments:  |  |  |
| Hot work area inspected 30 minutes after job is completed.    Available sprinklers, hose streams, and extinguishers are in service/operable.   Hot work equipment in good repair.   Requirements within 35ft of work   Area is protected with smoke or heat detection.   Flammable liquids, dust, lint and oil deposits removed.   Explosive atmosphere in area eliminated.   Lockout/tagout required.   Comments:   |  |  |
| Available sprinklers, hose streams, and extinguishers are in service/operable.   Hot work equipment in good repair.   Area is protected with smoke or heat detection.   Ample ventilation to remove smoke/vapor from work area.   Lockout/tagout required.   Comments:   | (Notes:  |  |
| Available sprinklers, hose streams, and extinguishers are in service/operable.  Hot work equipment in good repair.  Requirements within 35ft of work detection.  Flammable liquids, dust, lint and oil deposits removed.  Explosive atmosphere in area eliminated.  Floors swept clean of combustibles.  Confined space entry permit required.  Area is protected with smoke or heat detection.  Ample ventilation to remove smoke/vapor from work area.  Lockout/tagout required.  Comments:  |  |  |
| and extinguishers are in service/operable.  Hot work equipment in good repair.  Requirements within 35ft of work  Flammable liquids, dust, lint and oil deposits removed.  Explosive atmosphere in area climinated.  Floors swept clean of combustibles.  Area is protected with smoke or heat detection.  Ample ventilation to remove smoke/vapor from work area.  Lockout/tagout required.  Comments:  |  | Other precautions Taken  |
| <ul> <li>Hot work equipment in good repair.</li> <li>Requirements within 35ft of work</li> <li>☐ Flammable liquids, dust, lint and oil deposits removed.</li> <li>☐ Explosive atmosphere in area climinated.</li> <li>☐ Floors swept clean of combustibles.</li> <li>☐ Area is protected with smoke or heat detection.</li> <li>☐ Ample ventilation to remove smoke/vapor from work area.</li> <li>☐ Lockout/tagout required.</li> <li>Comments:</li> </ul>  |  | Confined space entry permit required.  |
| Requirements within 35ft of work    Flammable liquids, dust, lint and oil deposits removed.   Explosive atmosphere in area climinated.   Floors swept clean of combustibles.   Comments:   |  |  |
| ☐ Flammable liquids, dust, lint and oil deposits removed.       ☐ Ample ventilation to remove smoke/vapor from work area.         ☐ Explosive atmosphere in area climinated.       ☐ Lockout/tagout required.         ☐ Floors swept clean of combustibles.       Comments:  |  |  |
| oil deposits removed. from work area.  Explosive atmosphere in area climinated.  Floors swept clean of combustibles. from work area.  Lockout/tagout required.  Comments:  |  |  |
| ☐ Explosive atmosphere in area climinated. ☐ Lockout/tagout required. ☐ Comments:  |  |  |
| Floors swept clean of combustibles. Comments:  |  |  |
|  |  |  |
| [ Combustible Hoors wet down ]   | Combustible floors wet down.   | Comments:  |

FAX TO EH&S @352-392-6367 PRIOR TO 8:00AM OF PERMIT REQUEST DATE
This Permit was developed for compliance with:
EH&S HOT WORK SAFETY POLICY UFEHS-SAFE1-07/22/2003

## WARNING

## HOT WORK IN PROGRESS WATCH FOR FIRE

#### PART 2

#### INSTRUCTIONS 1. Person doing Hot Work Indicate time started and post REQUIRED PRECAUTIONS CHECKLIST permit at Hot Work location. Available sprinklers, hose streams After Hot Work, Indicate time completed and leave permit posted for fire watch. and extinguishers are in service. 2. Fire Watch: Prior to leaving area, do final inspection and Hot Work equipment in good repair. sign permit. 3. Return completed permit to Project Manager or Risk WITHIN 35 FEET OF WORK Management before leaving campus. Flammable liquids, dust, lint and oily **HOT WORK BEING DONE BY:** deposits removed. EMPLOYEE Explosive atmosphere in area eliminated. DEPARTMENT Floors swept clean of combustibles. Combustible floors wet down, covered CONTRACTOR with damp sand, metal or fire-resistive SITE FOREMAN tarpaulins. Remove other combustibles or protect with PROJECT MANAGER fire-resistive tarpaulins or metal shields. All wall and floor openings covered. DATE Fire-resistive tarpaulins suspended beneath work to collect sparks. LOCATION / BUILDING & FLOOR **WORK ON WALLS OR CEILINGS** Construction noncombustible and without NATURE OF JOB combustible covering. Combustibles moved away from other side of Required safety precautions have been done. WORK ON ENCLOSED EQUIPMENT Equipment cleaned of all combustibles. Signature of responsible person Containers purged of flammable vapors. Permission is given to do this work, provided required precautions have been done. FIRE WATCH SIGNED: (EHS) Fire watch to be provided during and for 60 minutes after work. PERMIT EXPIRES: Fire watch to be provided for 4 hours after DATE TIME work in areas without smoke detection. TIME STARTED: TIME FINISHED: Supplied with suitable extinguishers Trained in the use of equipment and in sounding fire alarm. TIRE WATCH SIGNOFF Fire watch may be required for adjoining ork area and all adjacent areas to which sparks and heat areas above and below. might spread were inspected during the fire watch period OTHER PRECAUTIONS TAKEN and were found fire safe. SIGNED:

## **WARNING!**

HOT WORK IN PROGRESS
WATCH FOR FIRE

IN CASE OF AN EMERGENCY

**CALL: CHHANY: 430-2588** 

ERIC:854-5583

**WARNING!** 

| *                               | Category: Administration       | Policy No.: 123-2              |
|---------------------------------|--------------------------------|--------------------------------|
| Kona<br>Community Hospital      | Administration                 | Revised:<br>Oct 8, 2009        |
| Policies and Procedures         | Issued By: Environment of Care | Effective Date: April 17, 2002 |
| Subject:<br>INTERIM LIFE SAFETY | Approved By:                   | Supersedes Policy:             |
| MEASURES                        | Assistant Administrator        | Page:<br>1 of 1                |

#### **PURPOSE:**

Interim Life Safety Measures (ILSMs) are required to temporarily compensate for the hazards posed by existing life safety code (LSC) deficiencies or construction activities. ILSM shall apply to all personnel, including construction workers.

#### POLICY:

Each interim life safety measure must be documented. Implementation of ILSM must begin upon project development, and continuously be enforced through to project completion. Inspection, testing and monitoring and evaluation actions shall be reported monthly at the hospital safety committee meeting. ILSM consists of the actions listed below.

#### PROCEDURES:

- A. Ensure daily inspection of exits to provide free and unobstructed egress. Personnel shall receive training if alternative exits must be designated.
- B. Ensure free and unobstructed access to emergency department or services, and for emergency forces.
- C. Ensure that fire alarm, detection, and suppression systems are not impaired. Provide a temporary, but equivalent system when any fire system is impaired.
  - Notify the Fire Department and alarm company when the alarm system in not working.
  - Announce every hour: "interim safety measures are in place." After hours, the supervisor notifies all units that ILSMs are in place.
- D. Ensure temporary partitions are smoke-tight and built on noncombustible materials.
- E. Develop and enforcing smoking pollicies and procedures in excess of JCAHO standards. Smoking shall be prohibited in or adjacent to all construction areas.
- F. Develop and enforce storage, housekeeping, and debris removal policies and procedures that reduce the flammable and combustible fire load to the lowest level necessary for daily operations.
- G. Conduct at least two fire drills per shift, per quarter. When temporary systems are in place, inspect, test and document readiness of temporary systems daily.
  - 1. Visually inspect existing sprinklers and extra fire extinguishers daily.
  - 2. Inspect audible system battery-operated smoke detectors daily.
- H. Increase hazard surveillance of buildings, grounds, and equipment with special attention to excavating, construction areas, storage, and field offices.
- Train personnel when structural features of fire safety are compromised, such as compartmentation change.
- J. Conduct organization-wide-safety-education programs to ensure awareness of any LSC deficiencies, construction hazards and ILSMs.

|   |  |                               |                      |                             | Live                           | Safety Defici   | olloy - I                       | LOR D                                 | ociaio                          | i mau ia                         |   |  |   |
|---|--|-------------------------------|----------------------|-----------------------------|--------------------------------|---|---------------------------------|---------------------------------------|---------------------------------|----------------------------------|---|--|---|
| Location:   |  |                               | _                    |                             |                                | Deficiency:   | _                               |                                       |                                 |                                  |   |  |   |
| Assessed By:  |  |                               | _                    |                             | Ass                            | essment Date:   |                                 |                                       |                                 | Date ap                          | oplicable ILSM initiated  | d (if required):   |   |
| Work Order Number:  |  |                               | _                    |                             |                                |   |                                 |                                       |                                 |                                  |   |  |   |
| 1   |  |                               | П                    |                             | -                              | 9 -   | 1 3                             | r                                     |                                 | nterim Li                        | ife Safety Measures   |  | 0.0   |
|   | ILSM not required. Risk<br>is considered<br>manageable with<br>existing conditions | Emergency forces notification | Fire watch initiated | Signage for alternate exits | Inspect exits on a daily basis | Provide temporary fire alarm and detection systems. Test temporary systems monthly. | Test temporary systems monthly. | Additional fire fighting<br>equipment | Temporary construction barriers | Increased hazard<br>surveillance | Enforce housekeeping, storage and debris removal practices that reduce the fammable and combustible load to the lowest feasible level | Conducting 2 fire drifts<br>per shift per quarter in<br>affected areas | construction hazards,<br>and temporary<br>measures implemented<br>and train those affected. |
| Protection Deficiencies   |  |                               |                      |                             |                                | 100   |                                 | 110                                   | 11 10                           |                                  | ter etc.  |  |   |
| Lecking a code compliant smoke barrier (small hole)                       |  |                               |                      |                             |                                |   |                                 |                                       |                                 |                                  |   |  |   |
| Lacking a code compliant smoke barrier (large hole)                       |  |                               |                      |                             |                                |   |                                 |                                       |                                 |                                  |   |  |   |
| Large penetrations in fire<br>barriers                                    |  |                               |                      |                             |                                |   |                                 |                                       |                                 |                                  |   |  |   |
| Small penetrations in fire barriers                                       |  |                               |                      |                             |                                |   |                                 |                                       |                                 |                                  |   |  |   |
| Suspended ceilings do not<br>prevent the passage of<br>smoke in corridors |  |                               |                      |                             |                                |   |                                 |                                       |                                 |                                  |   |  |   |
| Major renovation of an occupied floor                                     |  |                               |                      |                             |                                |   |                                 |                                       |                                 |                                  |   |  |   |
| Significantly modifying smoke or fire barrier walls                       |  |                               |                      |                             |                                |   |                                 |                                       |                                 |                                  |   |  |   |
| Hazardous areas not<br>property protected                                 |  |                               |                      |                             |                                |   |                                 |                                       |                                 |                                  |   |  |   |
| Exit Deficiencies Blocking off an approved                                |  | -                             | Т                    | -                           |                                |   |                                 |                                       |                                 |                                  |   |  |   |
| exit  |  |                               | H                    |                             |                                |   |                                 |                                       |                                 |                                  |   |  |   |
| Egress path width reduced   |  |                               |                      |                             |                                |   |                                 |                                       |                                 |                                  |   |  |   |
| Door, Deficiencies  |  |                               | 1                    | *                           | -                              | 4   |                                 |                                       | Ų,                              |                                  |   | - 1  |   |
| Door does not close or<br>atch  |  |                               |                      |                             |                                |   |                                 |                                       |                                 |                                  |   |  |   |
| Door and frame not<br>abeled  |  |                               |                      |                             |                                |   |                                 |                                       |                                 |                                  |   |  |   |
| Door does not prevent the bassage of smoke                                |  |                               |                      |                             |                                |   |                                 |                                       |                                 |                                  |   |  |   |
| Fire Alatm and Sprinkler D  | eficiencies  |                               | _                    |                             |                                |   |                                 |                                       |                                 |                                  |   |  |   |
| Fire alarm (out-of-service more than 4 hours)                             |  |                               |                      |                             |                                |   |                                 | - A                                   |                                 |                                  |   |  |   |
| Sprinkler (out-of-service nore than 4 hours)                              |  |                               |                      |                             |                                |   |                                 |                                       |                                 |                                  |   |  |   |
| nstalling sprinkler system<br>1 zone out-of-service)                      |  |                               |                      |                             |                                |   |                                 |                                       |                                 |                                  |   |  |   |
| Disconnecting alarm device (1 at a time)                                  |  |                               |                      |                             |                                |   |                                 |                                       |                                 |                                  |   |  |   |
| Blocked access to the fire department connection                          |  |                               |                      |                             |                                |   |                                 |                                       |                                 |                                  |   |  |   |
| Other Deficiencies  |  |                               |                      |                             |                                |   |                                 | =                                     |                                 |                                  |   |  |   |
|   |  |                               |                      |                             |                                |   |                                 |                                       |                                 |                                  |   |  |   |
| Blocked Hall<br>dinimal Deliciency-                                       |  | -                             | +                    | $\dashv$                    | -                              |   | -                               | -                                     |                                 | -1                               |   |  |   |



Kona Community
Hospital
79-1019 Haukapila Street
Kealakekua, HI 96750

Revised January 2016

## Contractor Guidelines Confirmation of Understanding

By signing this page, I acknowledge that I:

- a. Have read and understand the contents of the contractor Guidelines Booklet.
- b. Responsible for my safety, and will abide by the safety rules of KCH and my employer.

| Name (Print):       |       |  |
|---------------------|-------|--|
| Signature:          | Date: |  |
| Employer:           |       |  |
| Project Name:       |       |  |
| General Contractor: |       |  |



## **APPENDIX M**

## **PRICING SUMMARY**

See following page



## **Pricing Summary for**

Official Company Name (must match W-9)

| Qty  | Item   | Price |
|------|--|-------|
|      |  |       |
| 1    | Materials and all labor to upgrade hospital re-heat hot water system in accordance with all requirements of RFP 21-0044. |       |
| 1    | Permit(s) and inspections  |       |
| 1    | Performance and Payment Bonds  |       |
|      |  |       |
|      |  |       |
|      |  |       |
|      | Subtotal   |       |
|      | GE Tax (4.712%)  |       |
|      | GRAND TOTAL  |       |
| NOTE | Your company's standard quote form may be attached to this form as back up.  |       |

Any options the bidder would like to propose and/or requested pricing arrangements (i.e. deposit)

| Authorized Signature, Title |  |
|-----------------------------|--|
|                             |  |
| Date                        |  |

should be listed below.

NOTE